



Air Quality Management Services, Inc.
“Discovering Solutions for Healthier Living”

INDOOR AIR QUALITY EVALUATION

Particulate Matter and Silica Survey

Biddeford High School
20 Maplewood Avenue – Biddeford, Maine



PREPARED FOR

Biddeford School Department
C/o Mr. Phil Radding – Director of Facilities
PO Box 586
Biddeford, Maine 04005

Date of Survey

December 8th - 10th, 2010

AQM PROJECT #10-510

Nick Ferrala, B.A., CIEC
Microbiologist, Industrial Hygienist

TABLE OF CONTENTS

• PURPOSE & SCOPE	PAGE 1
• BACKGROUND	PAGE 1
• TESTING METHODOLOGY	PAGE 2
• RESULTS	PAGES 3 – 4
• DISCUSSION	PAGES 4 – 9
• RECOMMENDATIONS	PAGES 9 – 10

APPENDICES

I. Purpose and Scope

Air Quality Management Services, Inc. (AQM) conducted a limited Particulate Matter and Silica survey on December 8th – 10th, 2010. Particulate Matter was surveyed in order to evaluate levels and patterns over a 24-hour period in response to concerns over ongoing construction activities as well as prior sample results that indicated elevated particulate and dust issues within the school. Silica was sampled in response to concerns reported to AQM over construction activities and the potential for exposure of school occupants to silica in dust.

II. Background

Air Quality Management (AQM) has been asked to perform mold sampling and particulate screening in individual classrooms (selected by Client) on seven (7) occasions to date. AQM has not been made aware of specific issues or concerns in the individual rooms and has been asked to provide sampling and recommendations for remedial actions where applicable. Some of the sampling has reportedly been in classrooms after cleaning.

Based on the sample results to date, along with observations made during sampling, it appears that many locations had excessive accumulations of dust particularly within / under heating units. This dust has likely been the source of slightly elevated levels of Aspergillus-Penicillium like spores in certain locations, as no other issues were seen and cleaning of dust has resulted in airborne spore levels being reduced to typical background levels.

Elevated particulate matter in classrooms may have been a result of accumulated dust over time, dust from ongoing construction activities or a combination of the two. Thorough detailed-cleaning of classrooms should remove the “historical” dust accumulations and address the mold spore issue, but effective containment of construction areas as well as continued cleaning of settled dust are required to control any dust that may originate from the construction areas. It was reported to AQM that the initial containment of construction areas was less than ideal, but has since been improved dramatically.

The goal of particulate matter sampling was to assess levels throughout the school in select locations over a 24-hour period, in order to give better insight into time and spatial patterns. In particular, locations were selected near construction areas to determine the likelihood that construction activities were contributing to dust levels in the school. Sampling was also conducted in some classrooms and included carbon dioxide (CO₂) monitoring in a subset of those classrooms. Classrooms were selected by the Client and specific issues / concerns were not reported to AQM. Carbon dioxide monitoring was intended as a screen for select classrooms since data collection was relatively simple in conjunction with the other sampling performed in this study. It was not intended as an authoritative evaluation of CO₂ levels and potential issues within the classrooms and/or school as a whole.

Silica sampling (in respirable dust) was also included in each sample location. Inhalation of silica can result in chronic silicosis (generally 10 or more years of exposure), accelerated silicosis (generally 5 to 10 years exposure) and acute silicosis (within weeks to several years of exposure to extremely high levels of silica). It is highly unlikely that silica exposure could result in symptoms experienced by school occupants, since extremely high exposures are required for acute silicosis (the types of exposures only seen in extremely dusty construction and industrial environments). However, silica sampling was included to address concerns (as reported to AQM) and at Client’s request.

III. Testing Methodology

Sampling was conducted in 18 locations on 3 floors throughout the school. Monitoring stations were set up in the afternoon and evening of Wednesday, December 8th, 2010. All equipment (other than for silica sampling) was provided by (and calibrated through) Pine Environmental in Scarborough, Maine.

Silica sampling equipment and supplies were provided by Galson Laboratories, East Syracuse, New York. Sampling began at the start of the school day (7:30 – 8:30am) on Thursday, December 9th, 2010, and proceeded for about 7 hours for silica and 24 hours for the other parameters (until morning of December 10th, 2010).

Sample stations were set up in the following locations:

Table 1. Sample Locations

Site#	Location	Samples
1	Hall by Speech Room (1 st Floor)	Silica, Particulate Matter
2	Hall by Cafeteria Entry	Silica, Particulate Matter
3	Hall by Girls' Gym	Silica, Particulate Matter
4	Hall by Room 112	Silica, Particulate Matter
5	Little Theater	Silica, Particulate Matter
6	Room 105	Silica, Particulate Matter, CO ₂
7	Room 107	Silica, Particulate Matter, CO ₂
8	Hall / Balcony by Chorus Room	Silica, Particulate Matter
9	Hall by Room 14	Silica, Particulate Matter
10	Girls' Locker Room	Silica, Particulate Matter
11	Room 4	Silica, Particulate Matter, CO ₂
12	Hall by Room 223	Silica, Particulate Matter
13	Room 203	Silica, Particulate Matter, CO ₂
14	Hall by Room 207	Silica, Particulate Matter
15	Room 215	Silica, Particulate Matter, CO ₂
16	Room 209	Silica, Particulate Matter
17	Hall by Room 216	Silica, Particulate Matter
18	Hall by Room 6	Silica, Particulate Matter

Particulate matter (PM) was sampled as PM_{2.5} and PM₁₀ using DustTrak and DustTrak DRX laser particle counters (TSI Inc., Shoreview, MI) with data-logging capability. Samples were collected (via program) every 5 minutes over the course of 24 hours. CO₂ (along with temperature, relative humidity and carbon monoxide) was collected using TSI QTrak probes with data points every 5 minutes over 24 hours.

Silica was sampled and analyzed according to Modified NIOSH 7500 / OSHA ID-142 methodology. Samples were collected as respirable dust (using aluminum cyclone adapters) at 2.5 Liters / minute for 7 hours, and sent for analysis to Galson Laboratories (East Syracuse, New York).

IV. Results

A. Particulate Matter – PM2.5 and PM10

PM2.5 and PM10 were monitored and plotted over the course of 24 hours. Refer to the Appendix for charts of the individual site data. Most sample locations showed isolated particulate matter concentration spikes at varying times in the day, which could be attributable to activity by students / occupants, cleaning and/or construction activities. For most locations, PM10 levels rarely exceeded the EPA guideline except during these spikes. However, PM2.5 levels were close to or above the EPA guideline in many locations during school hours. The following table summarizes the average PM2.5 and PM10 levels for the 24-hour sampling period as well as school hours (approximately 7:30 am – 2:30 pm for purposes of data analysis).

Table 2. Average PM2.5 and PM10 values and EPA limit guidelines, in ug / m³

Site#	Location	PM2.5 24hr	PM2.5 School Day	PM2.5 EPA	PM10 24hr	PM10 School Day	PM10 EPA
1	Hall by Speech Room	31	39	35	46	70	150
2	Hall by Cafeteria Entry	30	39	35	60	114	150
3	Hall by Girls' Gym	23	42	35	43	87	150
4	Hall by Room 112	46	61	35	56	81	150
5	Little Theater	(1)	(1)	35	8	7	150
6	Room 105	20	25	35	27	37	150
7	Room 107	27	39	35	28	59	150
8	Balcony by Chorus	228	229	35	235	241	150
9	Hall by Room 14	28	40	35	45	69	150
10	Girls' Locker	21	19	35	30	32	150
11	Room 4	11	12	35	18	22	150
12	Hall by Room 223	18	23	35	21	29	150
13	Room 203	19	28	35	30	46	150
14	Hall by Room 207	24	39	35	37	67	150
15	Room 215	15	18	35	18	24	150
16	Room 209	29	58	35	52	131	150
17	Hall by Room 216	28	40	35	53	92	150
18	Hall by Room 6	17	27	35	29	48	150

ug = micrograms; m³ = cubic meters

(1) No data due to equipment failure

Values highlighted in yellow exceed EPA limit guidelines

As can be seen in Table 2, the 24-hour average for PM2.5 and PM10 were below EPA guidelines in all locations except for Site #8, Balcony by the Chorus Room and Site 4, Hall by Room 112 (PM2.5 only). When viewing data, note that EPA guidelines are based on 24-hour average values. However, when looking at PM2.5 and PM10 average values for the school day, the PM10 value is still below the EPA guideline (except for Site #8) but the PM2.5 values exceed the EPA guideline in 10 of the 18 sample locations.

IV. Results (Continued)

B. Silica

Silica (as Quartz, Cristobalite and Tridymite) concentrations were below the method detection limits (0.020 to 0.098 mg/m³) for all sample locations (see lab report in Appendix). Respirable dust levels were also below the method detection limit (0.098 mg/m³) for all locations except for Site #16 (sample S18, Room 209), which was only slightly above the method detection limit at 0.12 mg/m³. The Occupational Safety and Health Administration (OSHA) permissible exposure limit (PEL) for respirable dust is 5.0 mg/m³ (as an 8-hour, time-weighted average). Therefore, site #16 was well below the OSHA PEL for respirable dust.

C. Carbon Dioxide

Refer to the Appendix for charts of the individual site data. As would be expected, CO₂ levels were highest during periods of occupancy. The following table lists CO₂ average values for 24-hours and for the school day (approximately 7:30 am – 2:30 pm for purposes of data analysis):

Table 3. CO₂ Average Values (in parts per million, ppm)

Site #	Location	CO ₂ , 24-hour	CO ₂ , School-Day
6	Room 105	580	858
7	Room 107	531	787
11	Room 4	501	664
13	Room 203	647	819
15	Room 215	499	716

V. Discussion

A. Particulate Matter – PM_{2.5} and PM₁₀

According to the US Environmental Protection Agency (EPA), "Particulate matter," also known as particle pollution or PM, is a complex mixture of extremely small particles and liquid droplets. Particle pollution is made up of a number of components, including acids (such as nitrates and sulfates), organic chemicals, metals, and soil or dust particles.

The size of particles is directly linked to their potential for causing health problems. EPA is concerned about particles that are 10 micrometers in diameter or smaller because those are the particles that generally pass through the throat and nose and enter the lungs. Once inhaled, these particles can affect the heart and lungs and cause serious health effects. EPA groups particle pollution into two categories:

V. Discussion (Continued)

- "Inhalable coarse particles," such as those found near roadways and dusty industries, are larger than 2.5 micrometers and smaller than 10 micrometers in diameter.
- "Fine particles," such as those found in smoke and haze, are 2.5 micrometers in diameter and smaller. These particles can be directly emitted from sources such as forest fires, or they can form when gases emitted from power plants, industries and automobiles react in the air.

It must be stressed that EPA guidelines for PM2.5 and PM10 are not indoor air guidelines but are in fact regulatory criteria for outdoor air under the Clean Air Act, last amended in 1990. The Clean Air Act requires EPA to set National Ambient Air Quality Standards (NAAQS) for wide-spread pollutants from numerous and diverse sources considered harmful to public health and the environment. Particulate matter, as PM2.5 and PM10, is one of the regulated pollutants. AQM is using the EPA criteria limits for PM2.5 and PM10 for indoor air as a guideline only, since there are no standards or widely agreed-upon guidelines for particulate matter in indoor air.

EPA's criteria limits are health-based limits and have been set based on extensive research. However, there are no studies linking similar health effects with indoor particulates, and it is possible (and likely) that indoor particulates differ in composition from those examined in EPA's research (often conducted in highly urbanized areas with substantial influence from traffic, industrial effluents, etc.).

The criteria limits for particulate matter set forth under the Clean Air Act are as follows:

Table 4. National Ambient Air Quality Standards for Particle Pollution ($\mu\text{g}/\text{m}^3$)

Pollutant	Primary Standards	Averaging Time
Particulate Matter (PM ₁₀)	Revoked ⁽¹⁾	Annual ⁽¹⁾ (Arithmetic Mean)
	150 $\mu\text{g}/\text{m}^3$	24-hour ⁽²⁾
Particulate Matter (PM _{2.5})	15.0 $\mu\text{g}/\text{m}^3$	Annual ⁽³⁾ (Arithmetic Mean)
	35 $\mu\text{g}/\text{m}^3$	24-hour ⁽⁴⁾

μg = micrograms; m^3 = cubic meters (of air)

Footnotes:

- (1) - Due to a lack of evidence linking health problems to long-term exposure to coarse particle pollution, EPA revoked the annual PM₁₀ standard in 2006 (effective December 17, 2006).
- (2) - Not to be exceeded more than once per year on average over 3 years.
- (3) - To attain this standard, the 3-year average of the weighted annual mean PM_{2.5} concentrations from single or multiple community-oriented monitors must not exceed 15.0 $\mu\text{g}/\text{m}^3$.
- (4) - To attain this standard, the 3-year average of the 98th percentile of 24-hour concentrations at each population-oriented monitor within an area must not exceed 35 $\mu\text{g}/\text{m}^3$ (effective December 17, 2006).

V. Discussion (Continued)

Indoor particulate matter levels are greatly influenced by outdoor levels especially in a school like Biddeford High where there is no mechanical air system and filtration of the air. AQM did not measure outdoor particulate matter levels during this evaluation as outdoor data-logging stations are much more difficult to set up and operate and much more expensive than indoor stations, as well as time constraints as the lead-time to initial sampling was very short. However, based on multiple spot-checks during early afternoons over the course of the year, outdoor particulate levels were well-below the EPA criteria outside of Biddeford High School. Therefore it is not anticipated that outdoor particulate levels, from the region as a whole, significantly influenced the levels measured indoors. This does not mean that very localized conditions, such as construction in adjacent outdoor areas, may not have influenced indoor levels.

Measurement of PM_{2.5} and PM₁₀ for regulatory compliance purposes must be done using specific methodology, and is based on gravimetric analysis (determination of actual weight of particulate matter collected). AQM's determination of PM_{2.5} and PM₁₀ was via laser particle counters, which measure particles passing through the meter after size-separation, with concentrations converted to mass (weight) using a standard, theoretical formula. Although this method will generally produce results very similar to those from the methodology required by EPA, AQM's methodology would not be acceptable for compliance testing. For this reason as well as those previously stated, AQM's use of the PM_{2.5} and PM₁₀ limits should be viewed only as a guideline. *The values (35 ug/m³ for PM_{2.5} and 150 ug/m³ for PM₁₀) should not be viewed as an absolute ceiling for healthy indoor air – there is no evidence that levels above these values are unsafe for occupants, especially in the short-term and/or for sporadic exposures.* However, it is AQM's recommendation that, in the absence of specific criteria for indoor air, the PM_{2.5} and PM₁₀ levels in Biddeford High School should not exceed EPA's limits in the long-term, on average during the school day. This recommendation is being made for best indoor air quality and given the recent health issues and concerns.

As Table 2 shows, all sites other than 4 and 8 were below the EPA criteria when looking at 24-hour averages (Site 4 only exceeded the criteria for PM_{2.5}). However, when looking at the average values over the school day, when students would be present and exposed, the values for PM_{2.5} exceeded the EPA criteria in 8 other locations (Sites 1, 2, 3, 7, 9, 14, 16 and 17). This may be due to normal school activities (disturbing settled dust) or to other influences such as construction activities taking place in adjoining areas and/or immediately outside. Examination of the data charts (Appendix) shows this trend in more detail. During the school day, average PM_{2.5} was highest at sites 4 (Hall by Room 112), 8 (Balcony by Chorus Room) and 16 (Room 209). Site 8 was also the only location where PM₁₀ exceeded the EPA criteria in either the 24-hour or school day average (both in this case). When looking at the charts, short-term spikes are useful for determining which activities are likely to influence particulate levels overall, but are less of a concern than longer-term averages (spikes will always occur when even minute amounts of dust are disturbed, and are a very common occurrence outdoors).

V. Discussion (Continued)

Given visual observations of dust and low but significant presence of mold spores (prior testing – see Background section), and the particulate data from past measurements as well as presented in this report, it is very likely that exposure to dust has resulted in or contributed to at least some of the reported health issues. Excessive dust exposure can lead to breathing difficulties and exacerbation of Asthma particularly in susceptible individuals, and allergy-like reactions including rashes can occur from exposure to mold spores and other allergens that might be present in dust (e.g. dust mites, pet dander from students' clothing, etc.).

B. Silica

The following background information is taken from the US Occupational Safety and Health Administration (OSHA):

Crystalline silica is the basic component of sand, quartz and granite rock. Airborne crystalline silica occurs commonly in both work and non-work environments. Activities such as sandblasting, rock drilling, roof bolting, foundry work, stonecutting, drilling, quarrying, brick/block/concrete cutting, gunite operations, lead-based paint encapsulant applications, asphalt paving, cement products manufacturing, demolition operations, hammering, chipping and sweeping concrete or masonry, and tunneling operations can create an airborne silica exposure hazard. Occupational exposure and inhalation of airborne crystalline silica can produce silicosis, a disabling, dust-related disease of the lungs. Even materials containing small amounts of crystalline silica may be hazardous if they are used in ways that produce high dust concentrations.

Free silica may occur as amorphous-free silica, of which there are many forms, and crystalline-free silica, of which there are five principal forms. Certain materials contain both amorphous- and crystalline-free silica. Silica-related diseases are associated only with crystalline-free silica. The most common examples of crystalline-free silica are beach or bank sands. A third form of free silica is fused silica which is produced by heating either the amorphous or crystalline forms. Other forms include cristobalite and tridymite. Quartz, a principal form of silica, geologically is the second most common mineral in the earth's crust.

Silicosis is the result of the body's response to the presence of silica dust in the lung(s). The respirable fraction of the dust (particles generally considered to be smaller than five-millionth of a meter) can penetrate to the innermost reaches of the respiratory systems. These are the alveoli (airsacs) where the exchange of oxygen and carbon dioxide occurs. When workers inhale crystalline silica, they land on the alveoli, and white blood cells (macrophages) try to remove them. However, the particles of free crystalline silica cause the macrophages to break open. The lung tissues react by developing fibrotic nodules and scarring around the trapped silica particles.

V. Discussion (Continued)

Workers may develop any of three types of silicosis, depending on the concentration of airborne silica:

- Chronic silicosis, which usually occurs after ten or more years of exposure to crystalline silica at relatively low concentrations.
- Accelerated silicosis which results from exposure to high concentrations of crystalline silica and develops five to ten years after the initial exposure.
- Acute silicosis, which occurs where exposure concentrations are the highest and can cause symptoms to develop within a few weeks to four or five years after the initial exposure.

Early stages of the disease may go unnoticed. Continued exposure may result in a shortness of breath on exercising, possible fever and occasionally bluish skin at the ear lobes or lips. Silicosis makes a person more susceptible to infectious diseases of the lungs, such as tuberculosis. Progression of silicosis leads to fatigue, extreme shortness of breath, loss of appetite, pains in the chest, and respiratory failure, which may cause death. Medical evaluations of silicosis victims usually show the lungs to be filled with silica crystals and a protein material. Pulmonary fibrosis (fibrous tissue in the lung) may or may not develop in acute cases of silicosis depending on the time between the exposure and the onset of symptoms.

Intuitively, silicosis and silica exposure would not be a likely cause of the symptoms and health issues reported at Biddeford High School, since many symptoms (e.g. allergy-like reactions) do not match the profile of those from silicosis. And although some of the reported symptoms may match some of those from acute silicosis, this form of the disease generally only occurs in construction and industrial environments where exposures (and visible dusts) are extremely high. Although in this report and prior reports, we speak of dust as being elevated at Biddeford High, it is no where near the severe conditions that one would find in construction and industrial environments (e.g. in the immediate vicinity of jack-hammering or stone cutting). However, silica testing was requested by the Client due to concerns raised since ongoing construction is occurring in areas adjacent to the occupied areas of the school.

Silica was below the method detection limits for all air samples collected during this evaluation. A small amount of quartz was found in bulk samples from dust above ceiling tiles in Rooms 105 215. This is not atypical since quartz is very common in such materials as sand and sheetrock, and there is no evidence that this material is becoming airborne.

Respirable dust was not an issue in any location as noted in the Results Section. Please note that the term respirable dust is defined by OSHA and the criteria limit for respirable dust is set by OSHA at 5 mg/m³ (5000 ug/m³). This is an occupational exposure limit, as an 8-hour time-weighted average. This criteria is different from the PM_{2.5} and PM₁₀ criteria set forth by EPA under the Clean Air Act and discussed in Section V-A of this report.

Based on the results in this report, under current conditions of containment (construction site) and occupancy, silica exposure and silicosis are not a risk at Biddeford High School.

V. Discussion (Continued)

C. Carbon Dioxide

Although CO₂ levels were high during the school day, they were not particularly high on average. Prior criteria (ANSI/ASHRAE 62-1999 and 62-1989) use a reference of 1000 ppm (or 700 ppm above the outdoor level, which is typically 300-400 ppm) as a threshold beyond which there may be human comfort and/or odor issues. The current ASHRAE standard (62-2001) does not include any guidelines or limits on CO₂, but does make a “point of information” statement that “Comfort (odor) criteria with respect to human bioeffluents are likely to be satisfied if the ventilation results in indoor CO₂ concentrations less than 700 ppm above the outdoor concentration.” AQM’s opinion is, with the ambiguity in CO₂ standards (other than the OSHA 5000 ppm limit), the use of a 1000 ppm comfort guideline for CO₂ should be used loosely and any corrective action based on CO₂ levels should only be considered in cases where the levels are substantially elevated (e.g. approximately 1800-2500 ppm and above).

CO₂ levels were not significantly elevated to the extent of ventilation being a concern in any area sampled during this evaluation. However, it should be noted that the measurements taken were only a simple screen and it was reported to AQM that several classrooms were either under-occupied due to scheduling (Room 4) or largely unoccupied after a brief period in the morning (Rooms 105 and 203), due to teachers and students relocating as a result of noise from AQM’s sampling pumps. If CO₂ and ventilation continues to be a concern, AQM would recommend setting up CO₂-only data recording stations in select classrooms, and monitoring the conditions over several days to 1-week in order to account for any variation in schedules and occupancy.

VI. Recommendations

Based on particulate levels as reported and discussed in this report, we recommend the following immediate and/or on-going actions:

1. A thorough detailed cleaning of all areas of the school (any areas not already done, or visibly re-contaminated with dusts). Ensure that areas under heating units are thoroughly cleaned (damp hand-wiping or abrasive scrubbing may be required in some instances).
2. Compare particulate data tables and charts against known activities and routine procedures (e.g. cleaning) and try to determine possible sources of particulate spikes and/or elevated levels. Take appropriate actions to reduce particulates based on this information.
3. Evaluate alternative cleaning practices to reduce re-entrainment of airborne dusts during cleaning and to make dust removal more efficient (e.g. damp mopping or HEPA-filtered vacuuming instead of using dust mops).

VI. Recommendations (Continued)

4. Evaluate construction area containment to ensure that activities in these areas are not contributing dusts to the occupied school environment. This should include comparison of particulate data in this report with proximity to construction zones and containment barriers. Physically inspect construction barriers and ensure effectiveness. Ideally, barriers should be validated with smoke wands and measurement of pressure drop across the barriers (via use of a manometer). Overall, the negative-pressure established in construction areas should be measured with reference to the occupied school areas to ensure that the construction areas are truly negative with reference to the school.
5. Once all of the above has been conducted, AQM recommends re-sampling PM_{2.5} and PM₁₀ in select areas to verify a reduction in particulate levels.
6. With regard to silica – no further recommendations.
7. With regard to CO₂ – see discussion section.


AQM appreciates this opportunity to have aided in this project. In the event you have questions or require further assistance, please do not hesitate to contact us.

APPENDICES
PARTICULATES & CO2 GRAPHS

Site-1 Hall by Speech Room (1st Floor)

12/09-10/2010
AQM# 10-510


— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

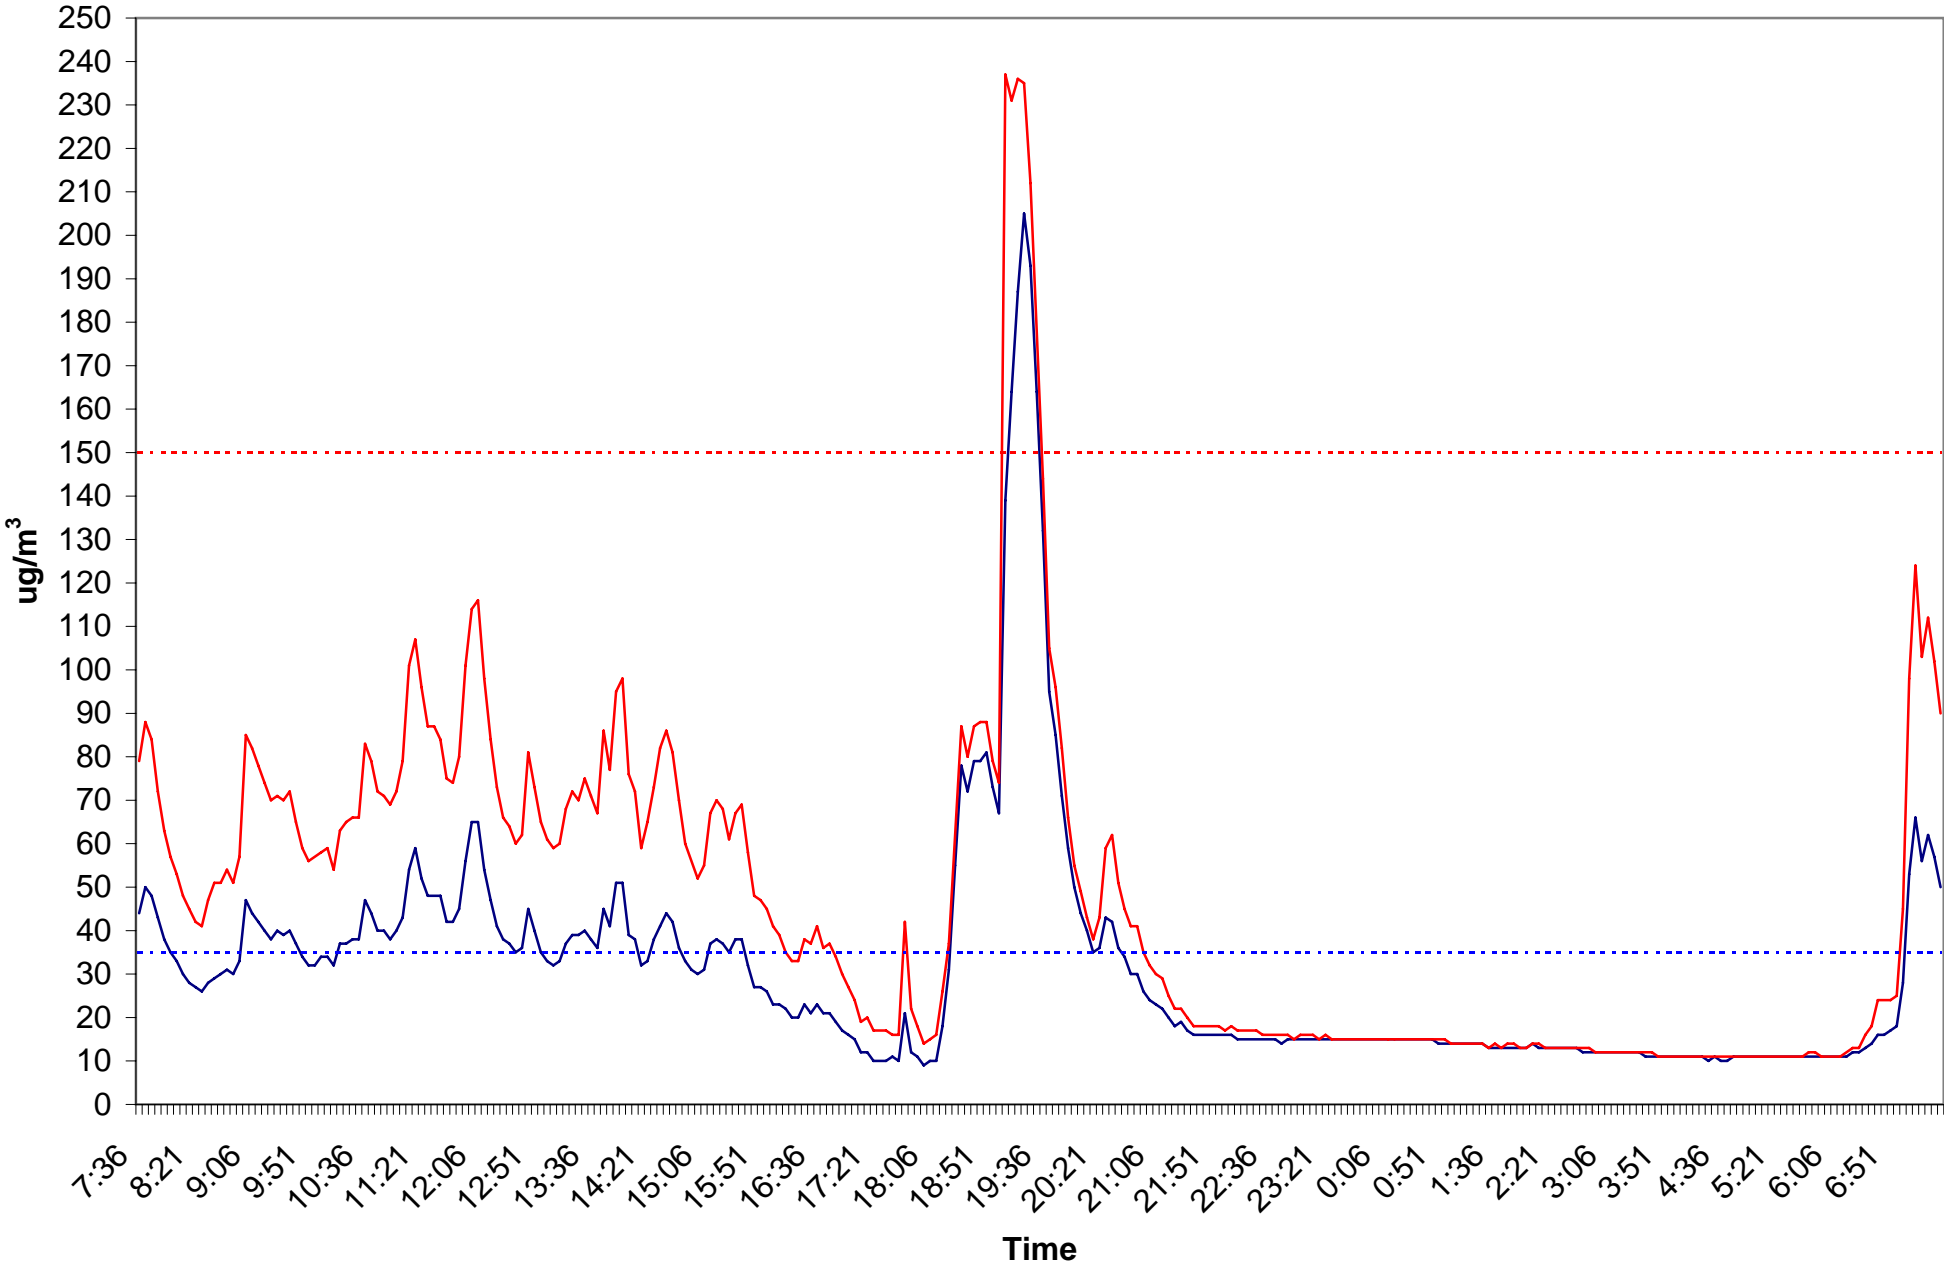

Site-2 Hall by Cafeteria Entry

12/09-10/2010
AQM# 10-510


— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

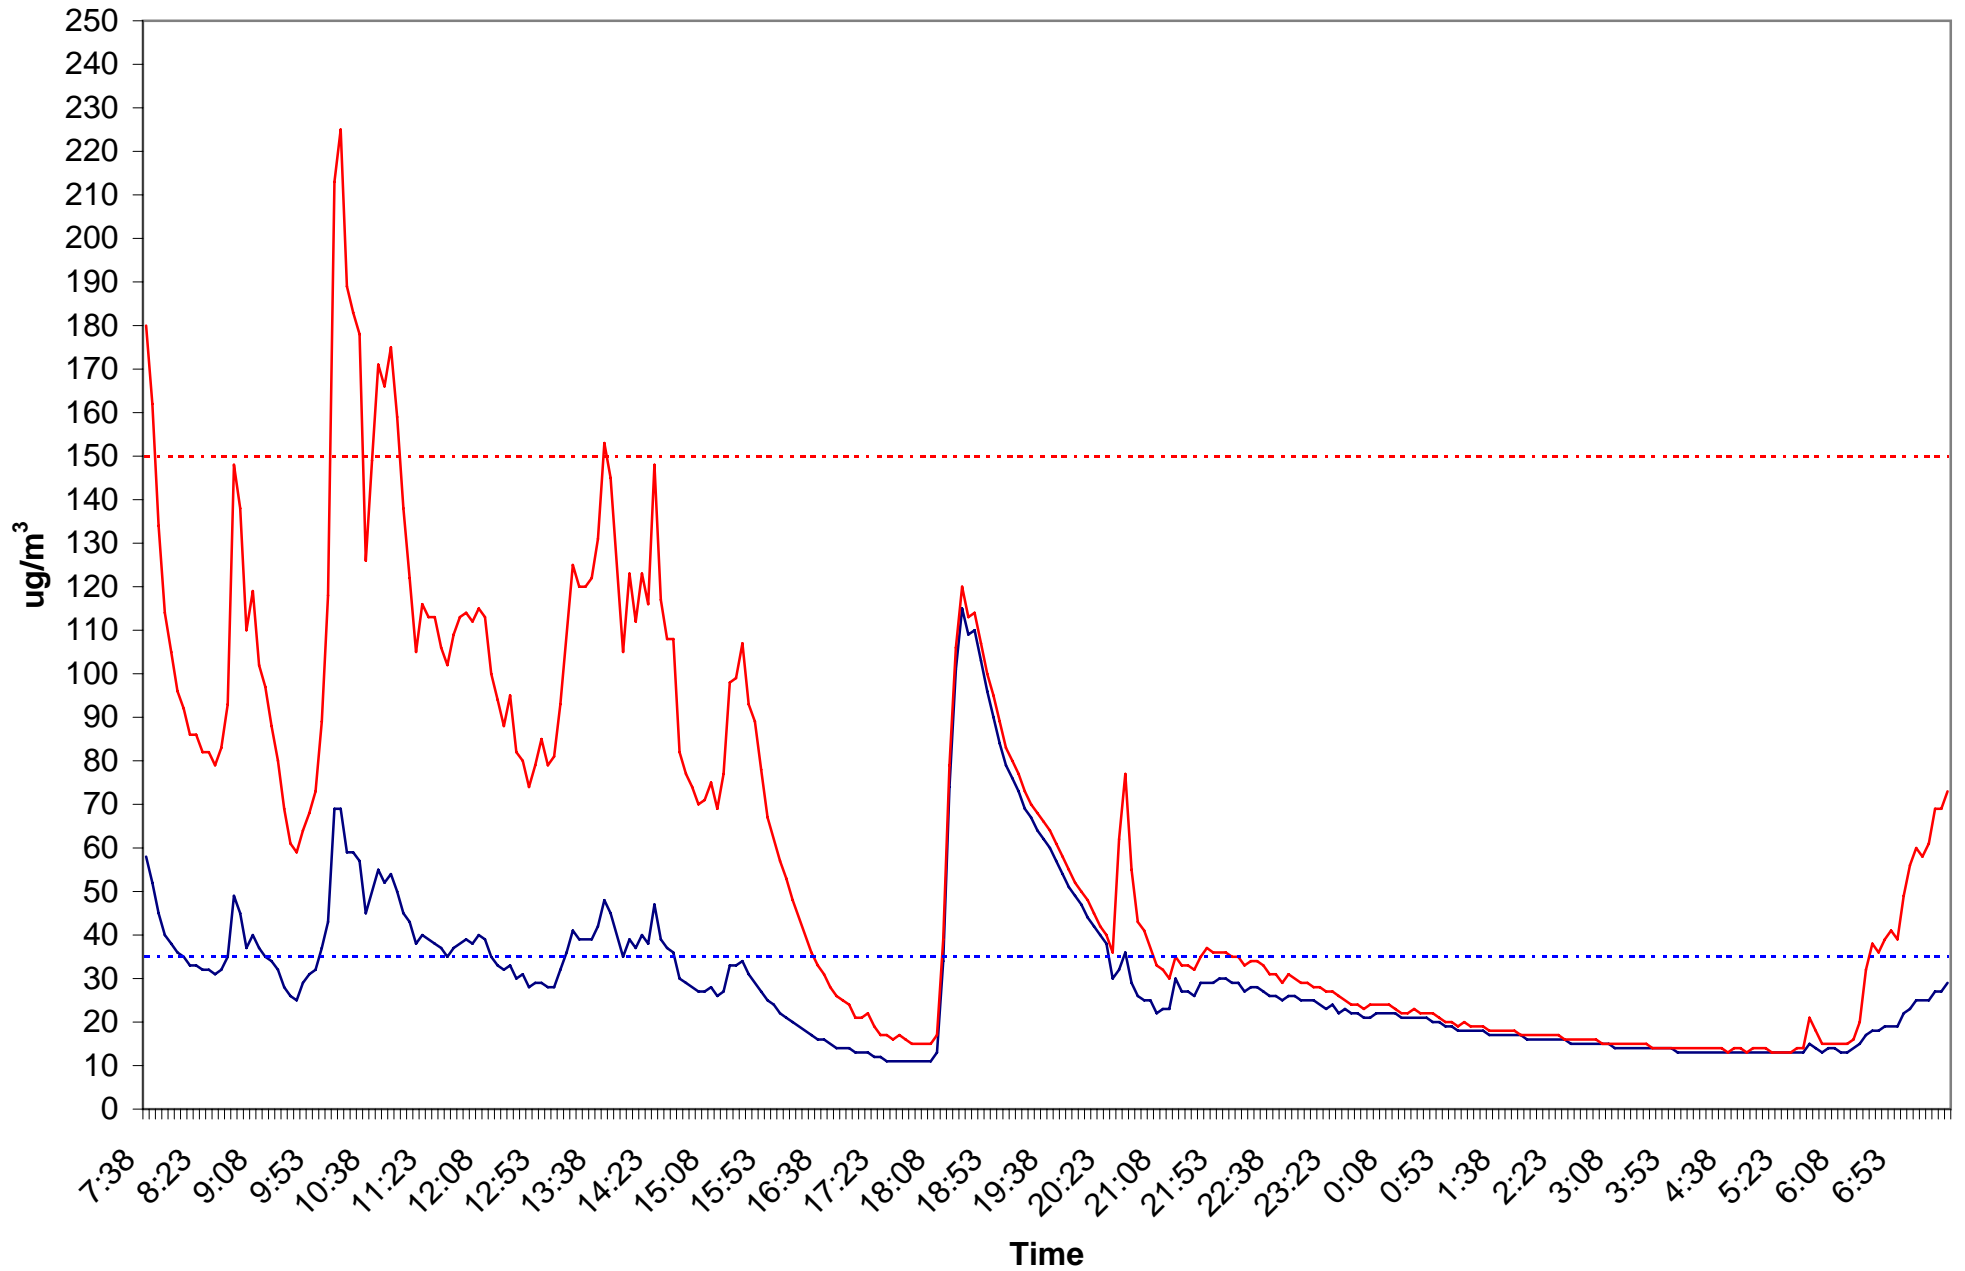

Site-3 Hall by Girls' Gym

12/09-10/2010

AQM# 10-510

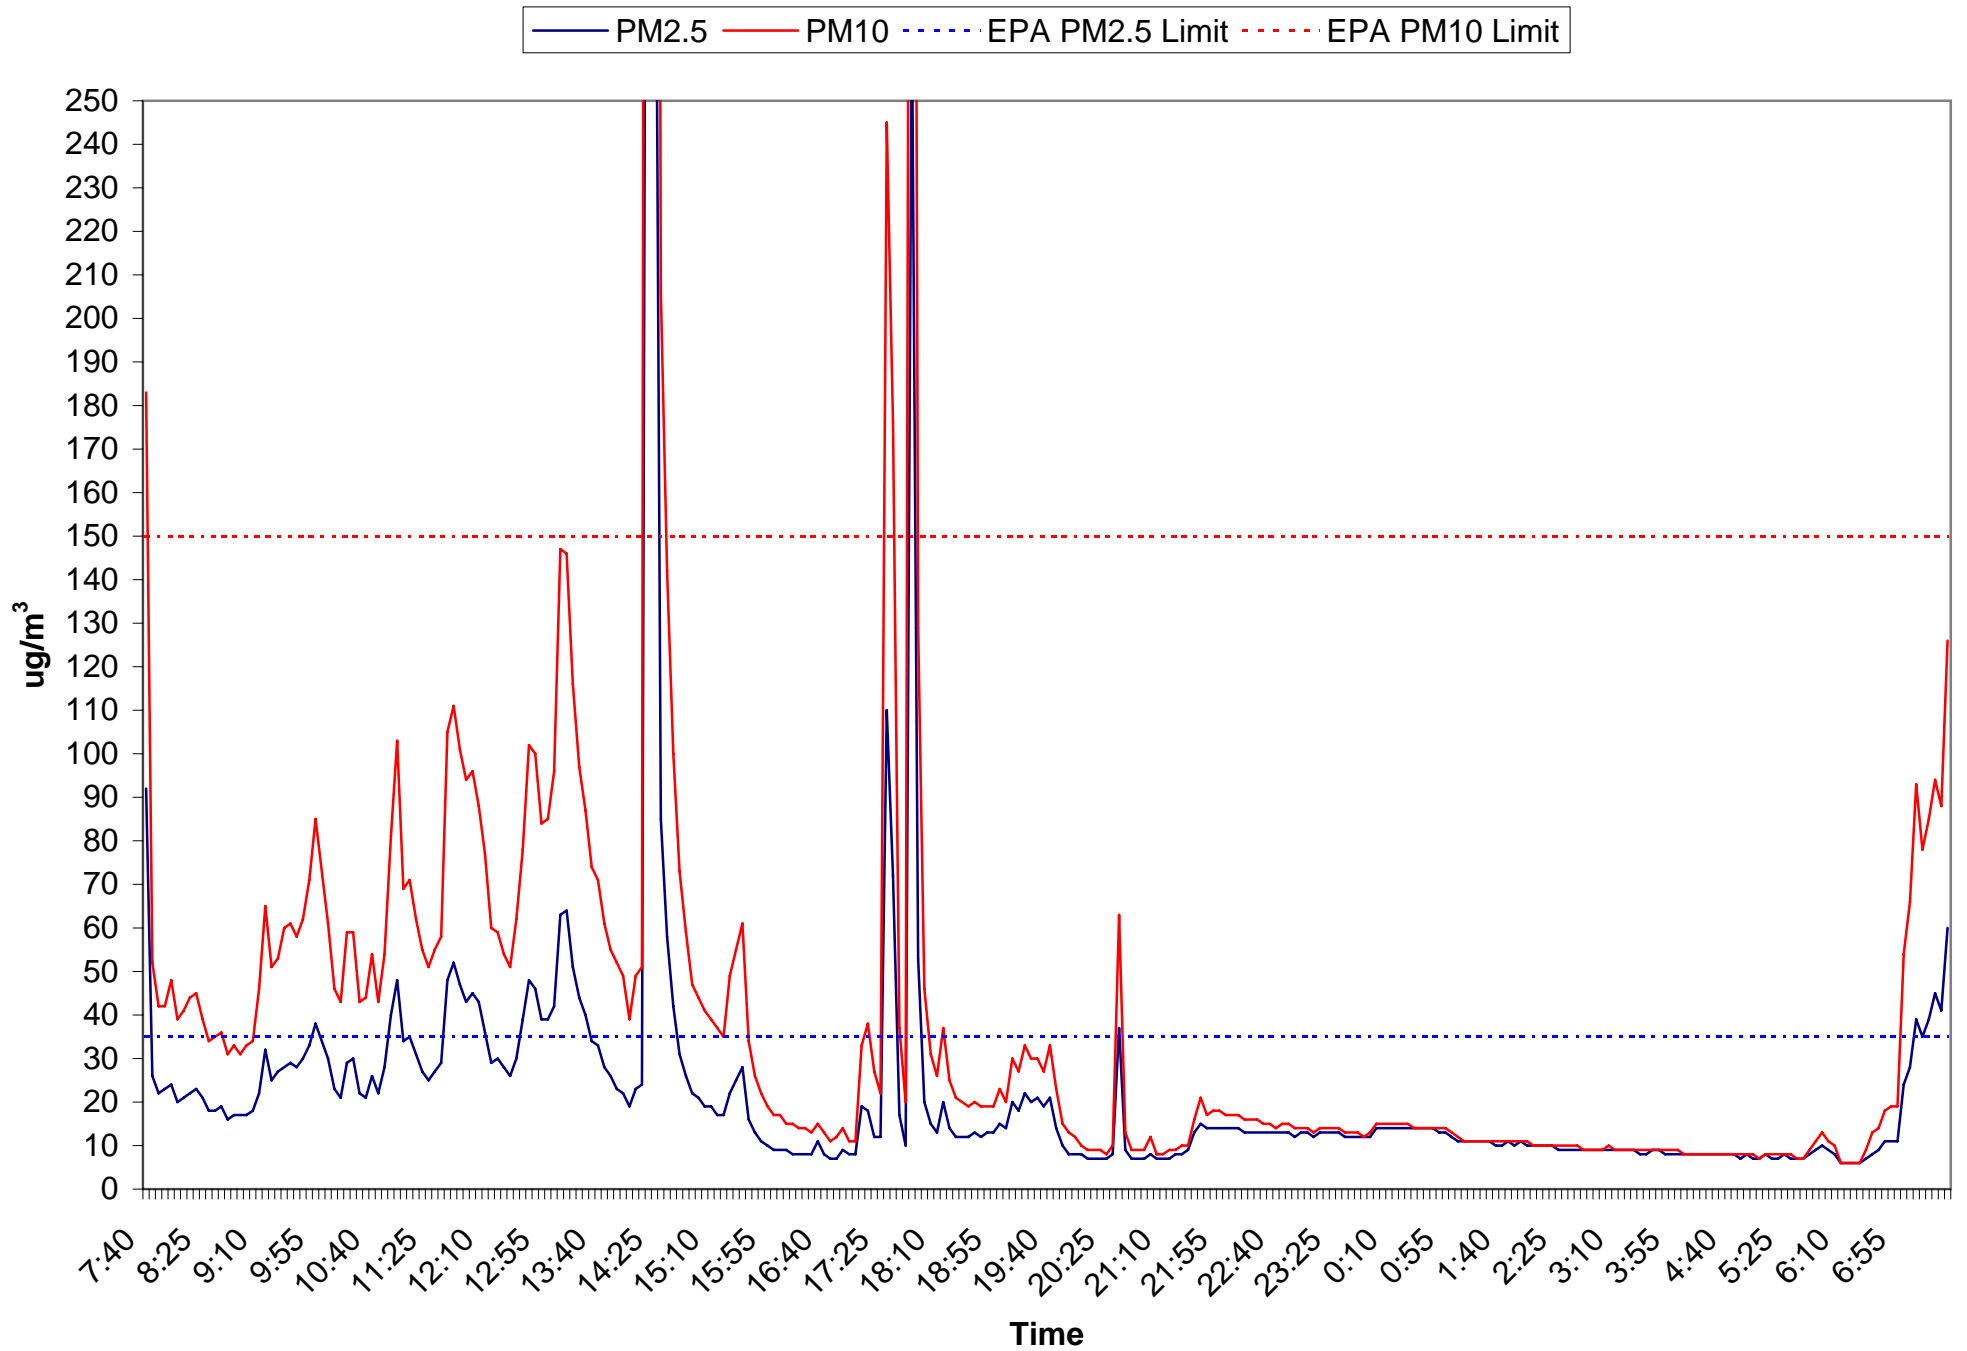


Site-3 Hall by Girls' Gym

12/09-10/2010


AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - . - . EPA PM10 Limit

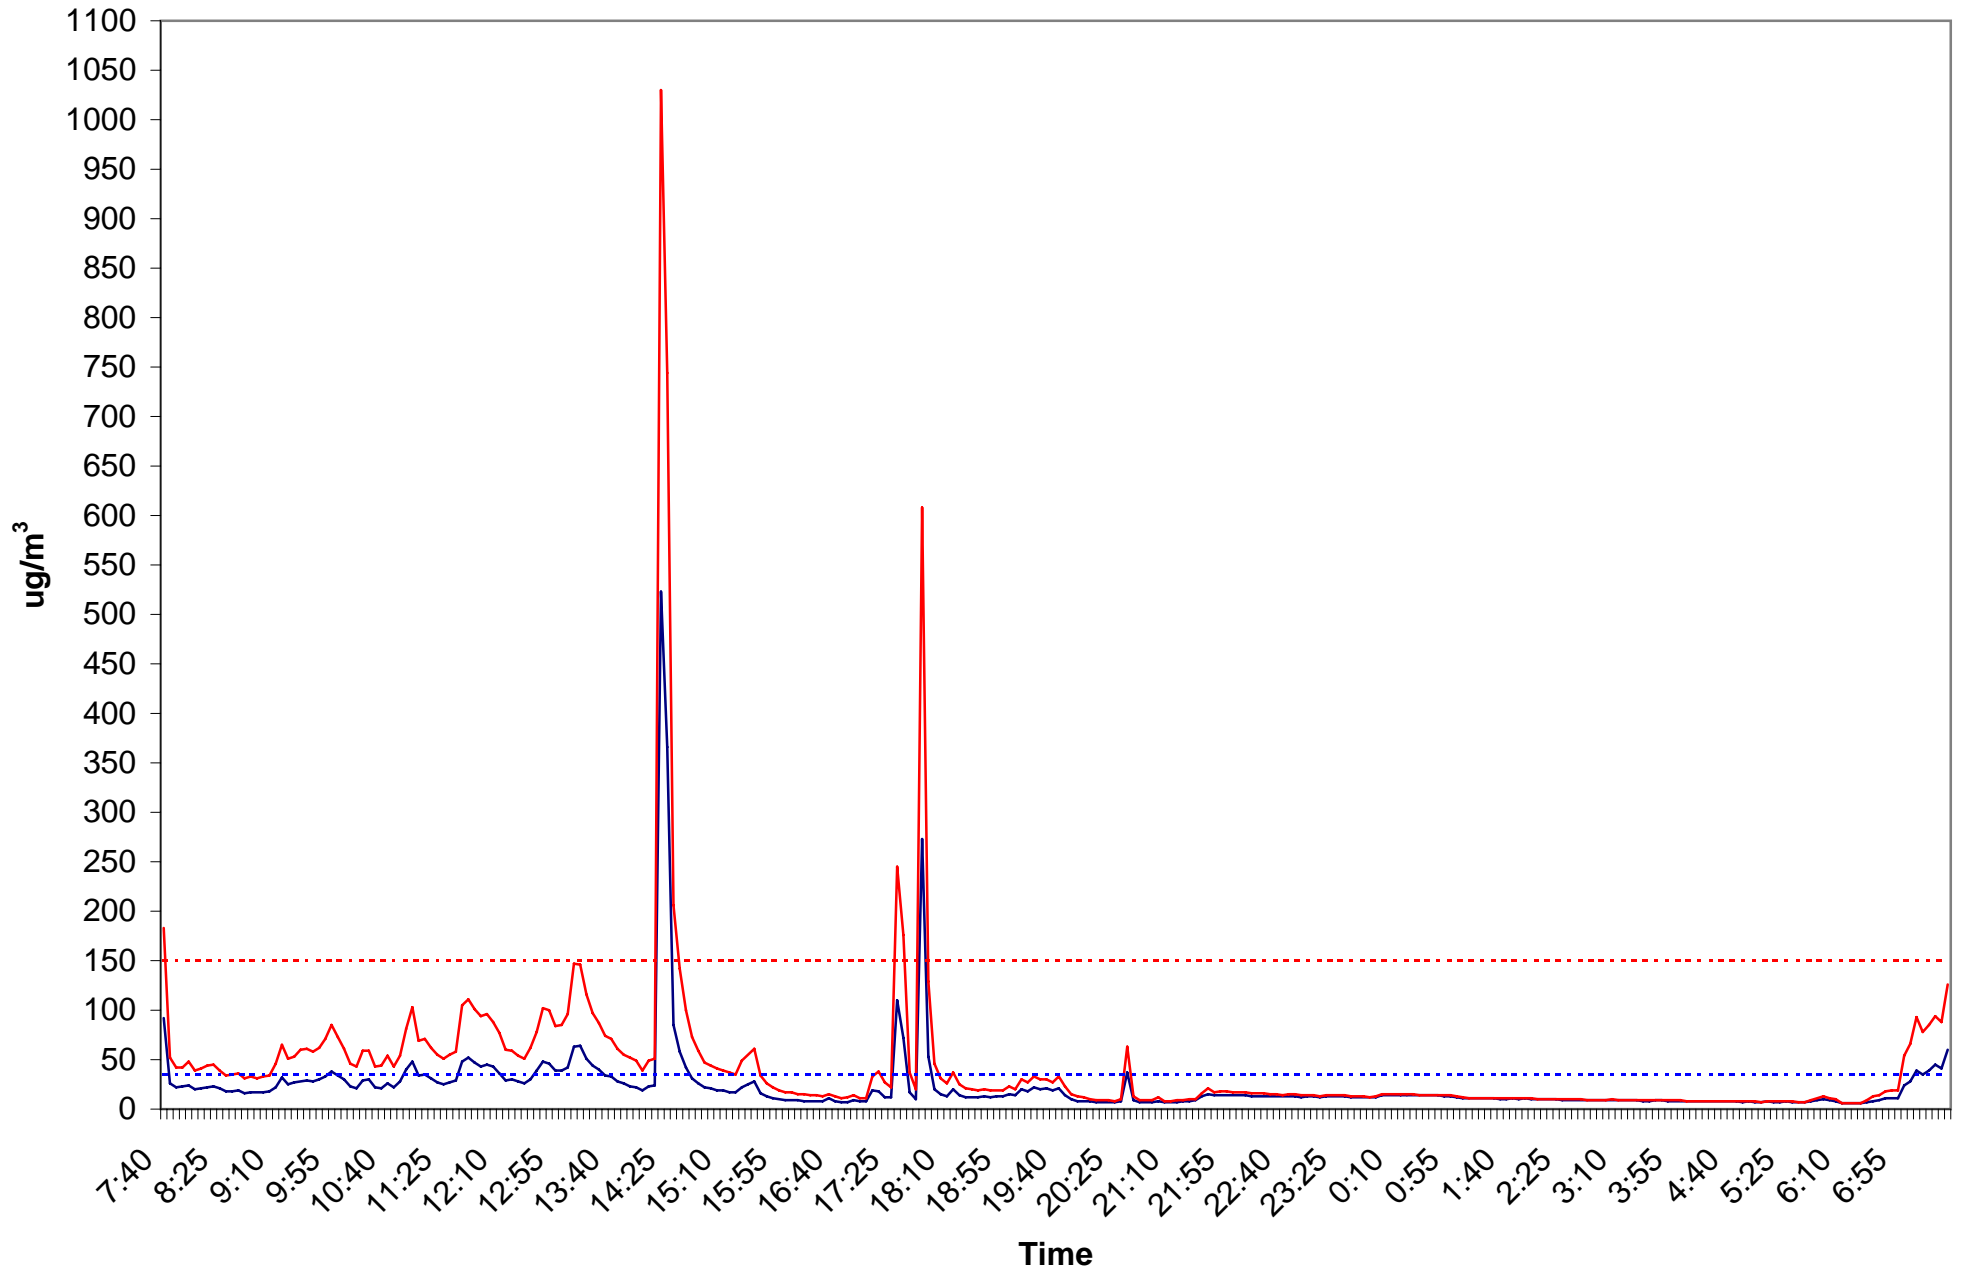


Site-4 Hall by Room 112

12/09-10/2010
AQM# 10-510

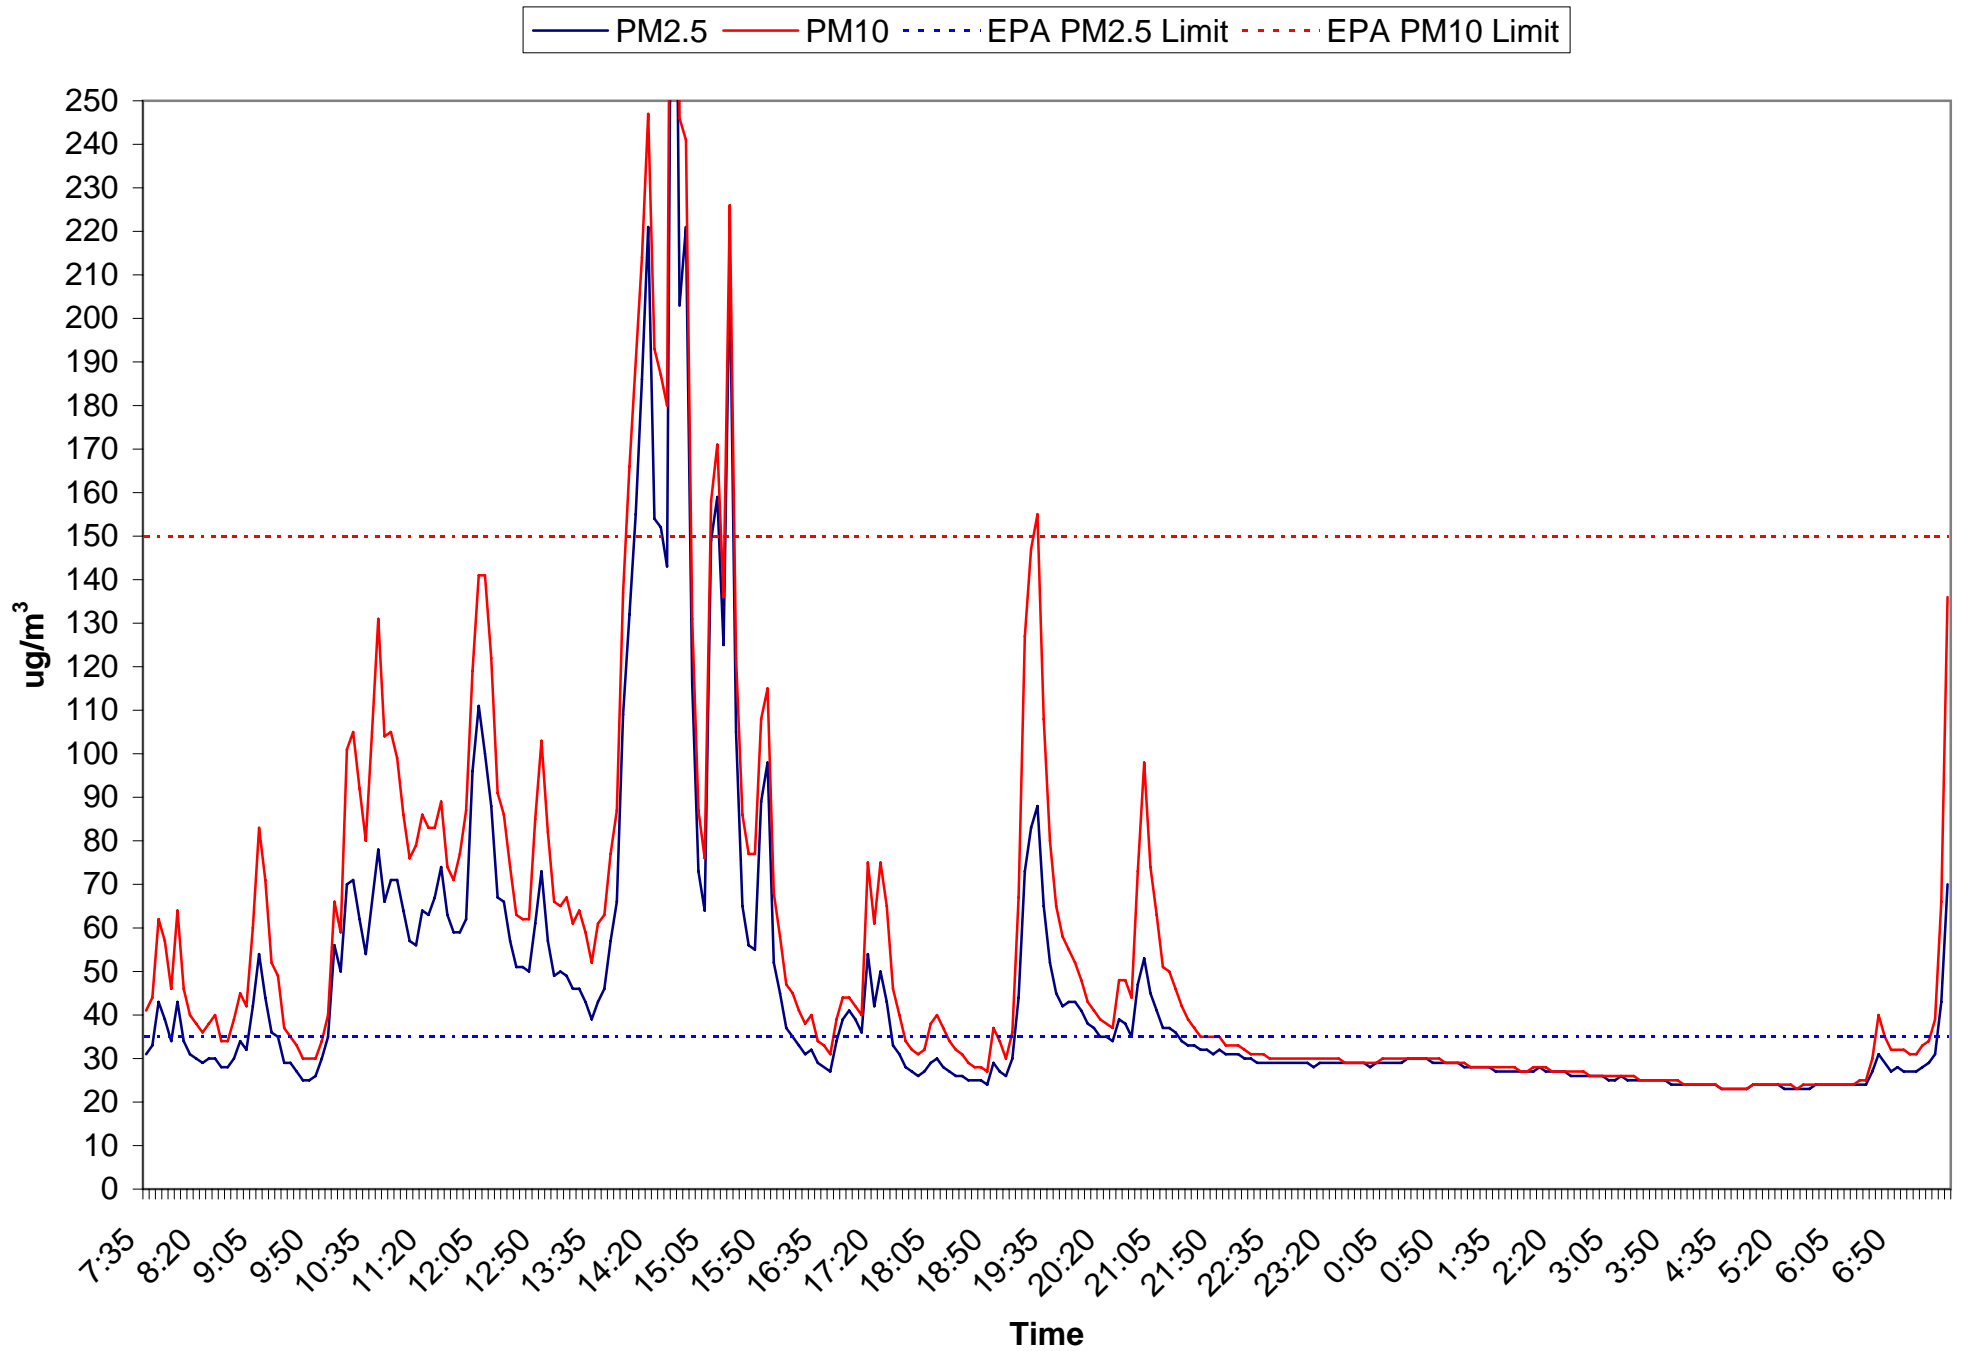

Site-4 Hall by Room 112


12/09-10/2010
AQM# 10-510

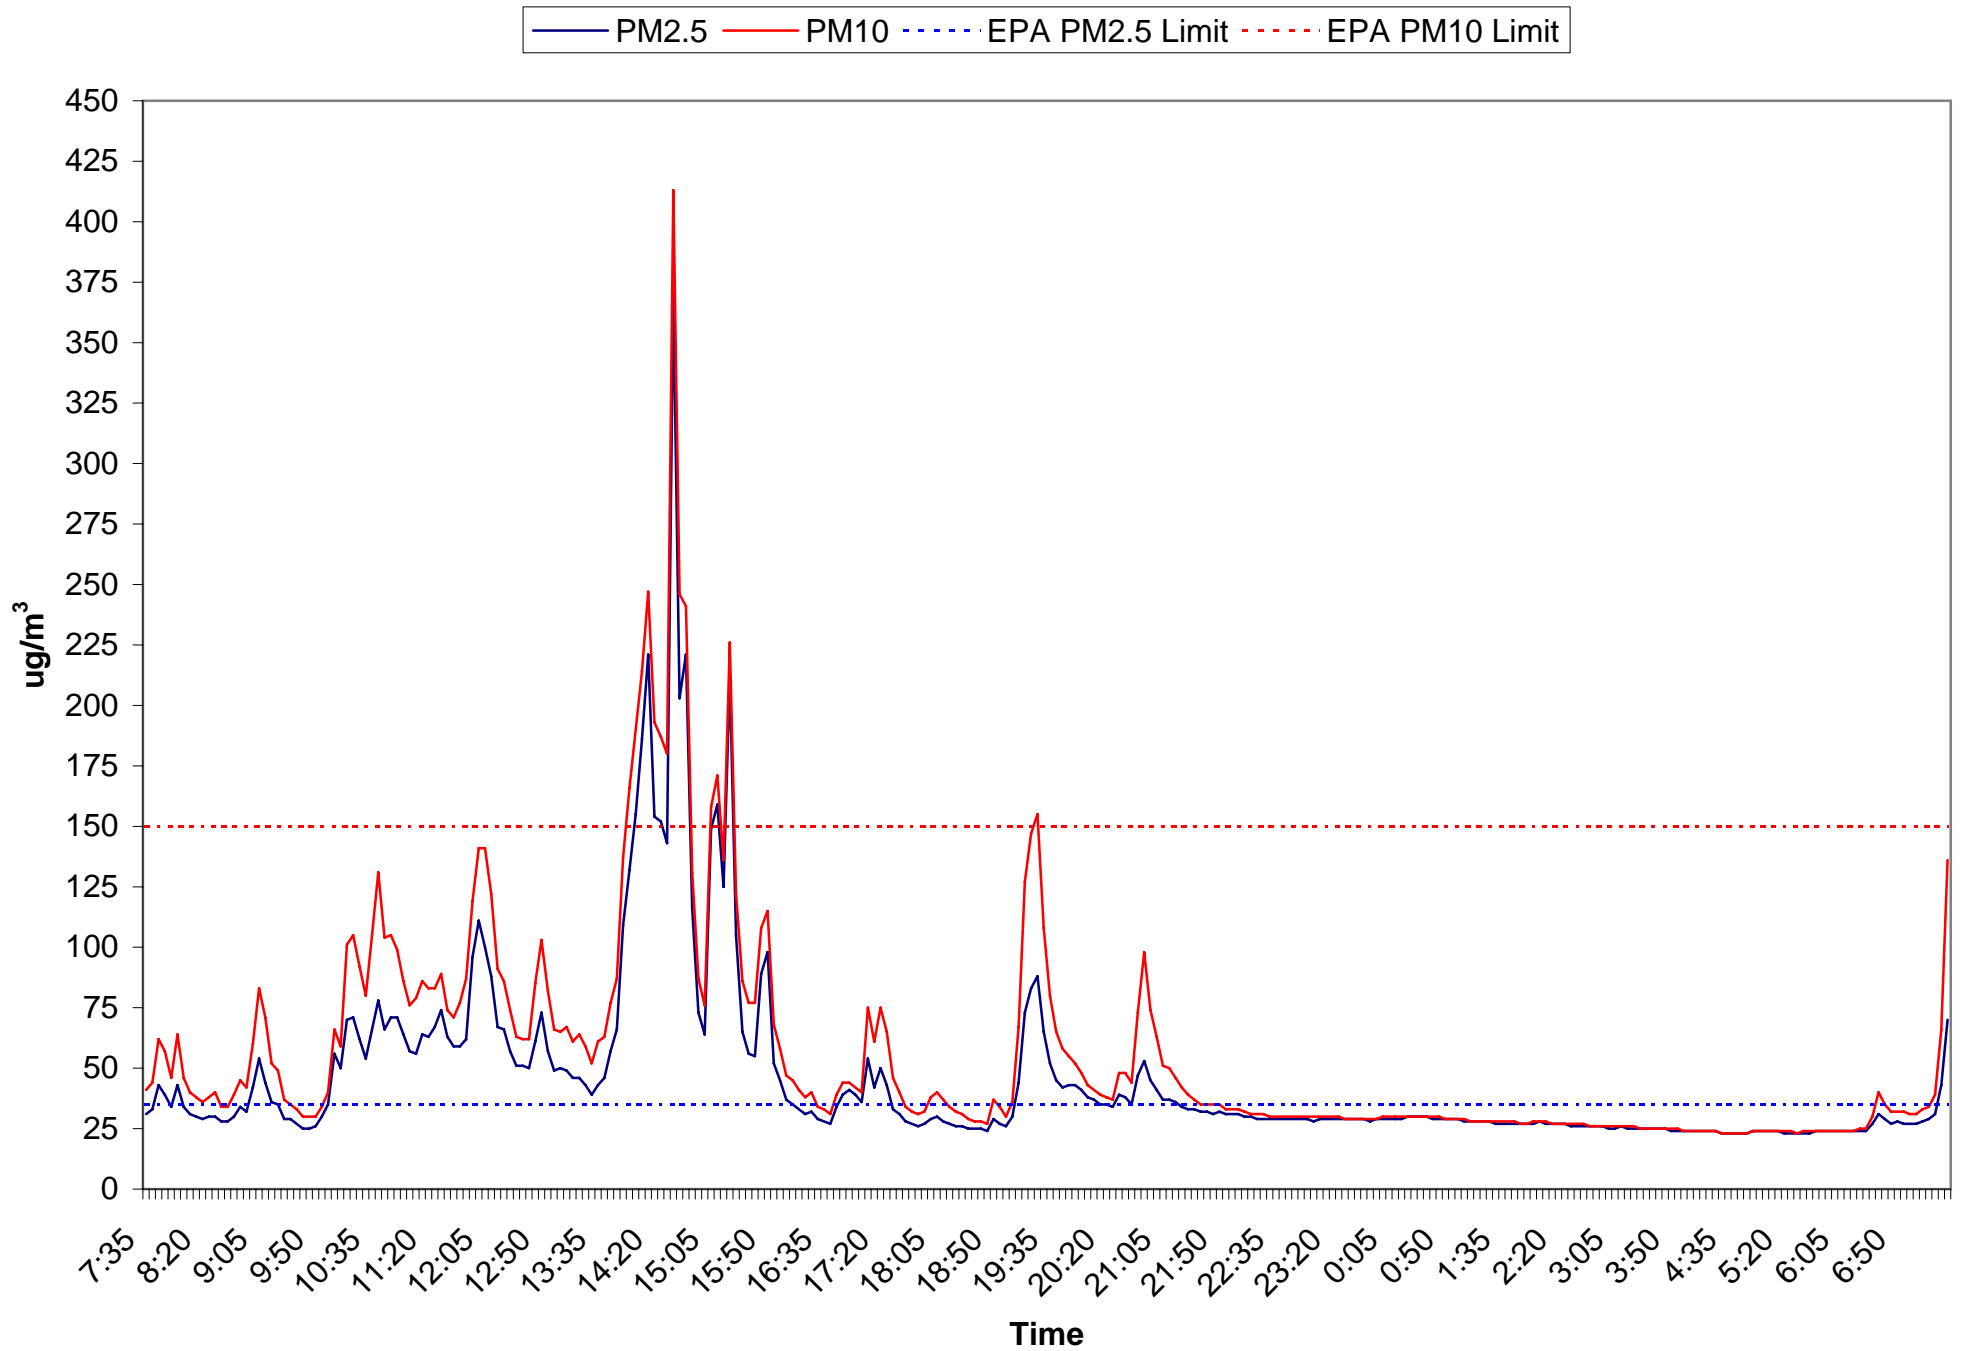

Site-5 Little Theater

Note: PM2.5 Data Lost Due to Equipment Failure


— PM10 - - - EPA PM10 Limit

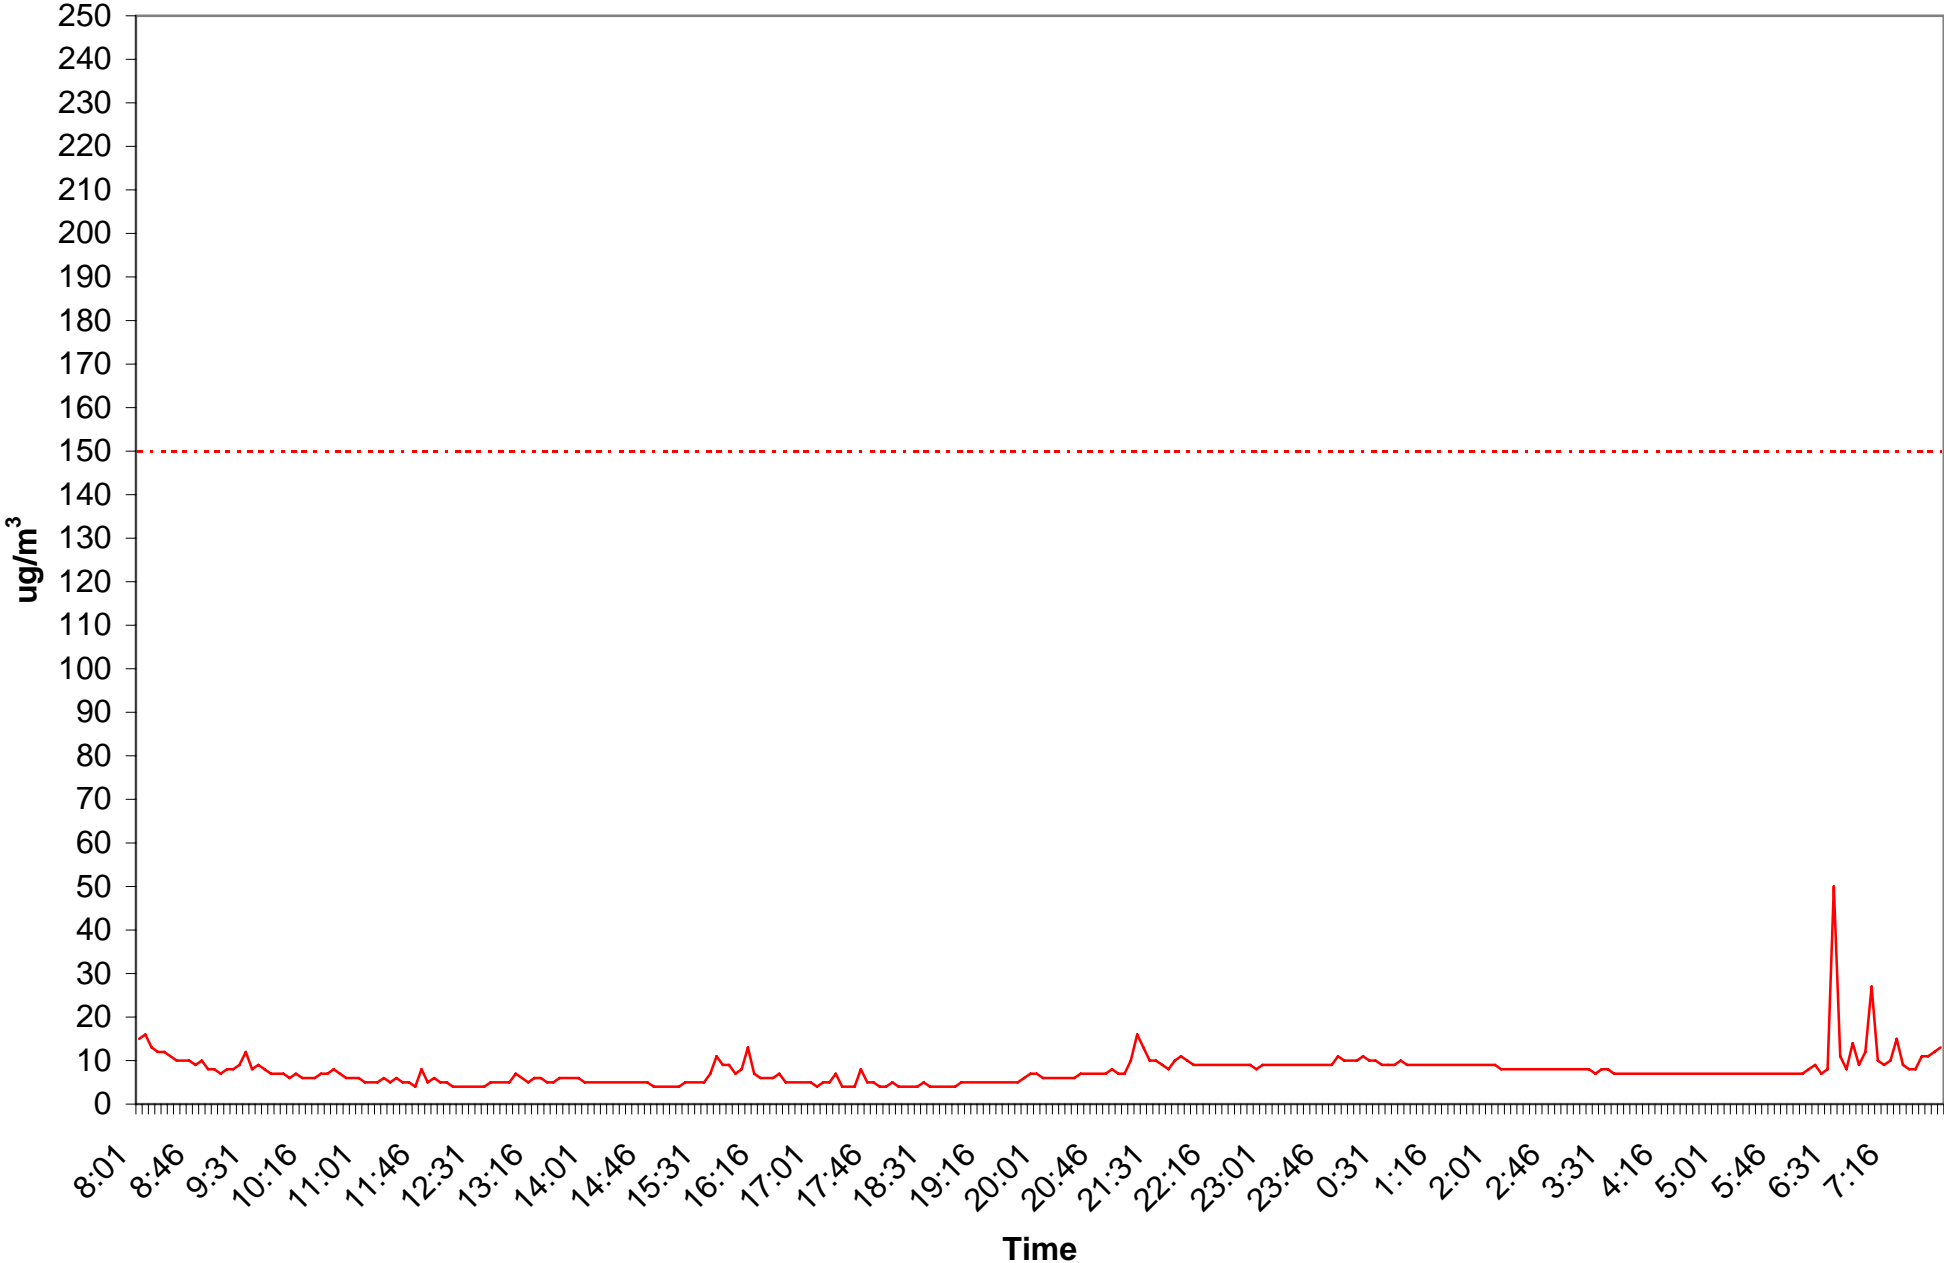

Site-6 Room 105

12/09-10/2010

AQM# 10-510

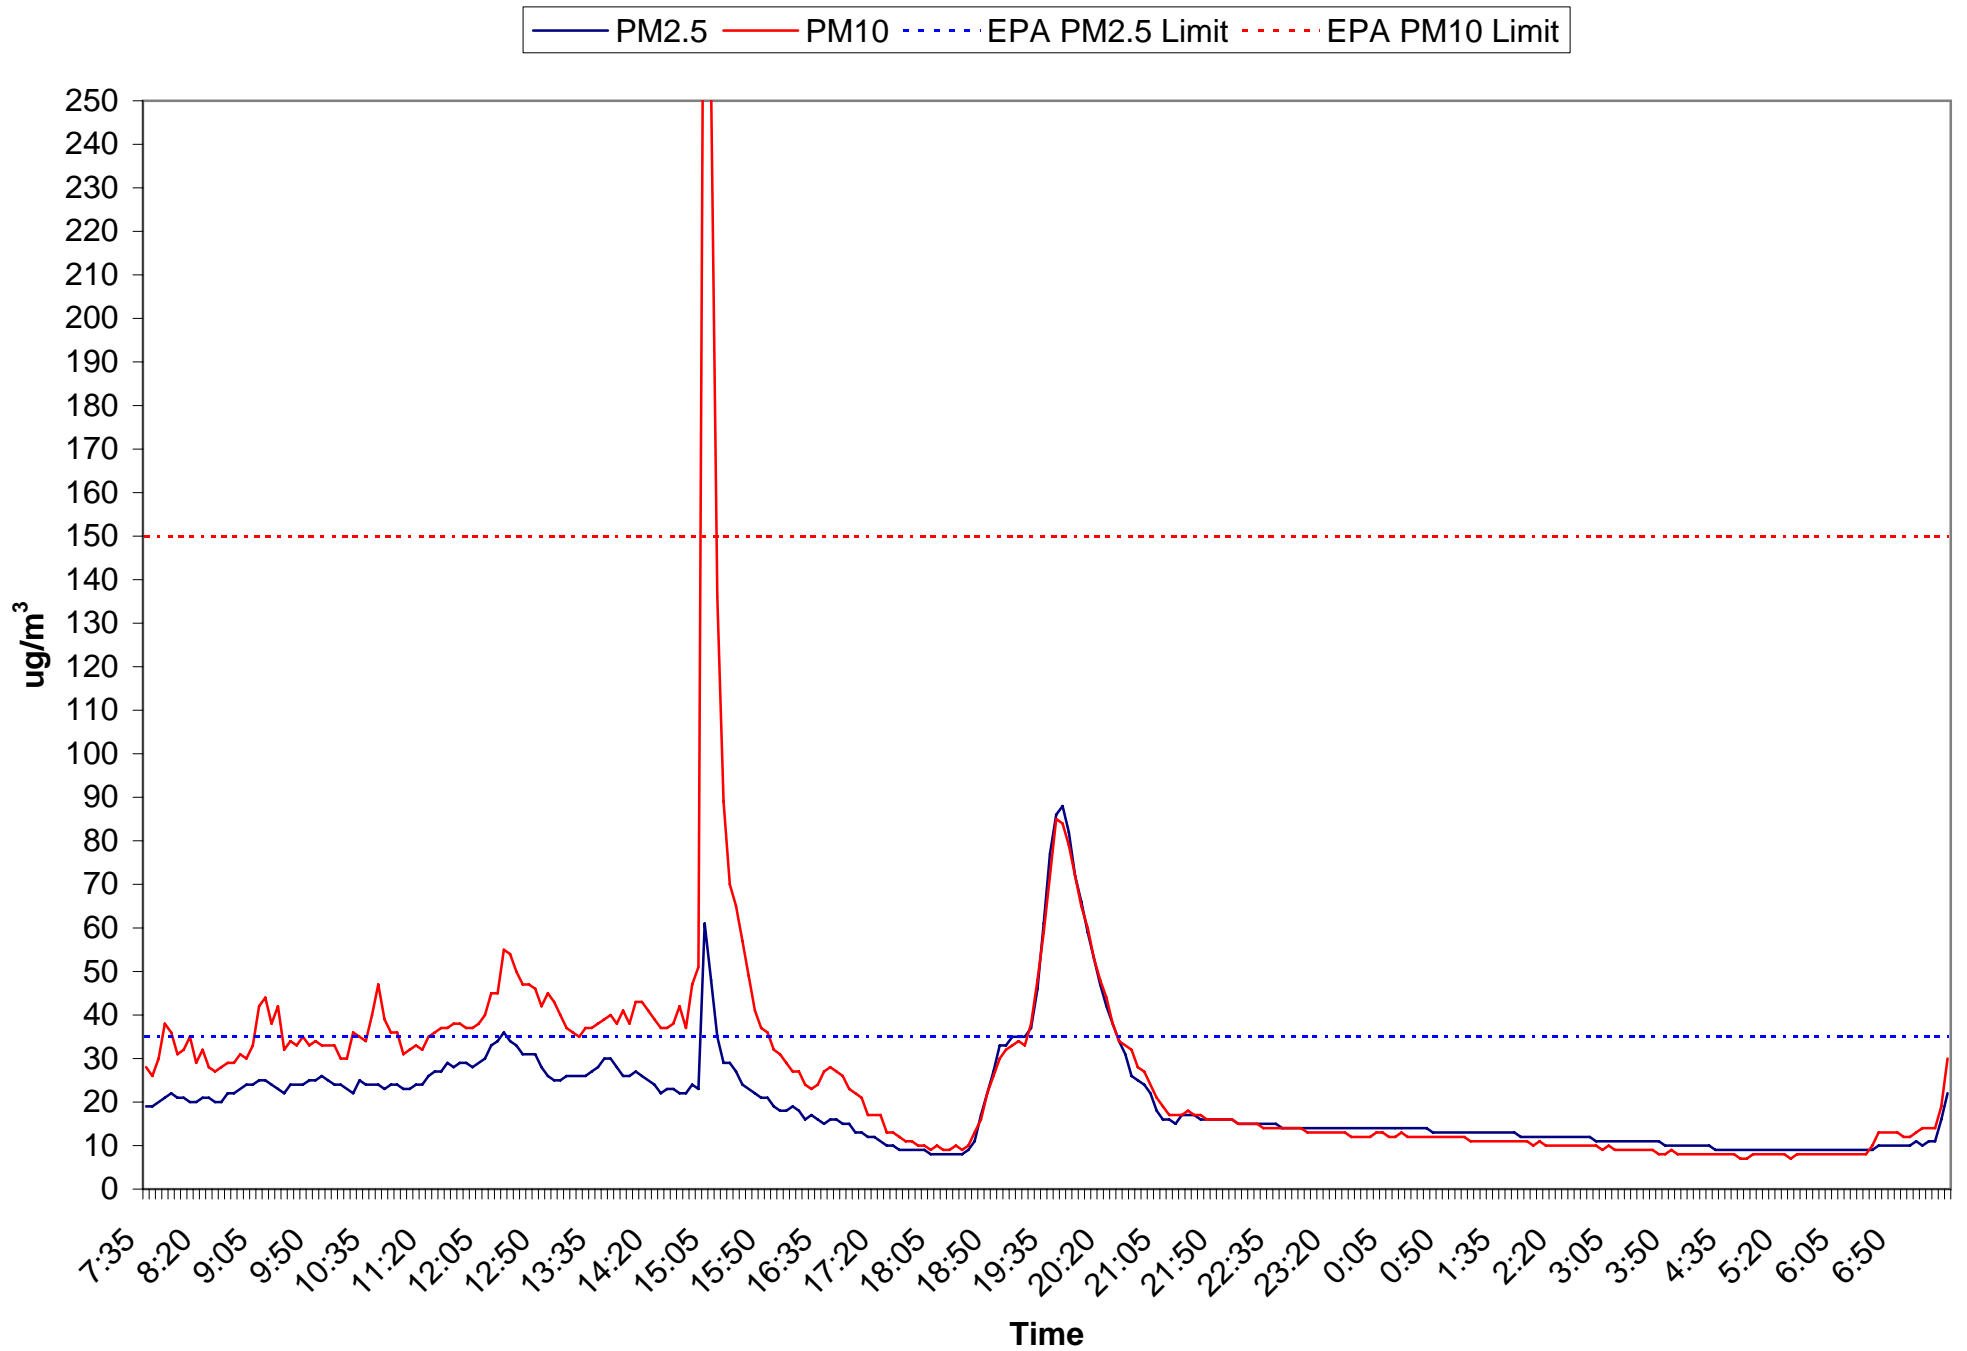


Site-6 Room 105

12/09-10/2010

AQM# 10-510


— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

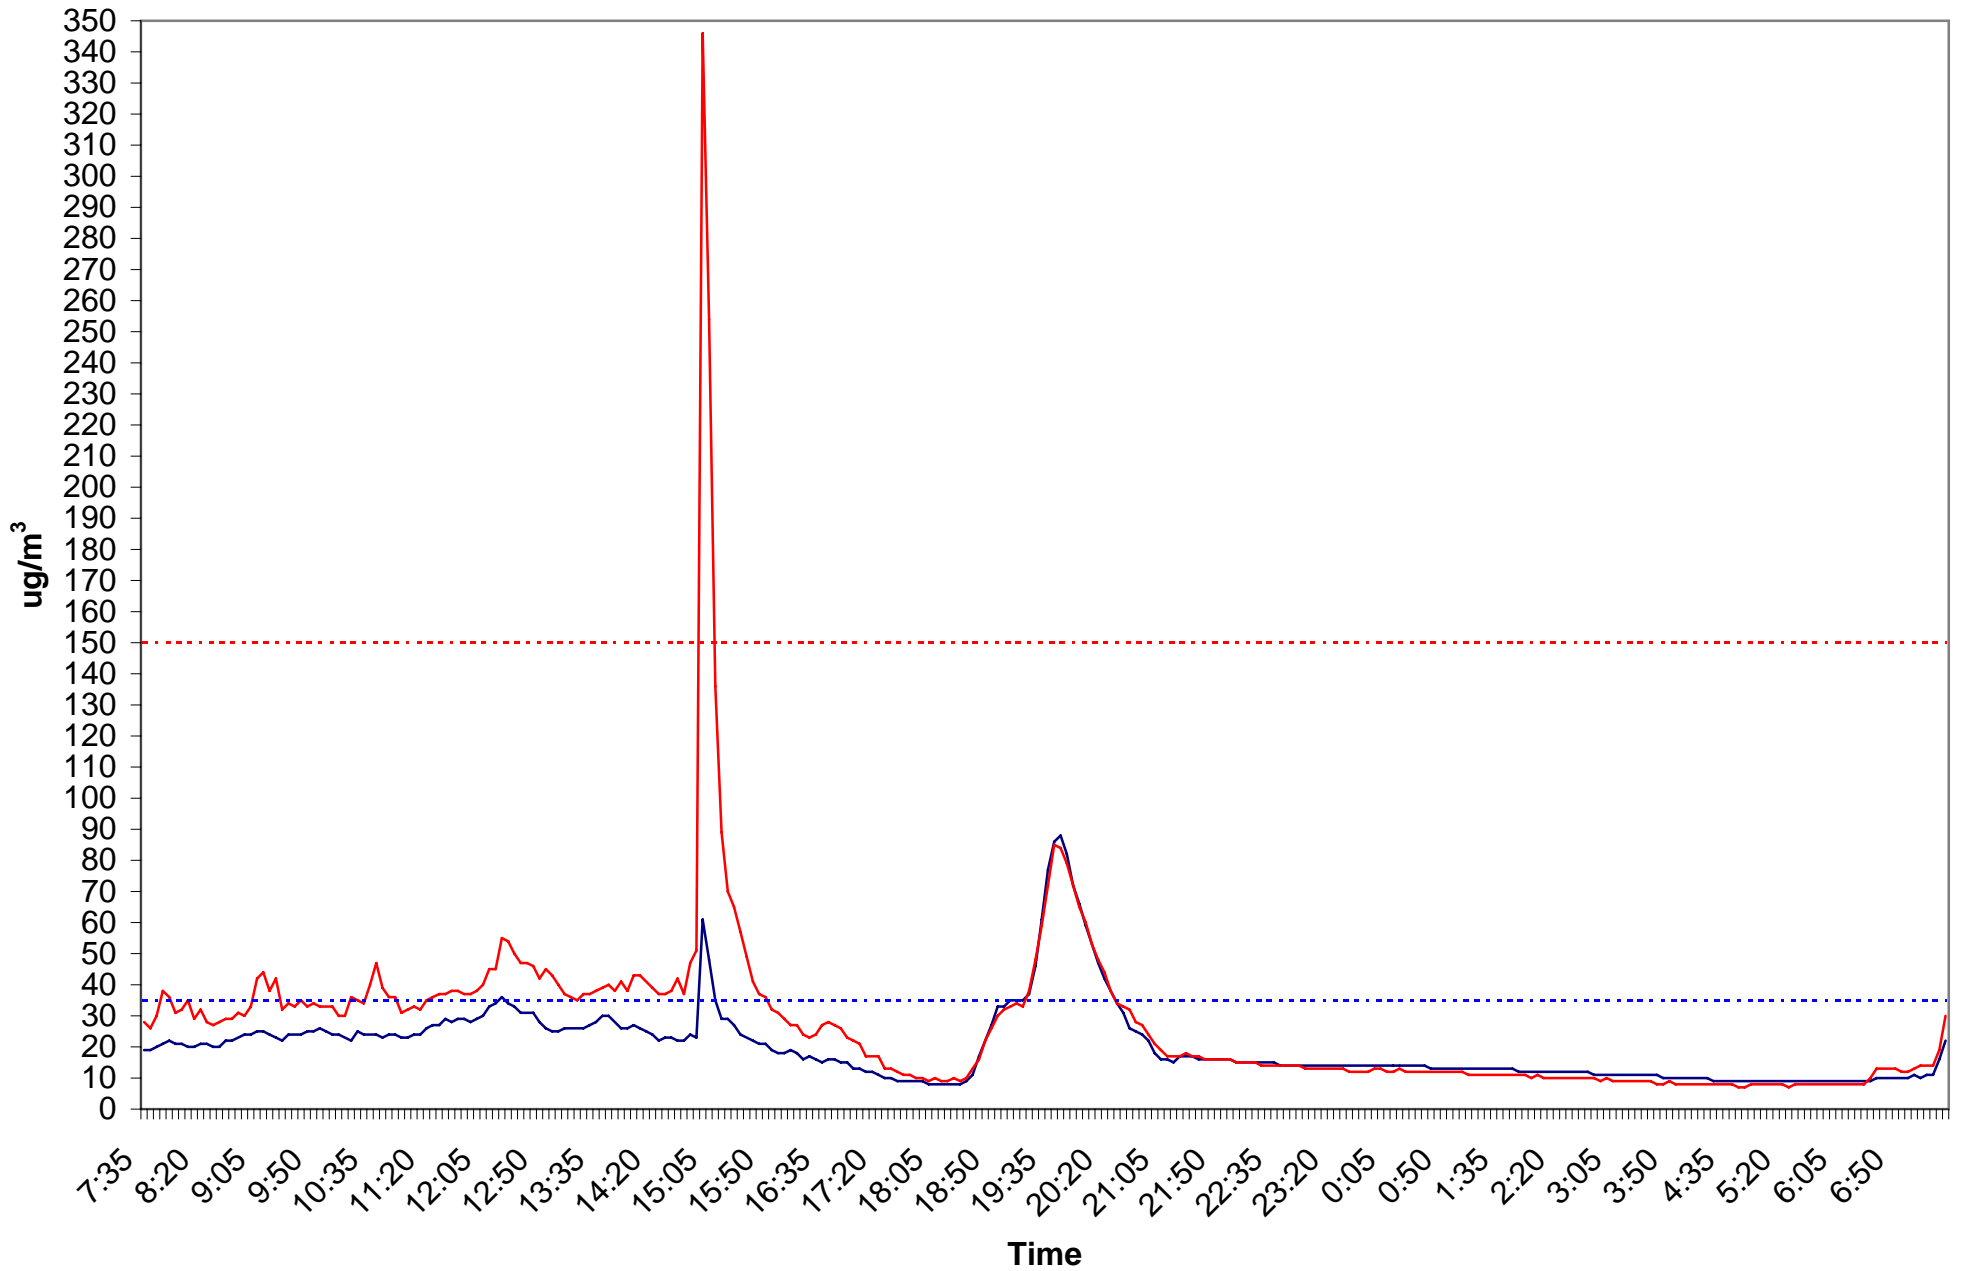

Site-7 Room 107

12/09-10/2010
AQM# 10-510


— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

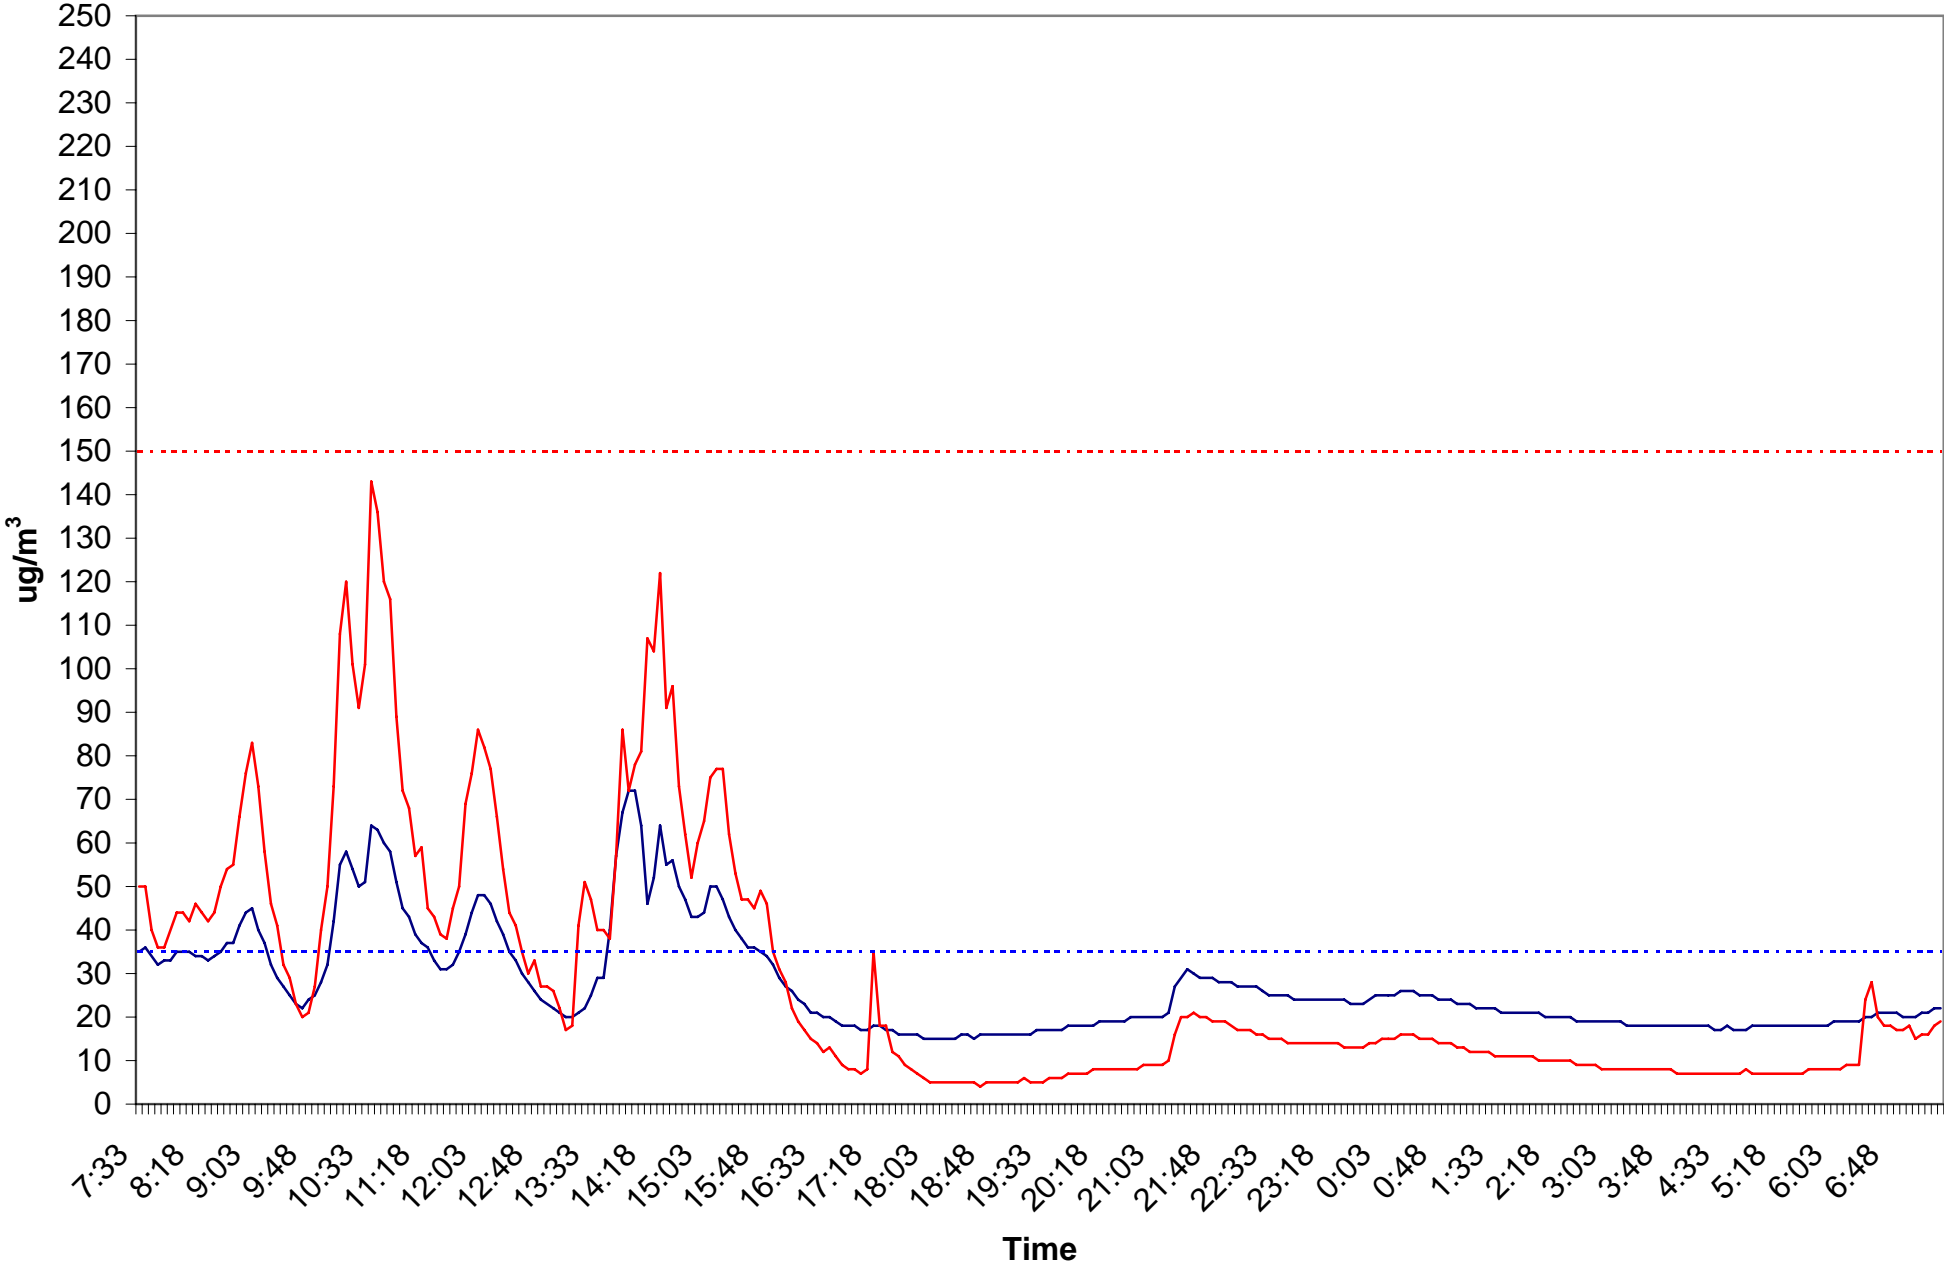

Site-8 Balcony by Chorus


12/09-10/2010
AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

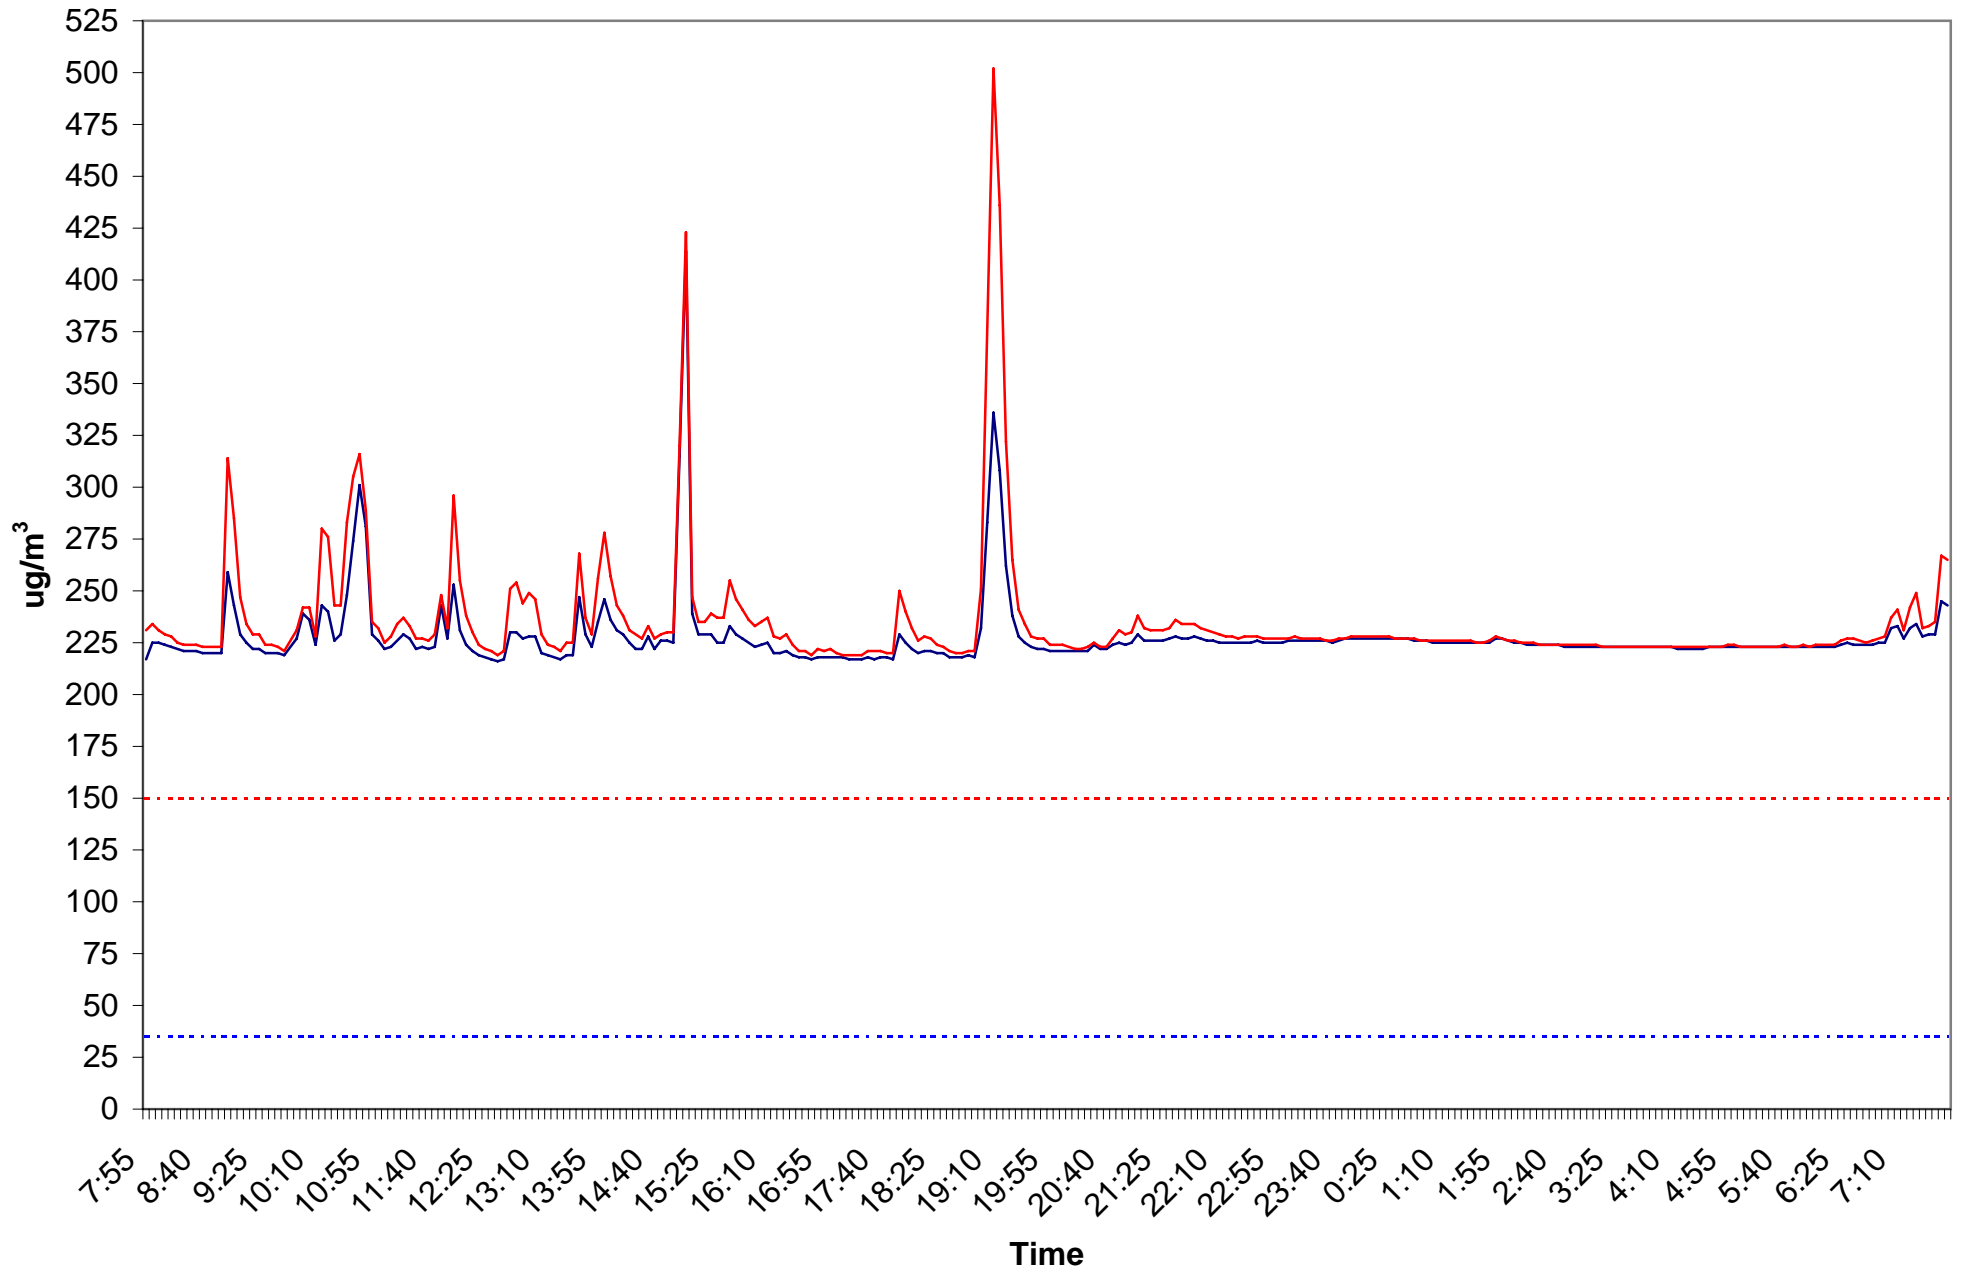

Site-9 Hall by Room 14


12/09-10/2010
AQM# 10-510

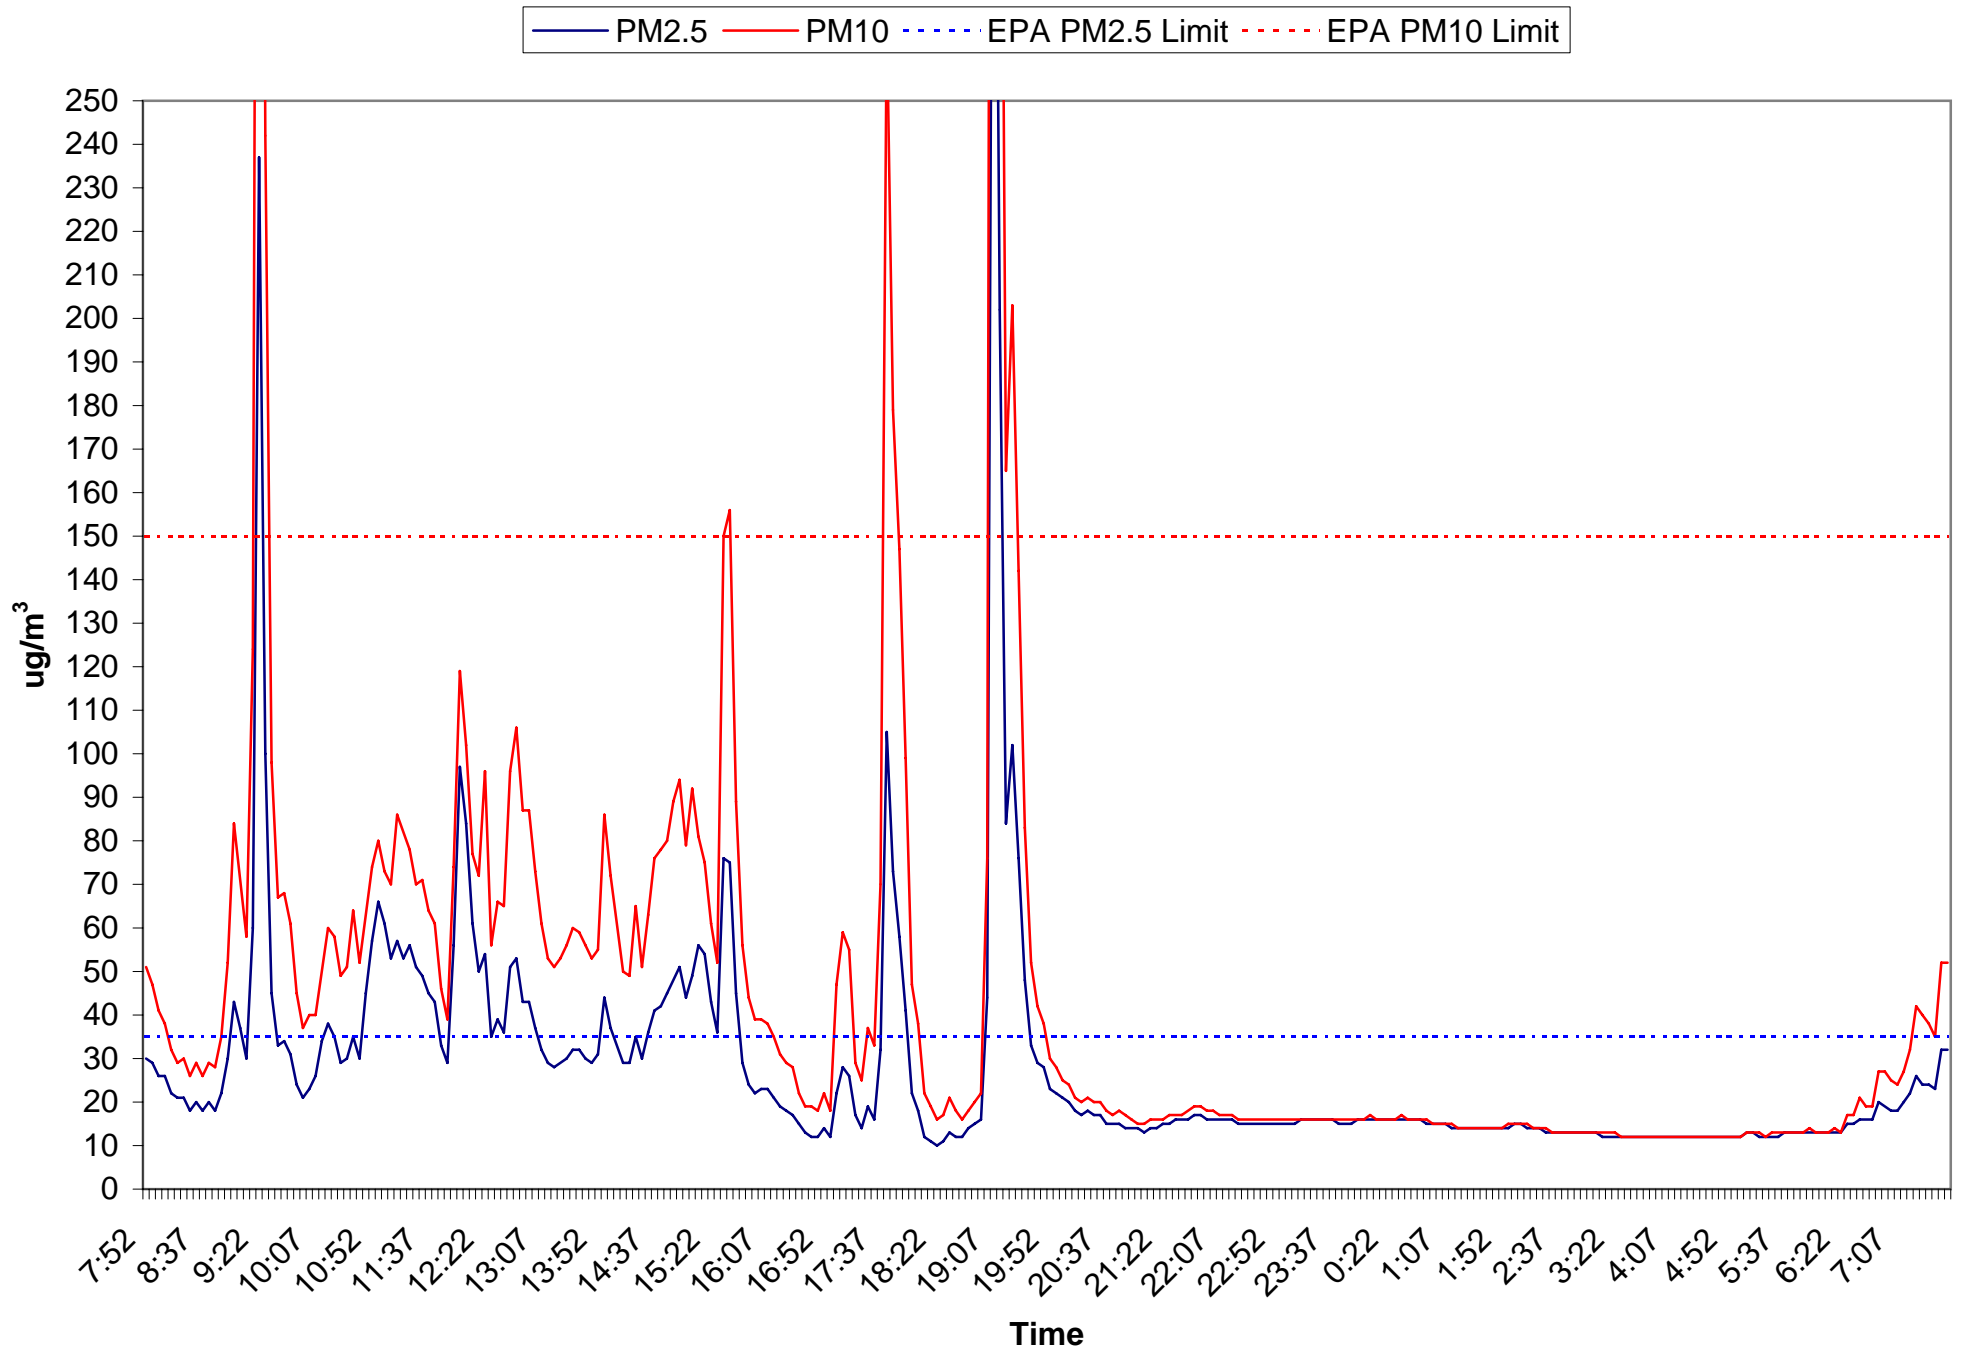

Site-9 Hall by Room 14

12/09-10/2010
AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

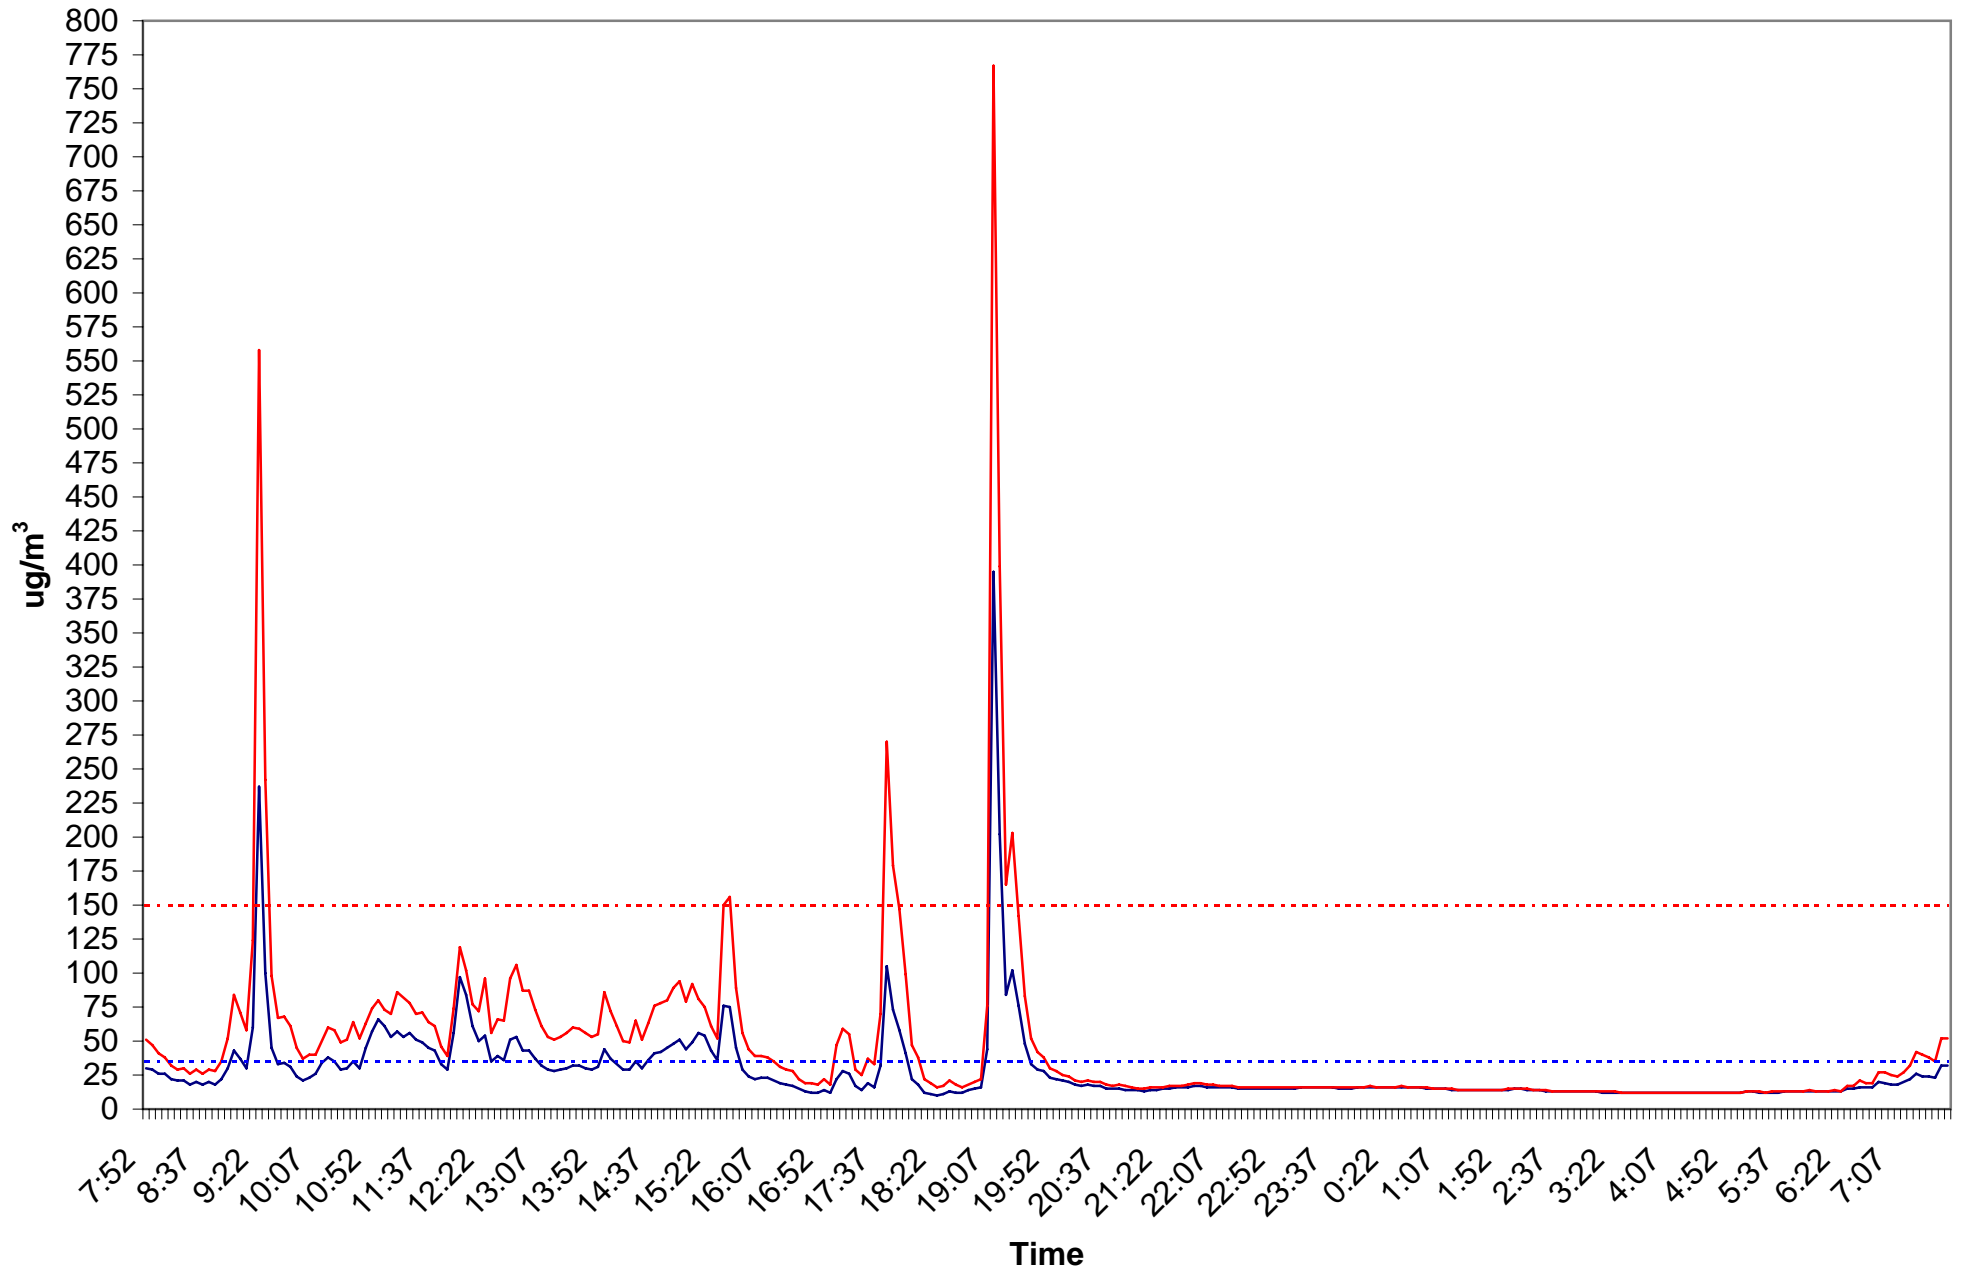


Site-10 Girls' Locker Room

12/09-10/2010

AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

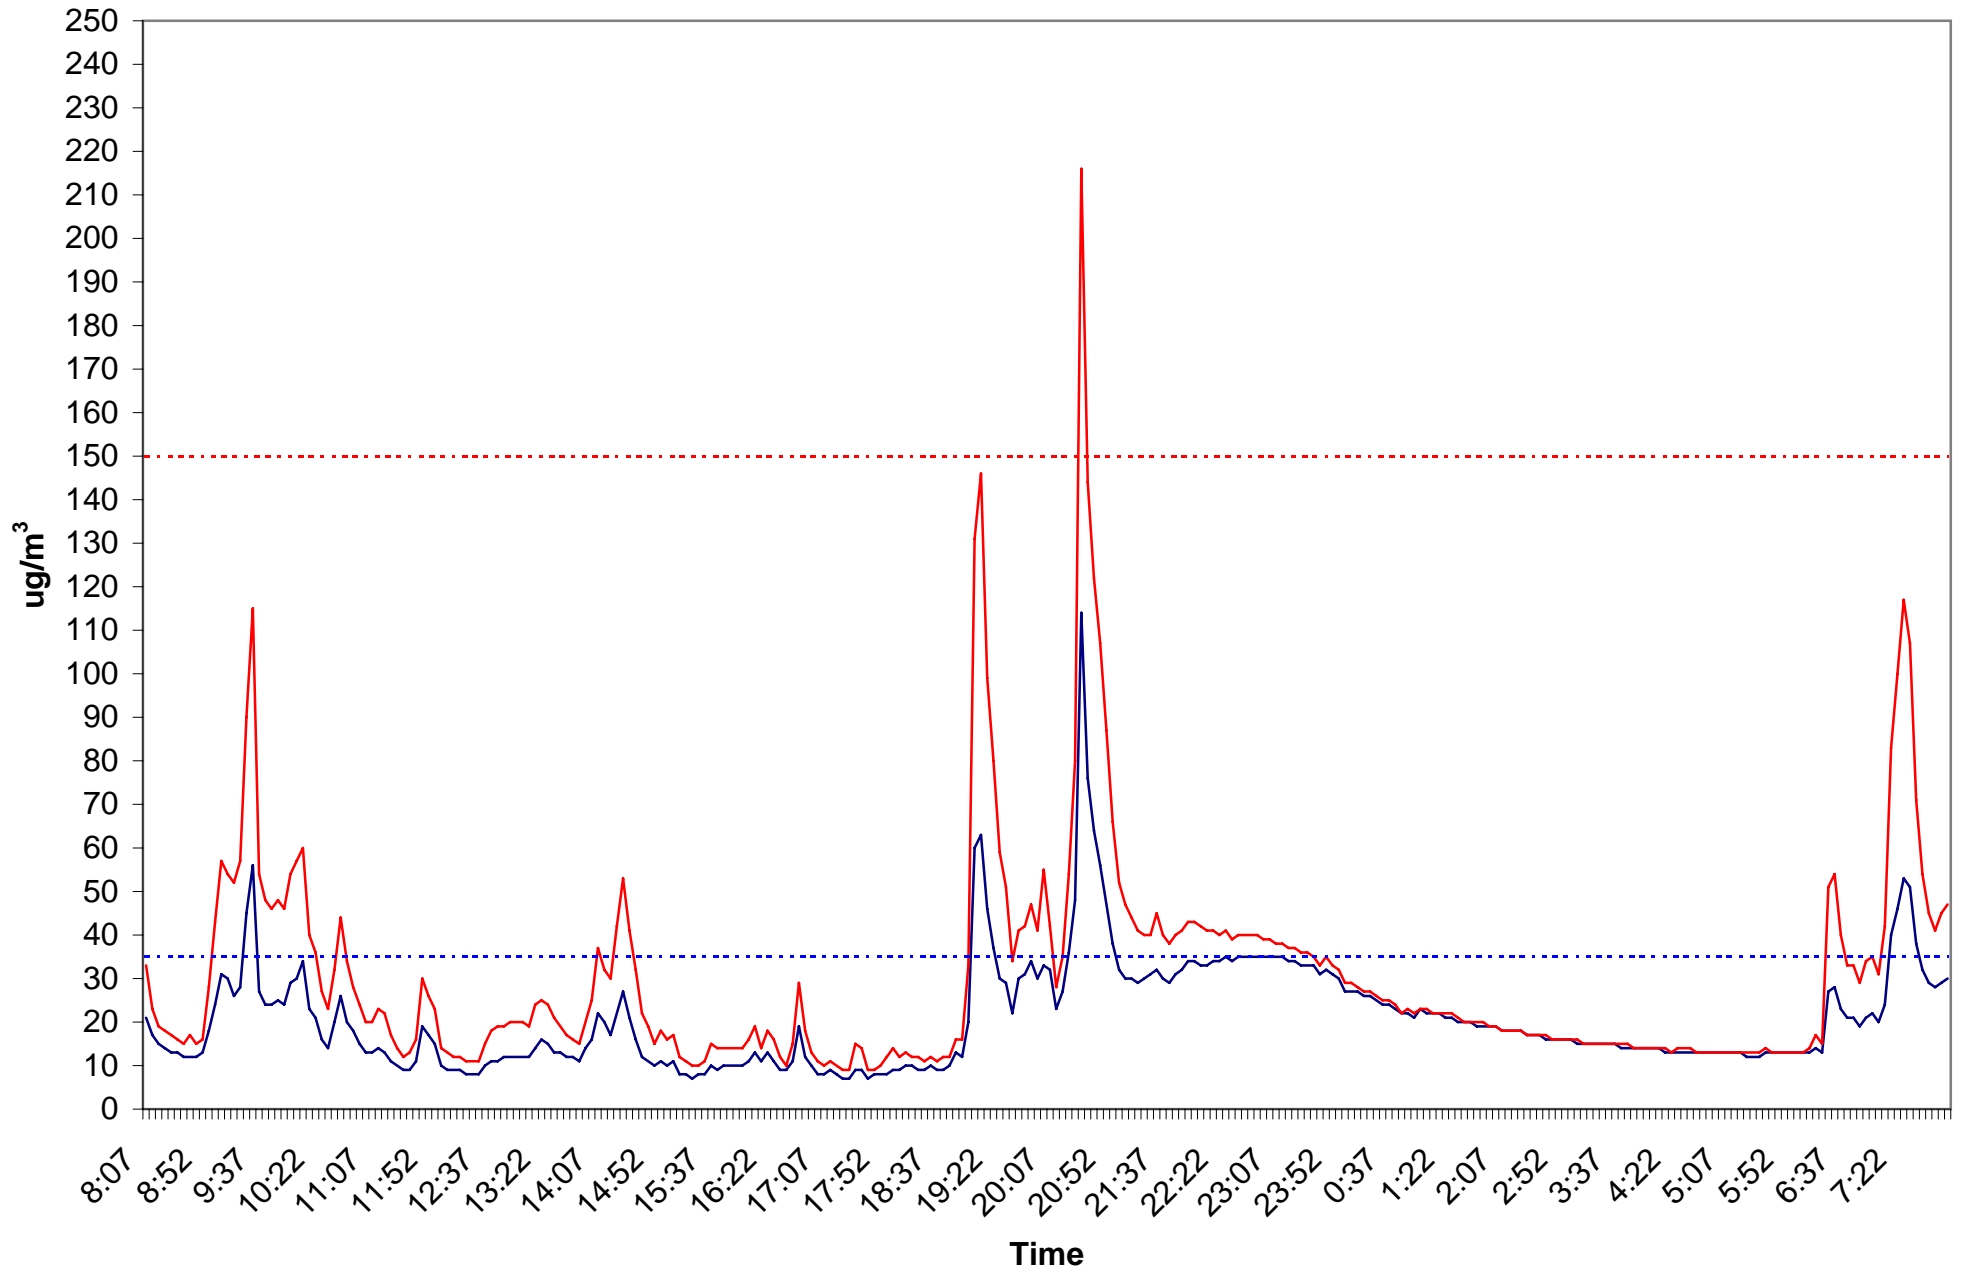


Site-11 Room 4

12/09-10/2010

AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

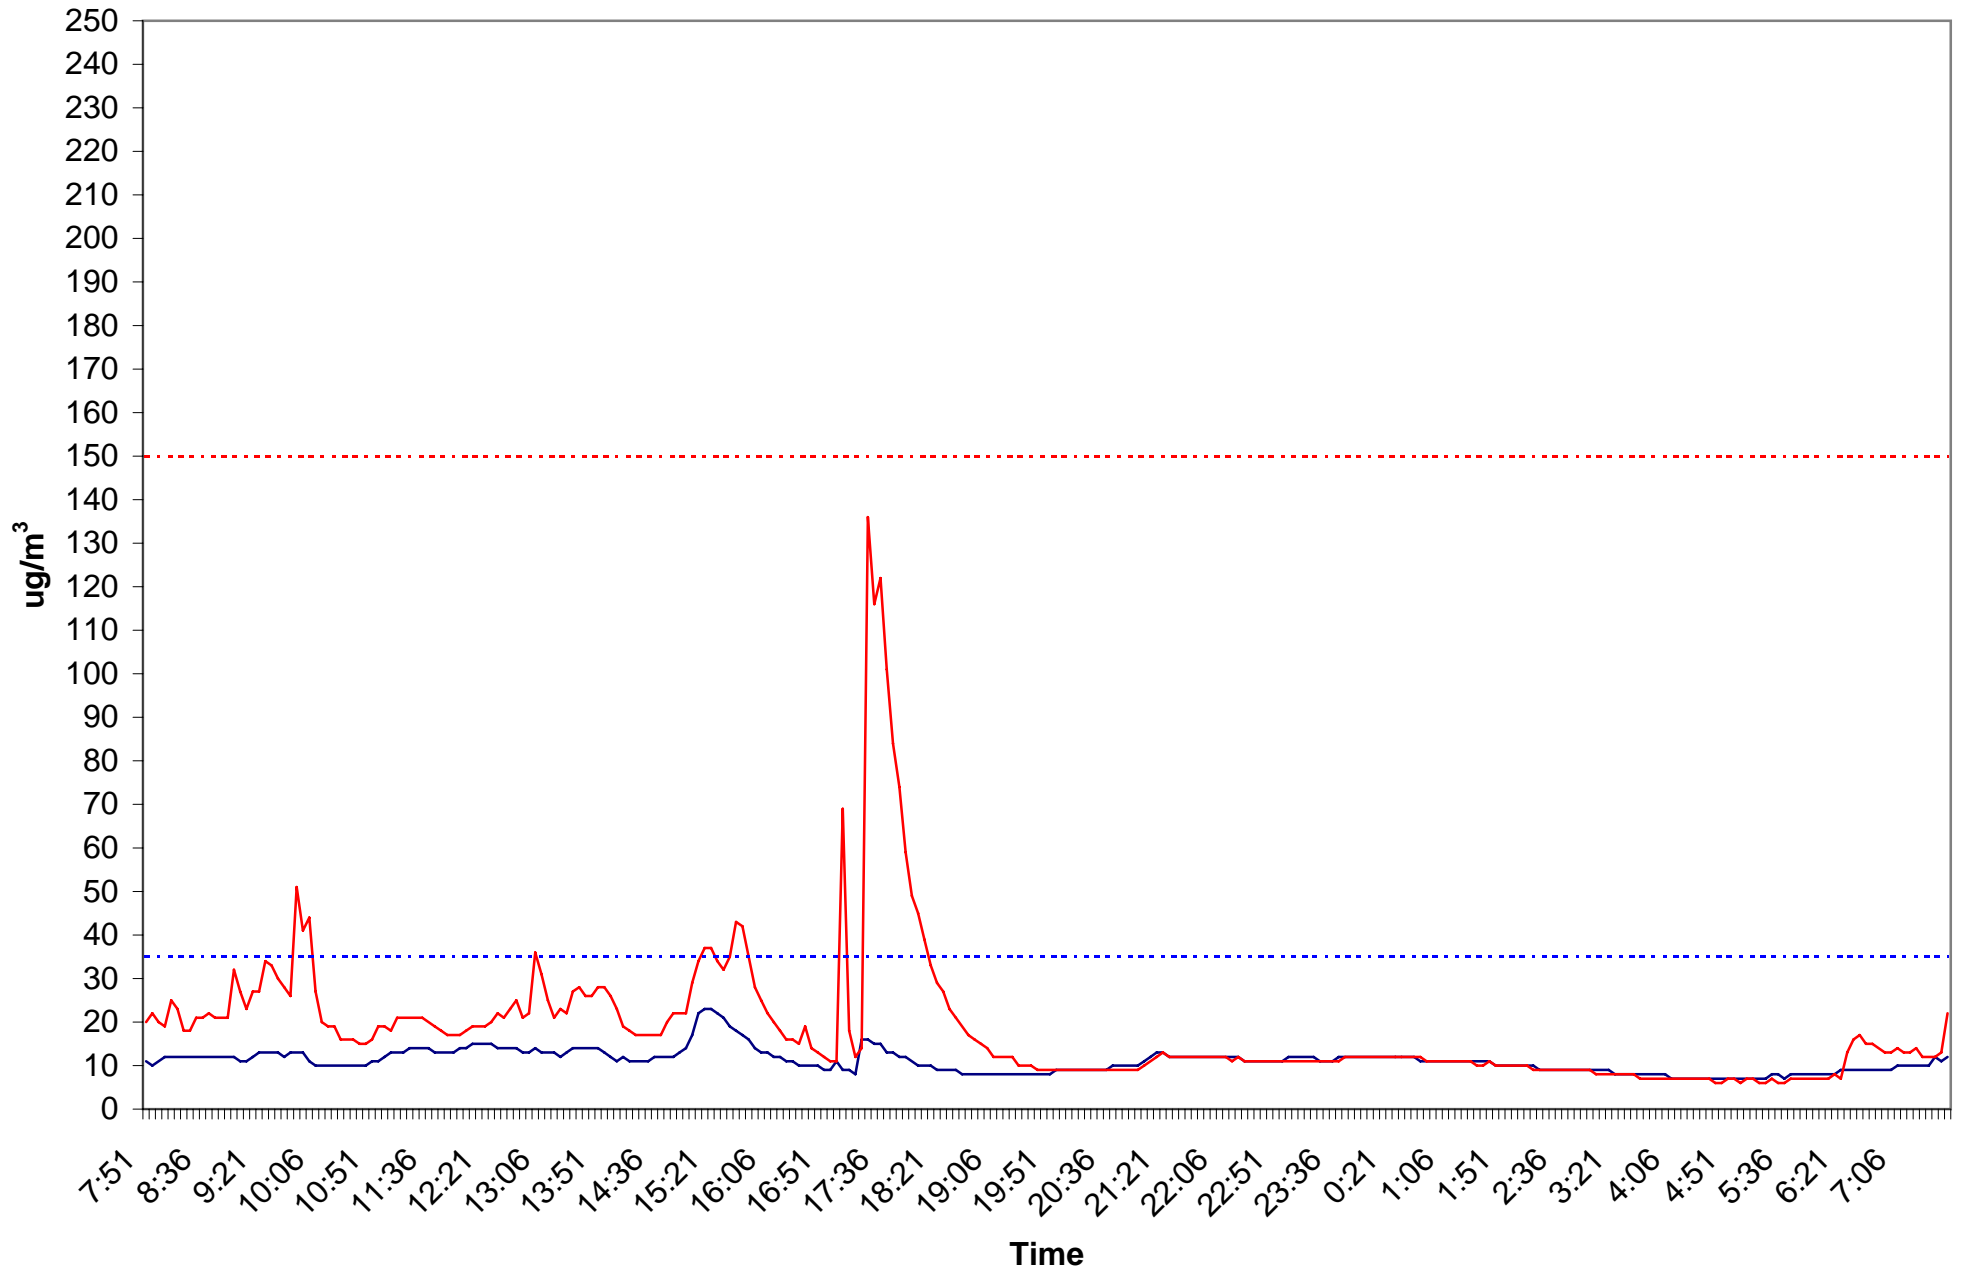


Site-12 Hall by Room 223

12/09-10/2010


AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

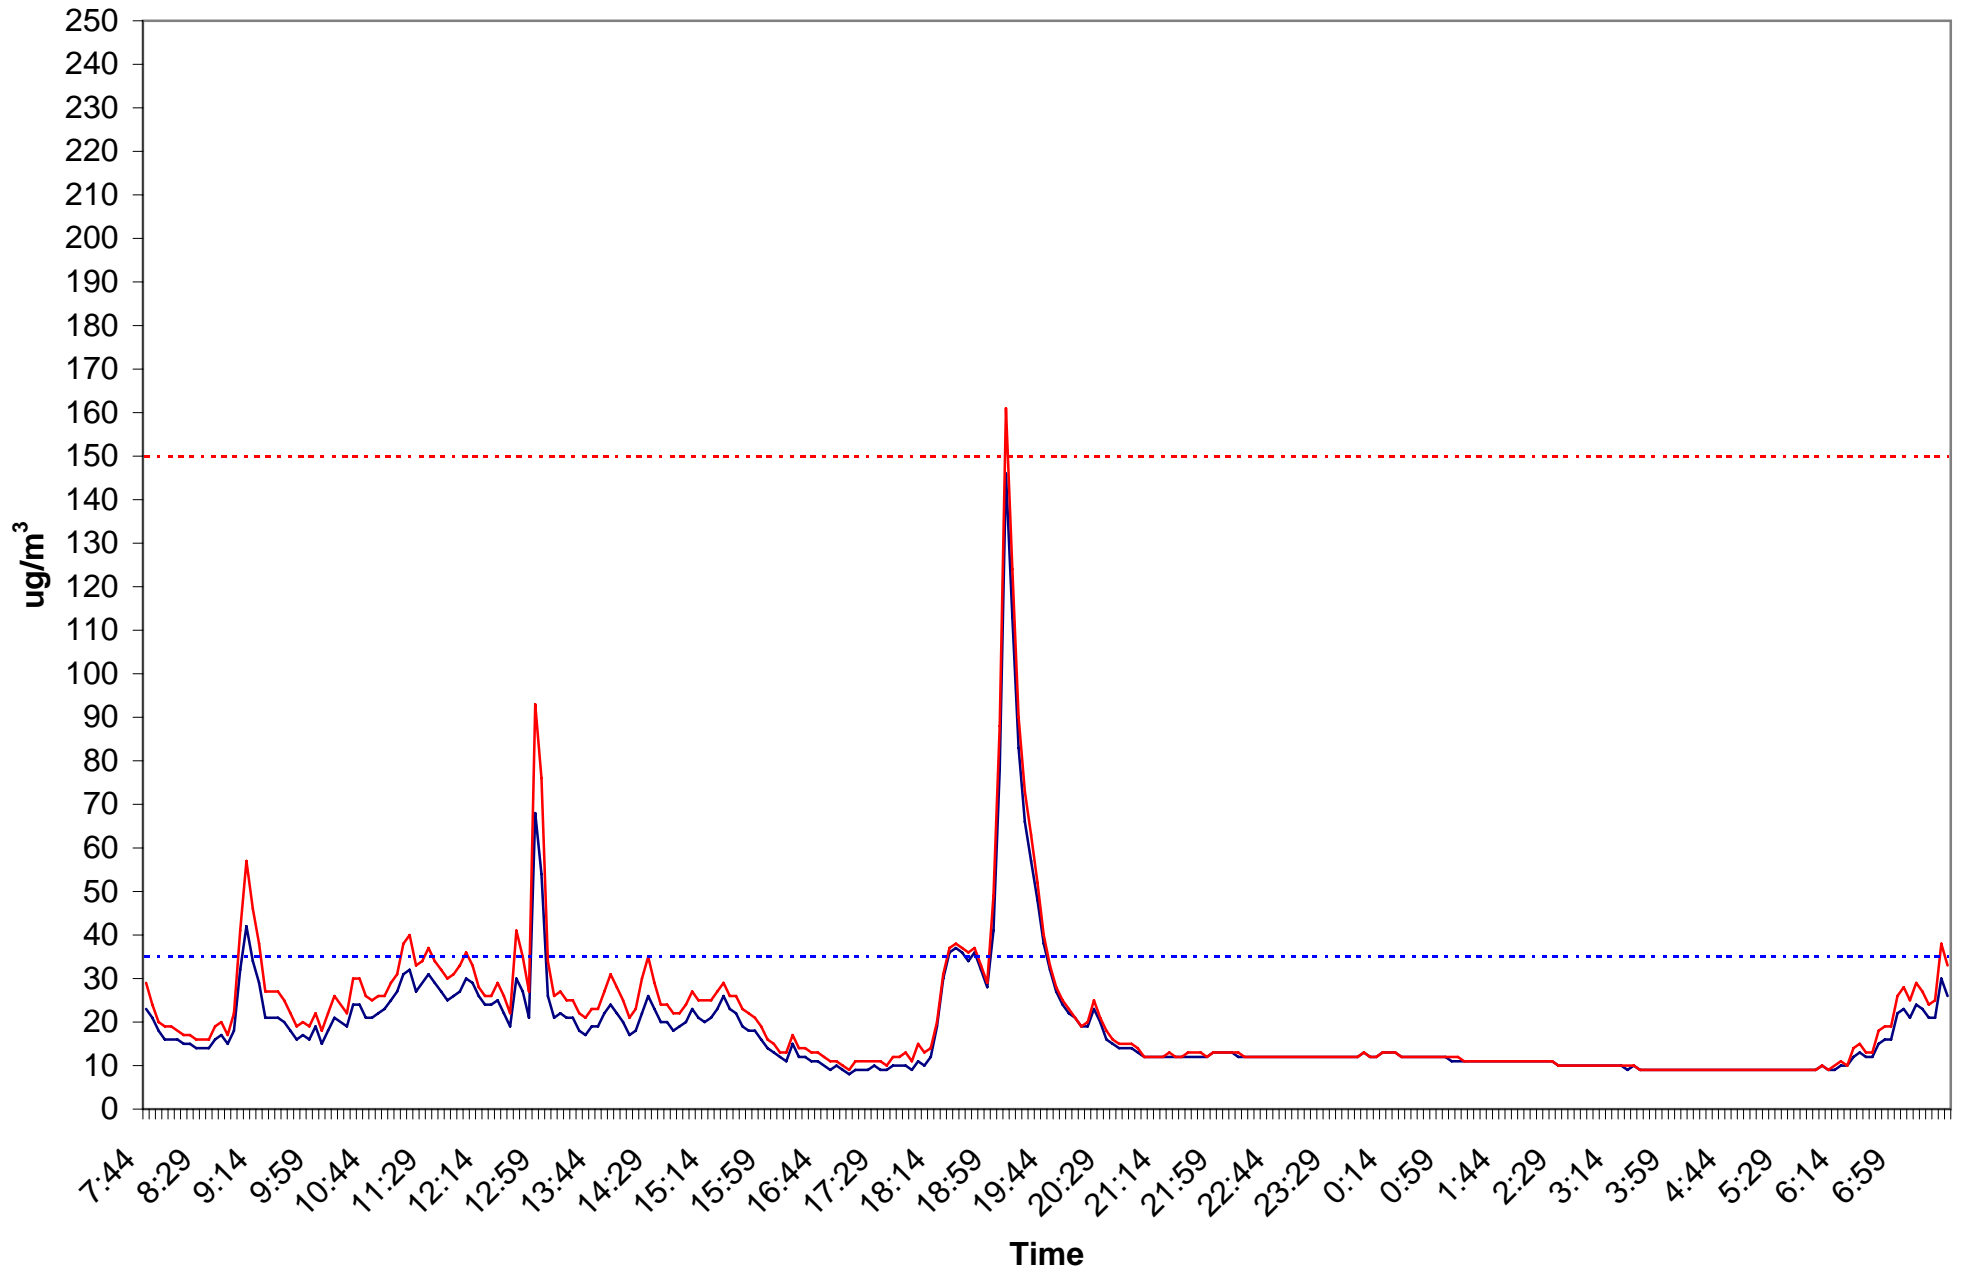

Site-13 Room 203


12/09-10/2010
AQM# 10-510

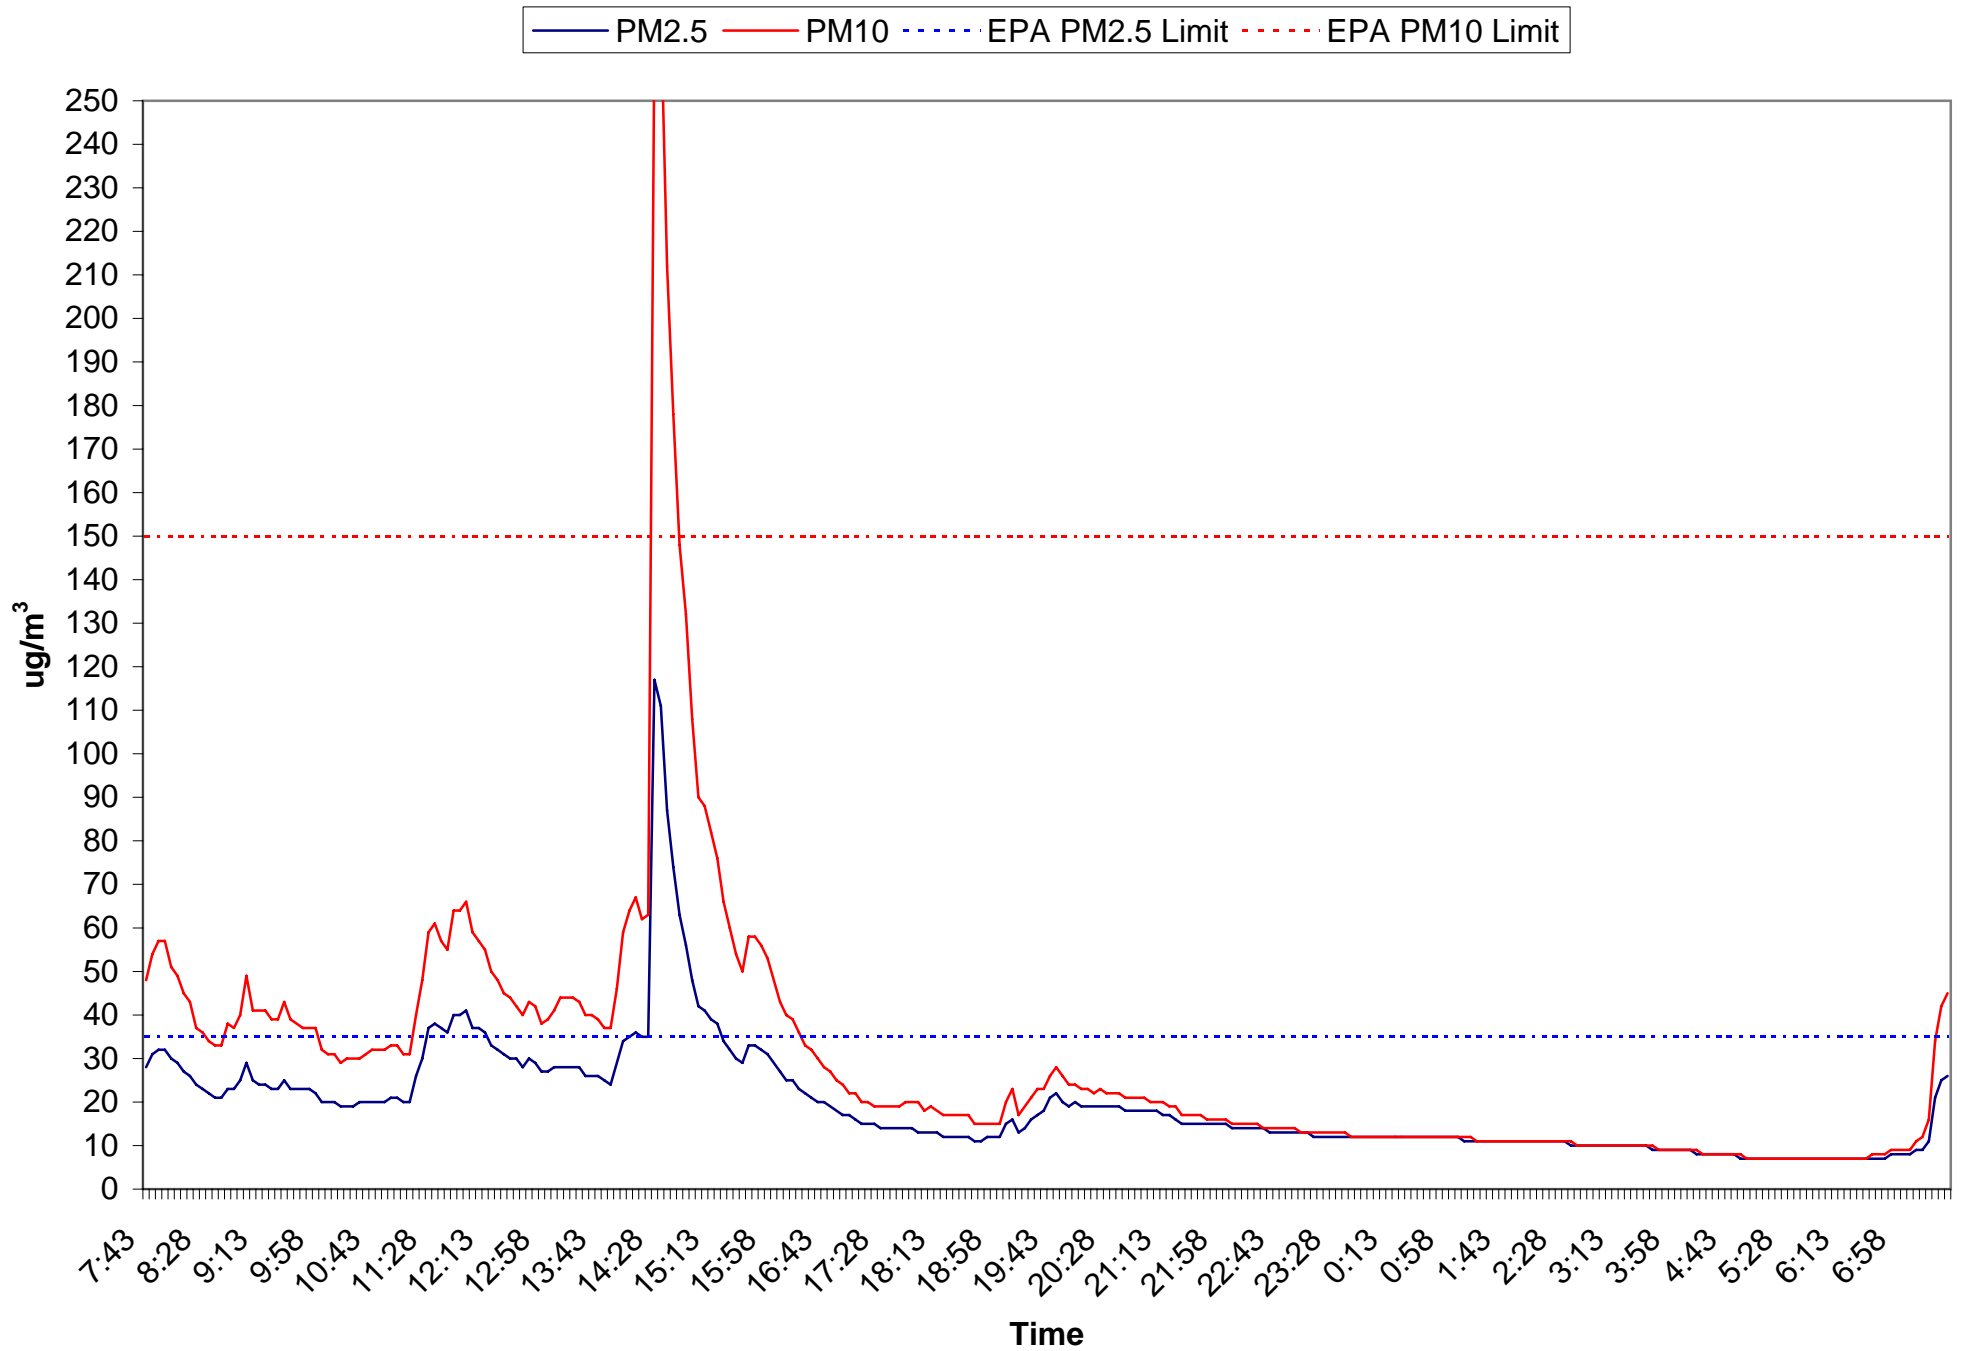

Site-14 Hall by Room 207

12/09-10/2010
AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

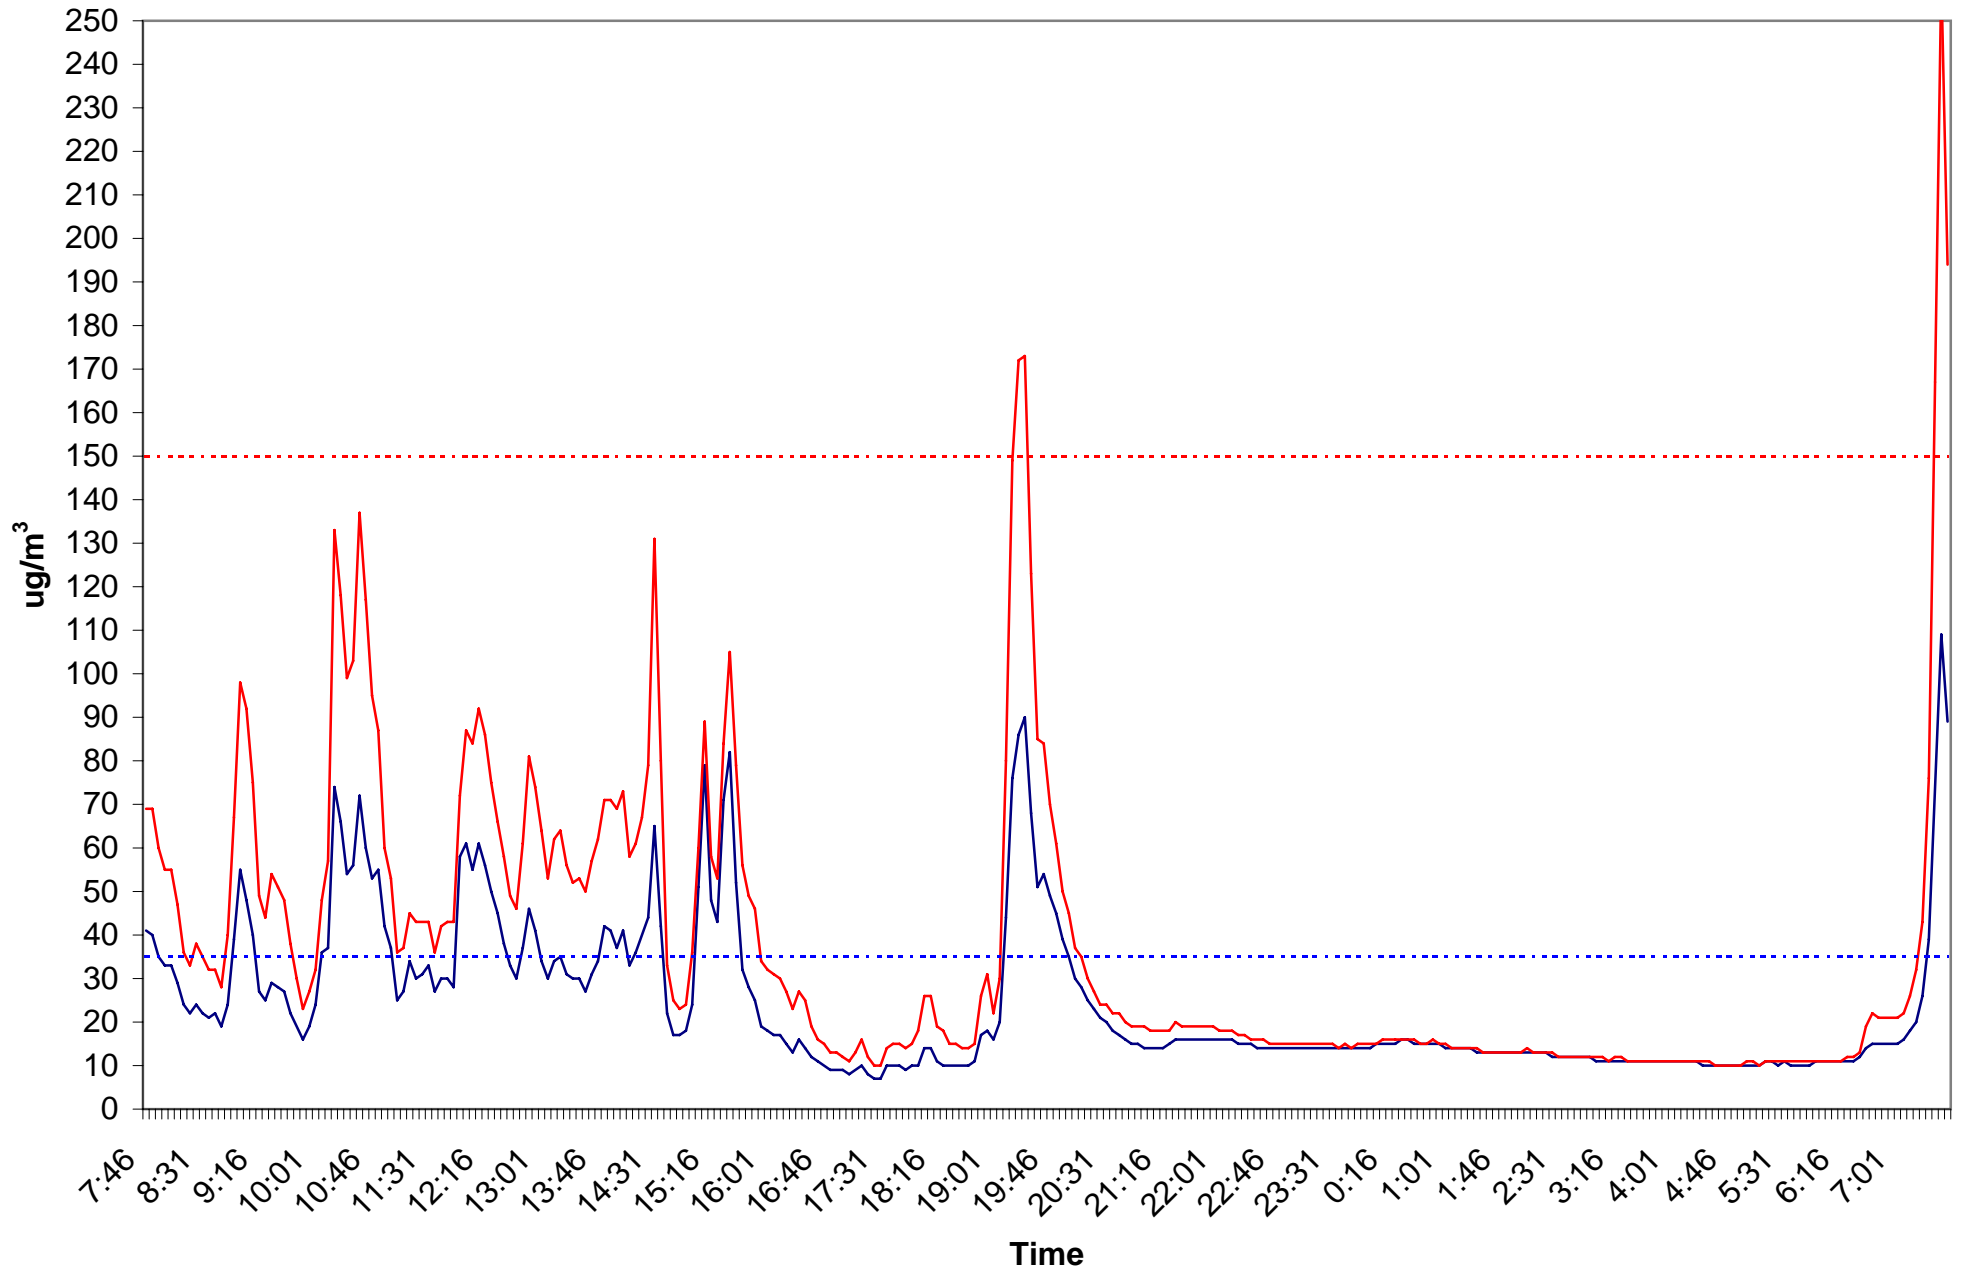


Site-15 Room 215

12/09-10/2010


AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

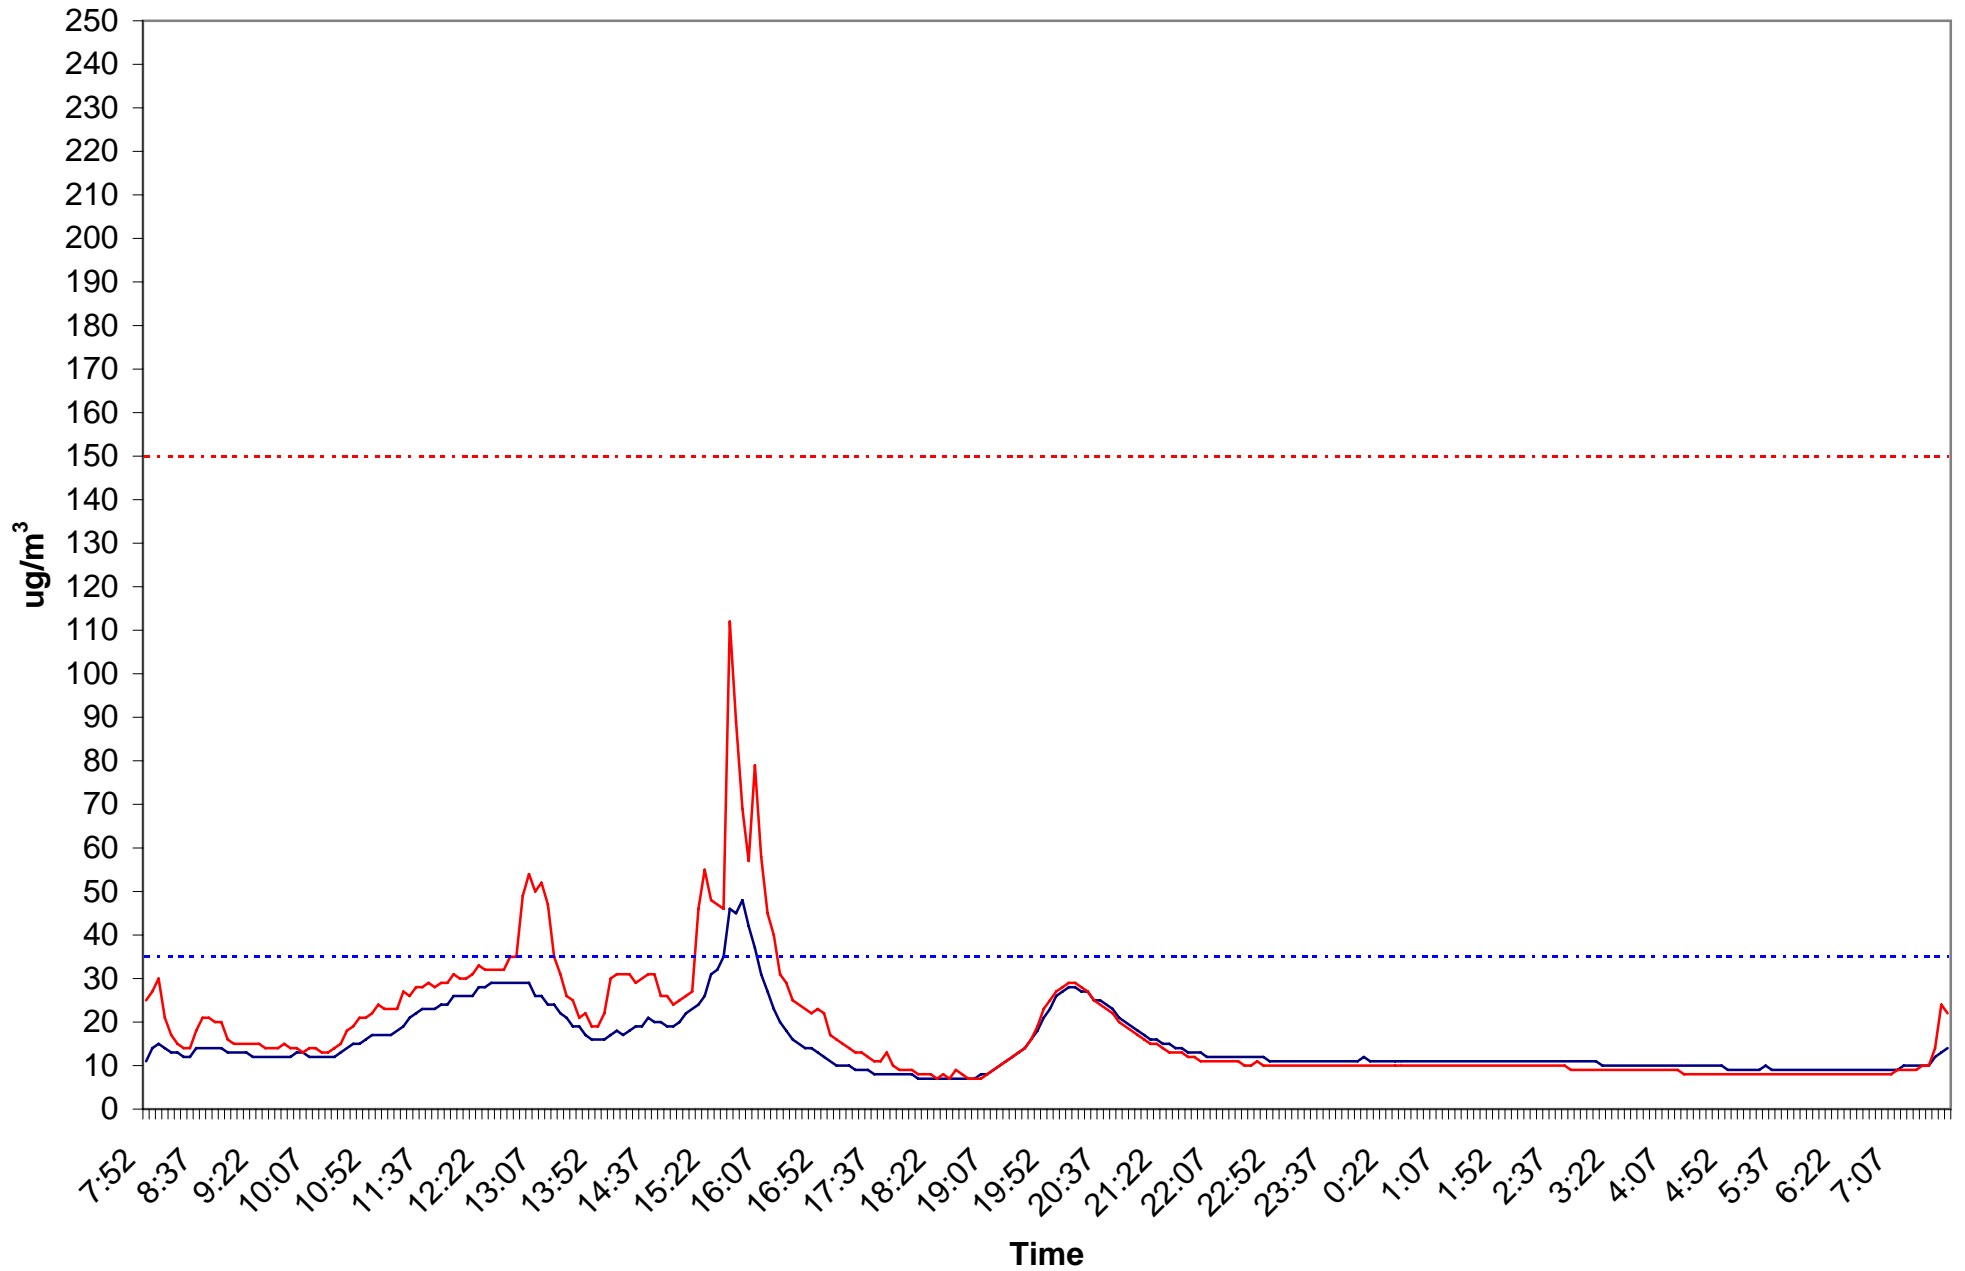

Site-16 Room 209


12/09-10/2010
AQM# 10-510

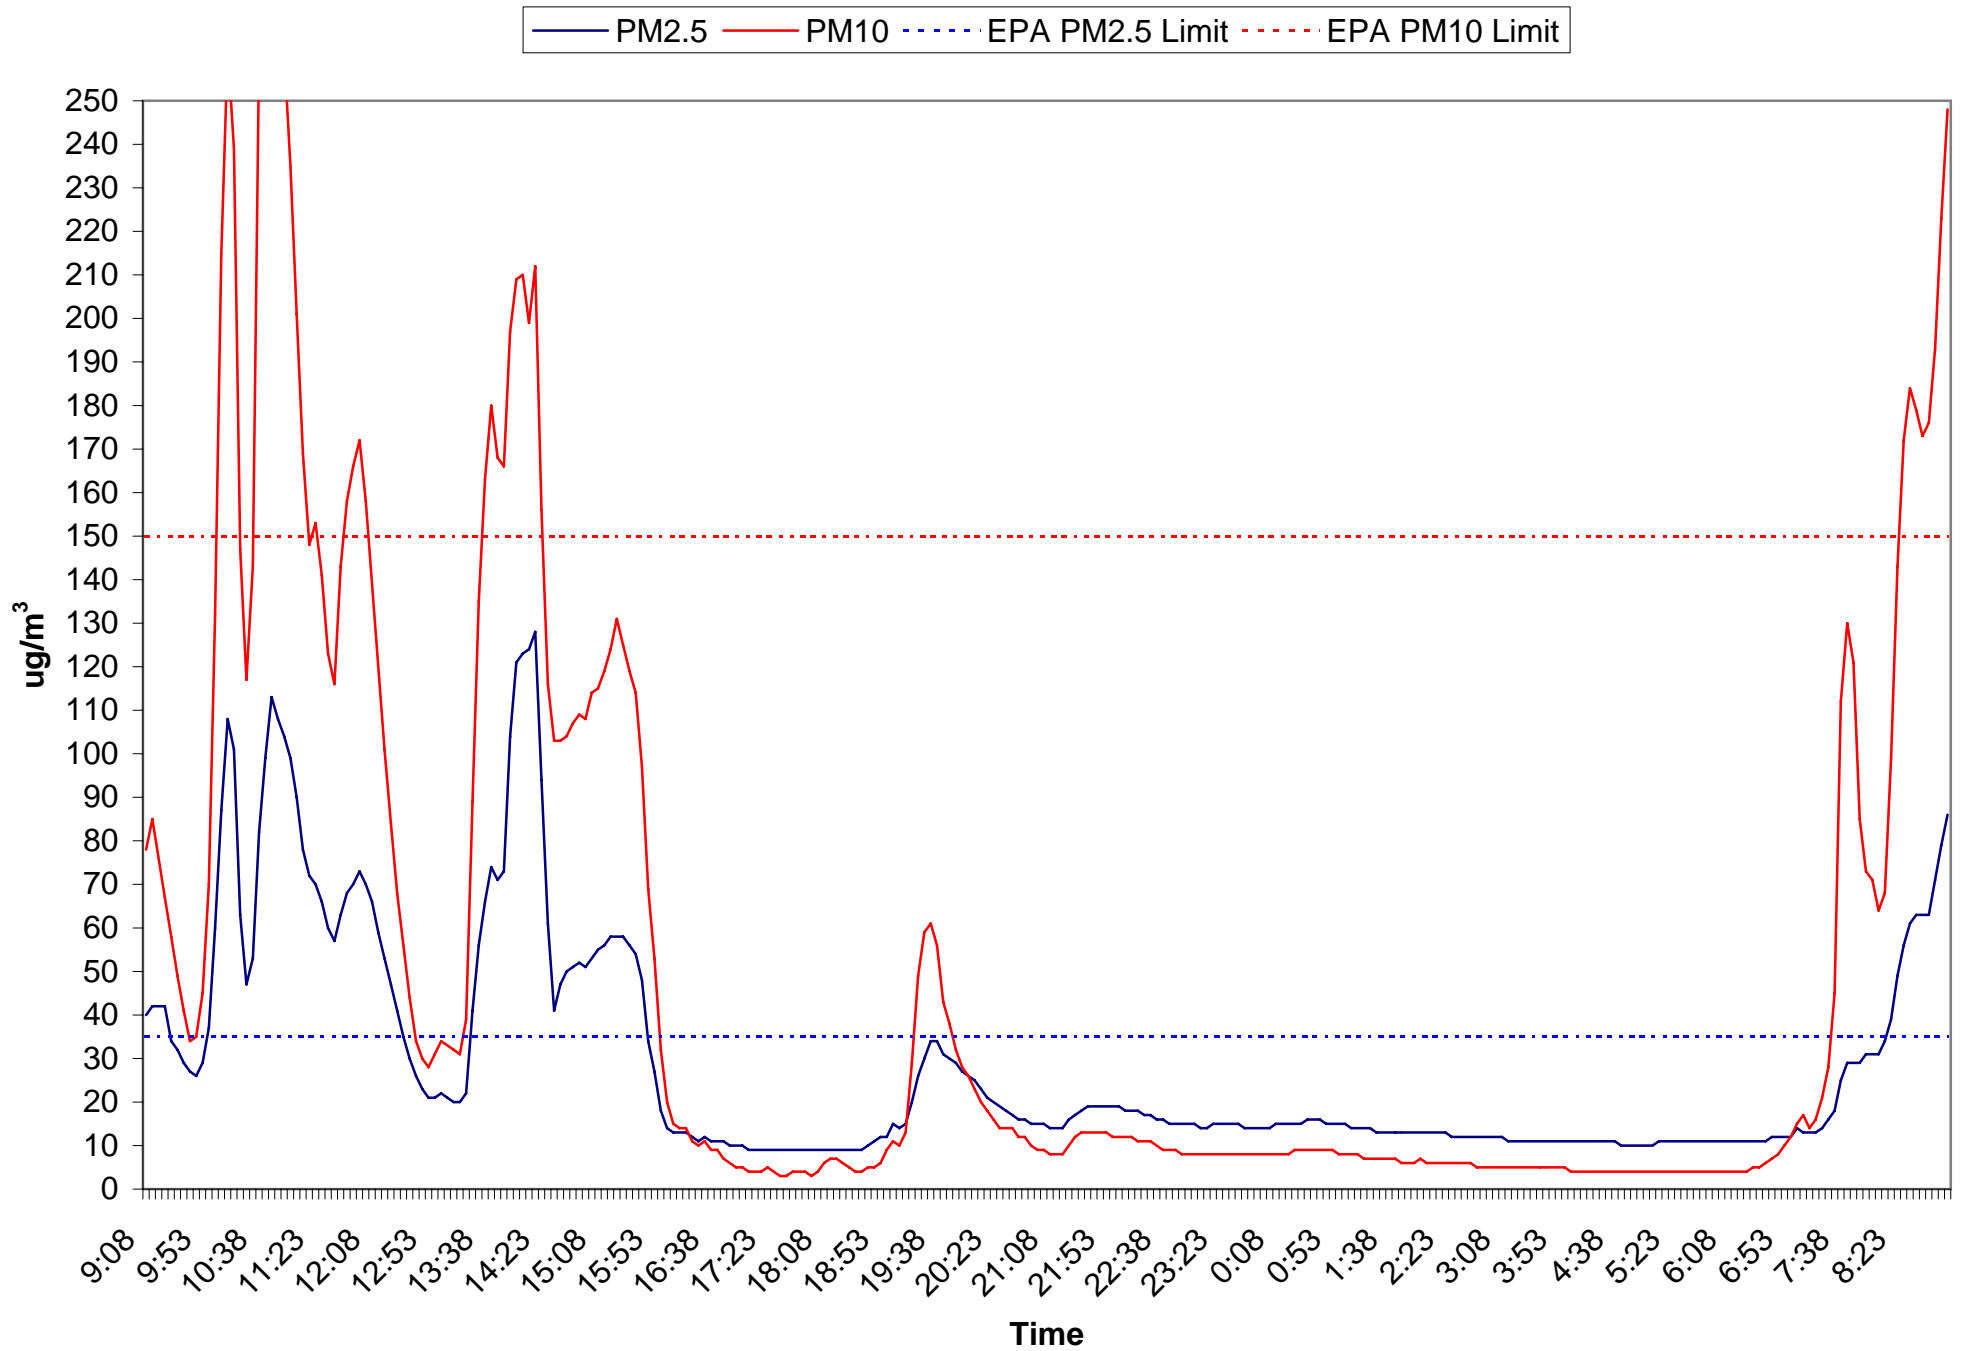

Site-16 Room 209

12/09-10/2010
AQM# 10-510


— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

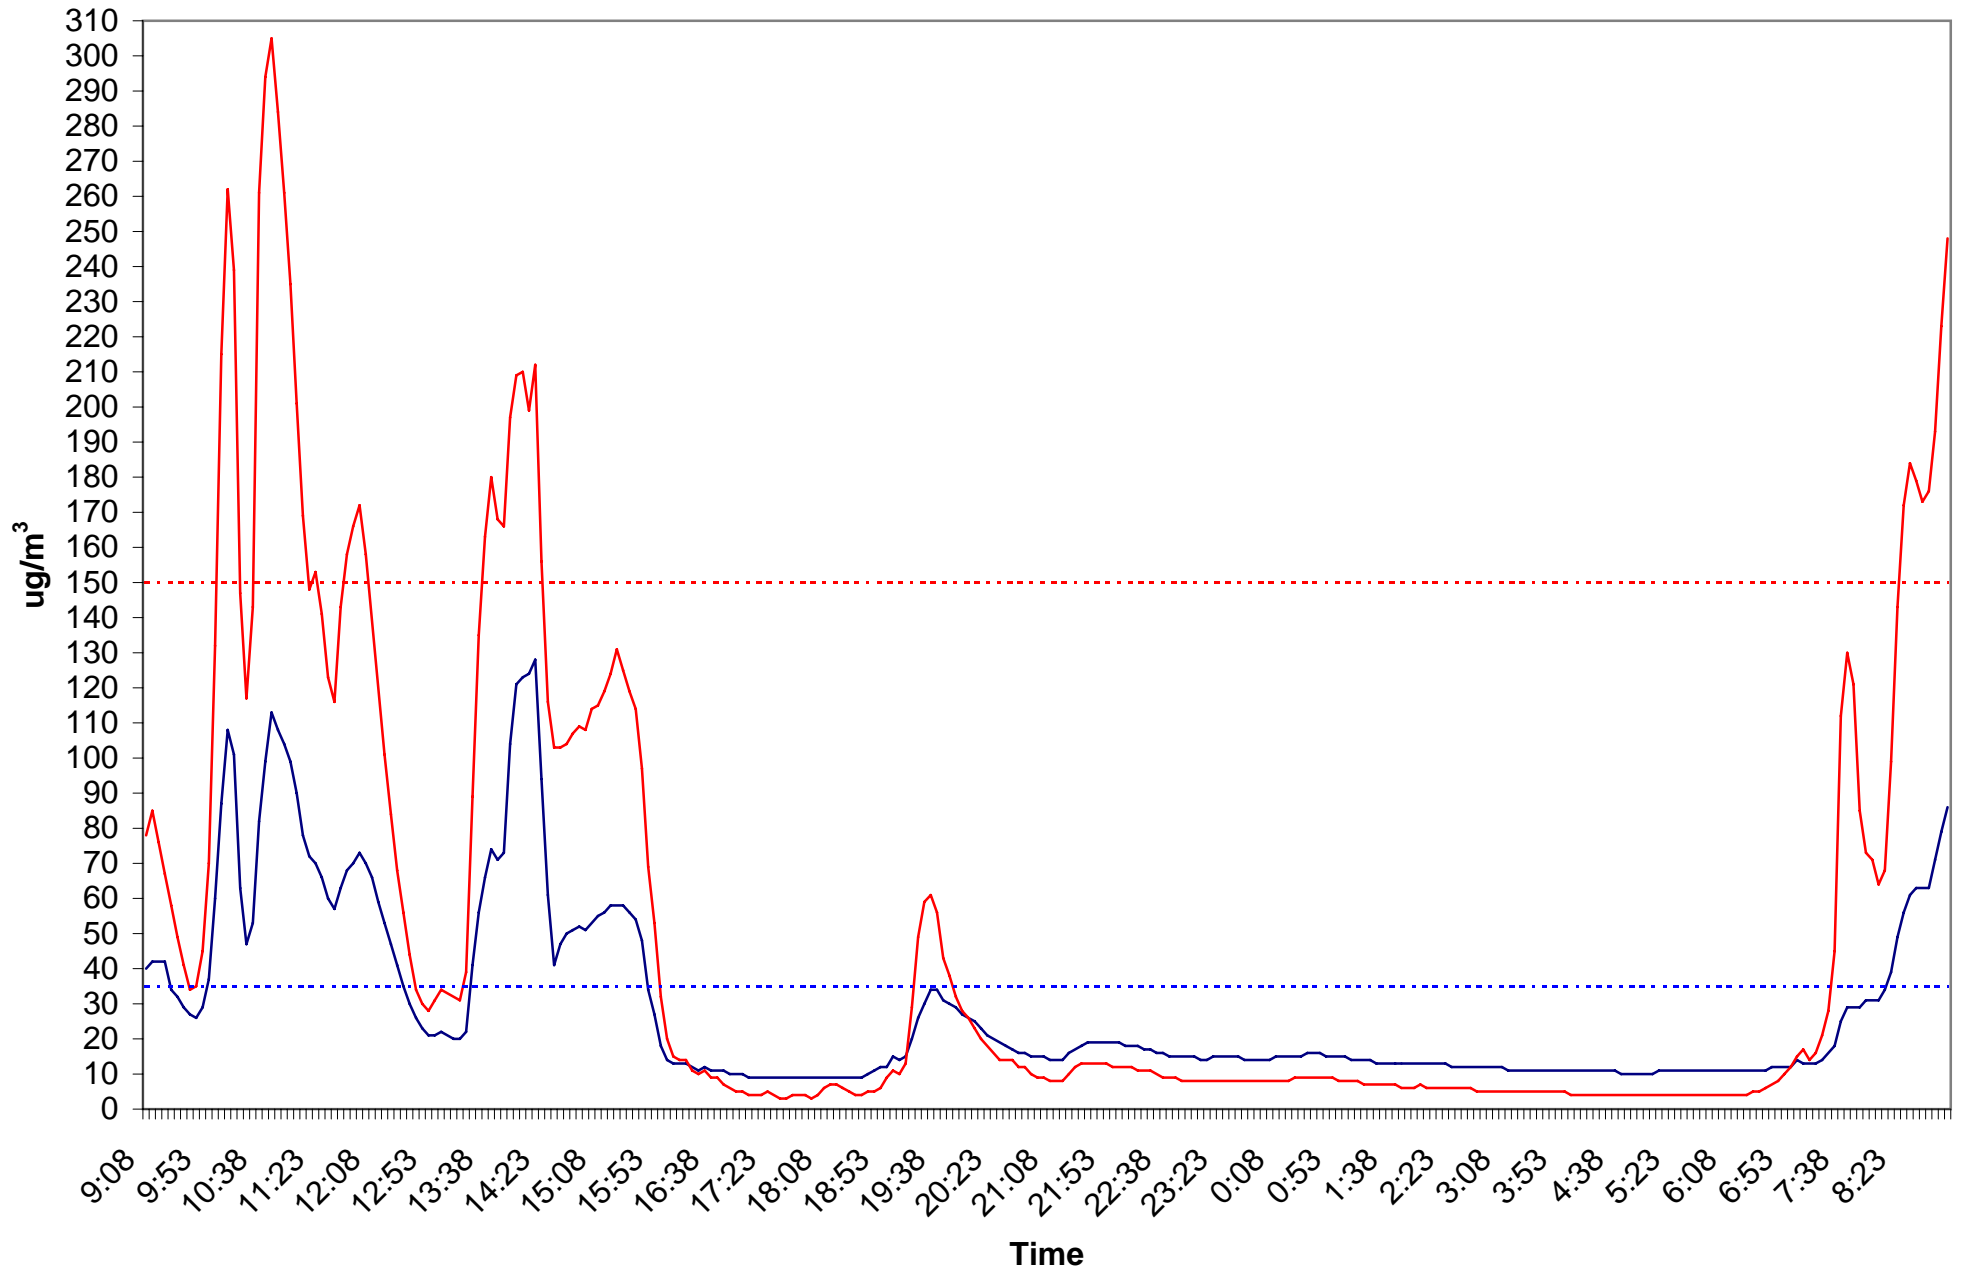

Site-17 Hall by Room 216

12/09-10/2010
AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

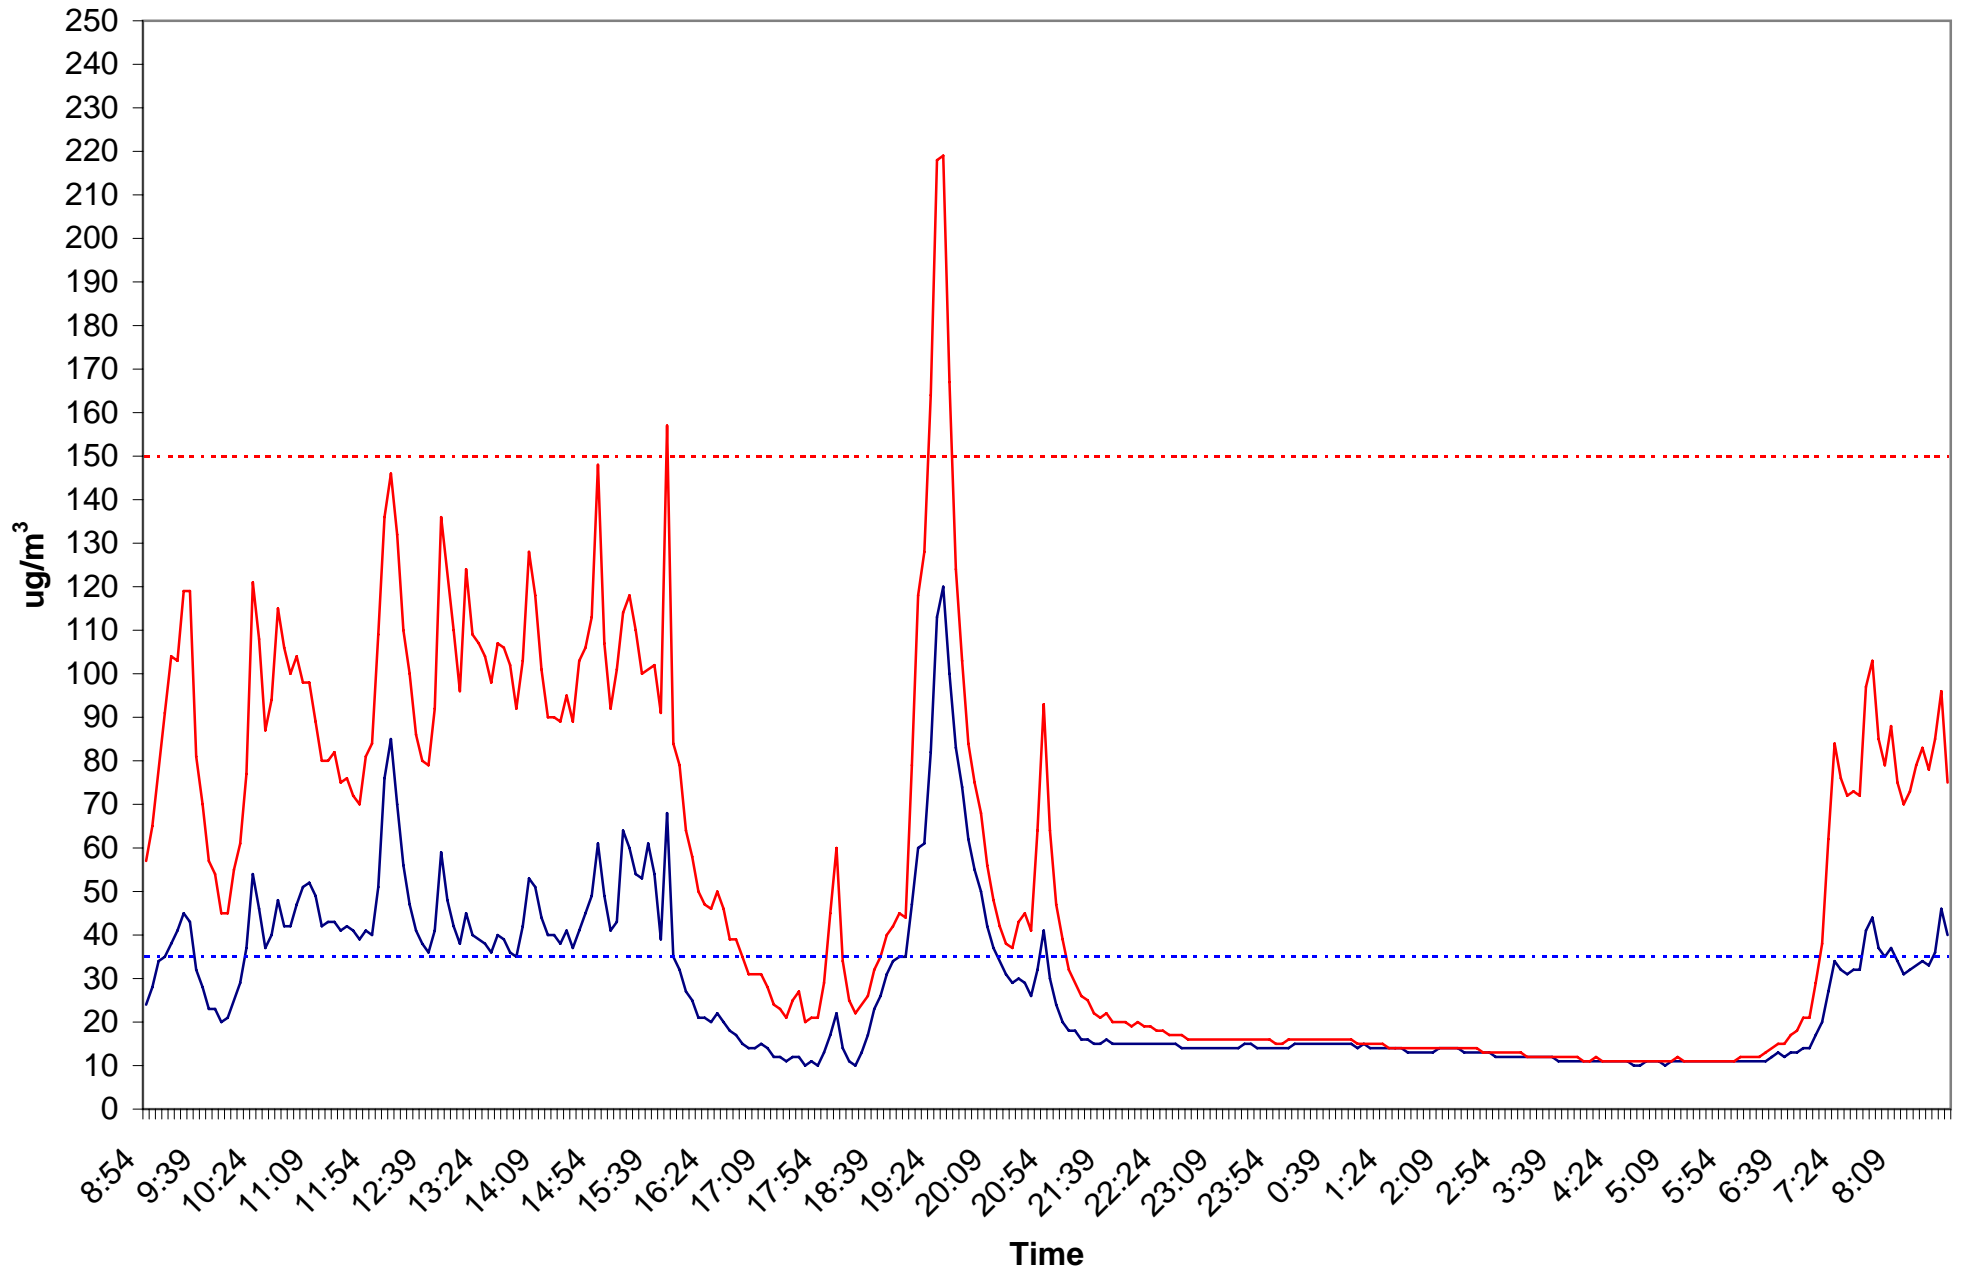


Site-18 Hall by Room 6

12/09-10/2010

AQM# 10-510

— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

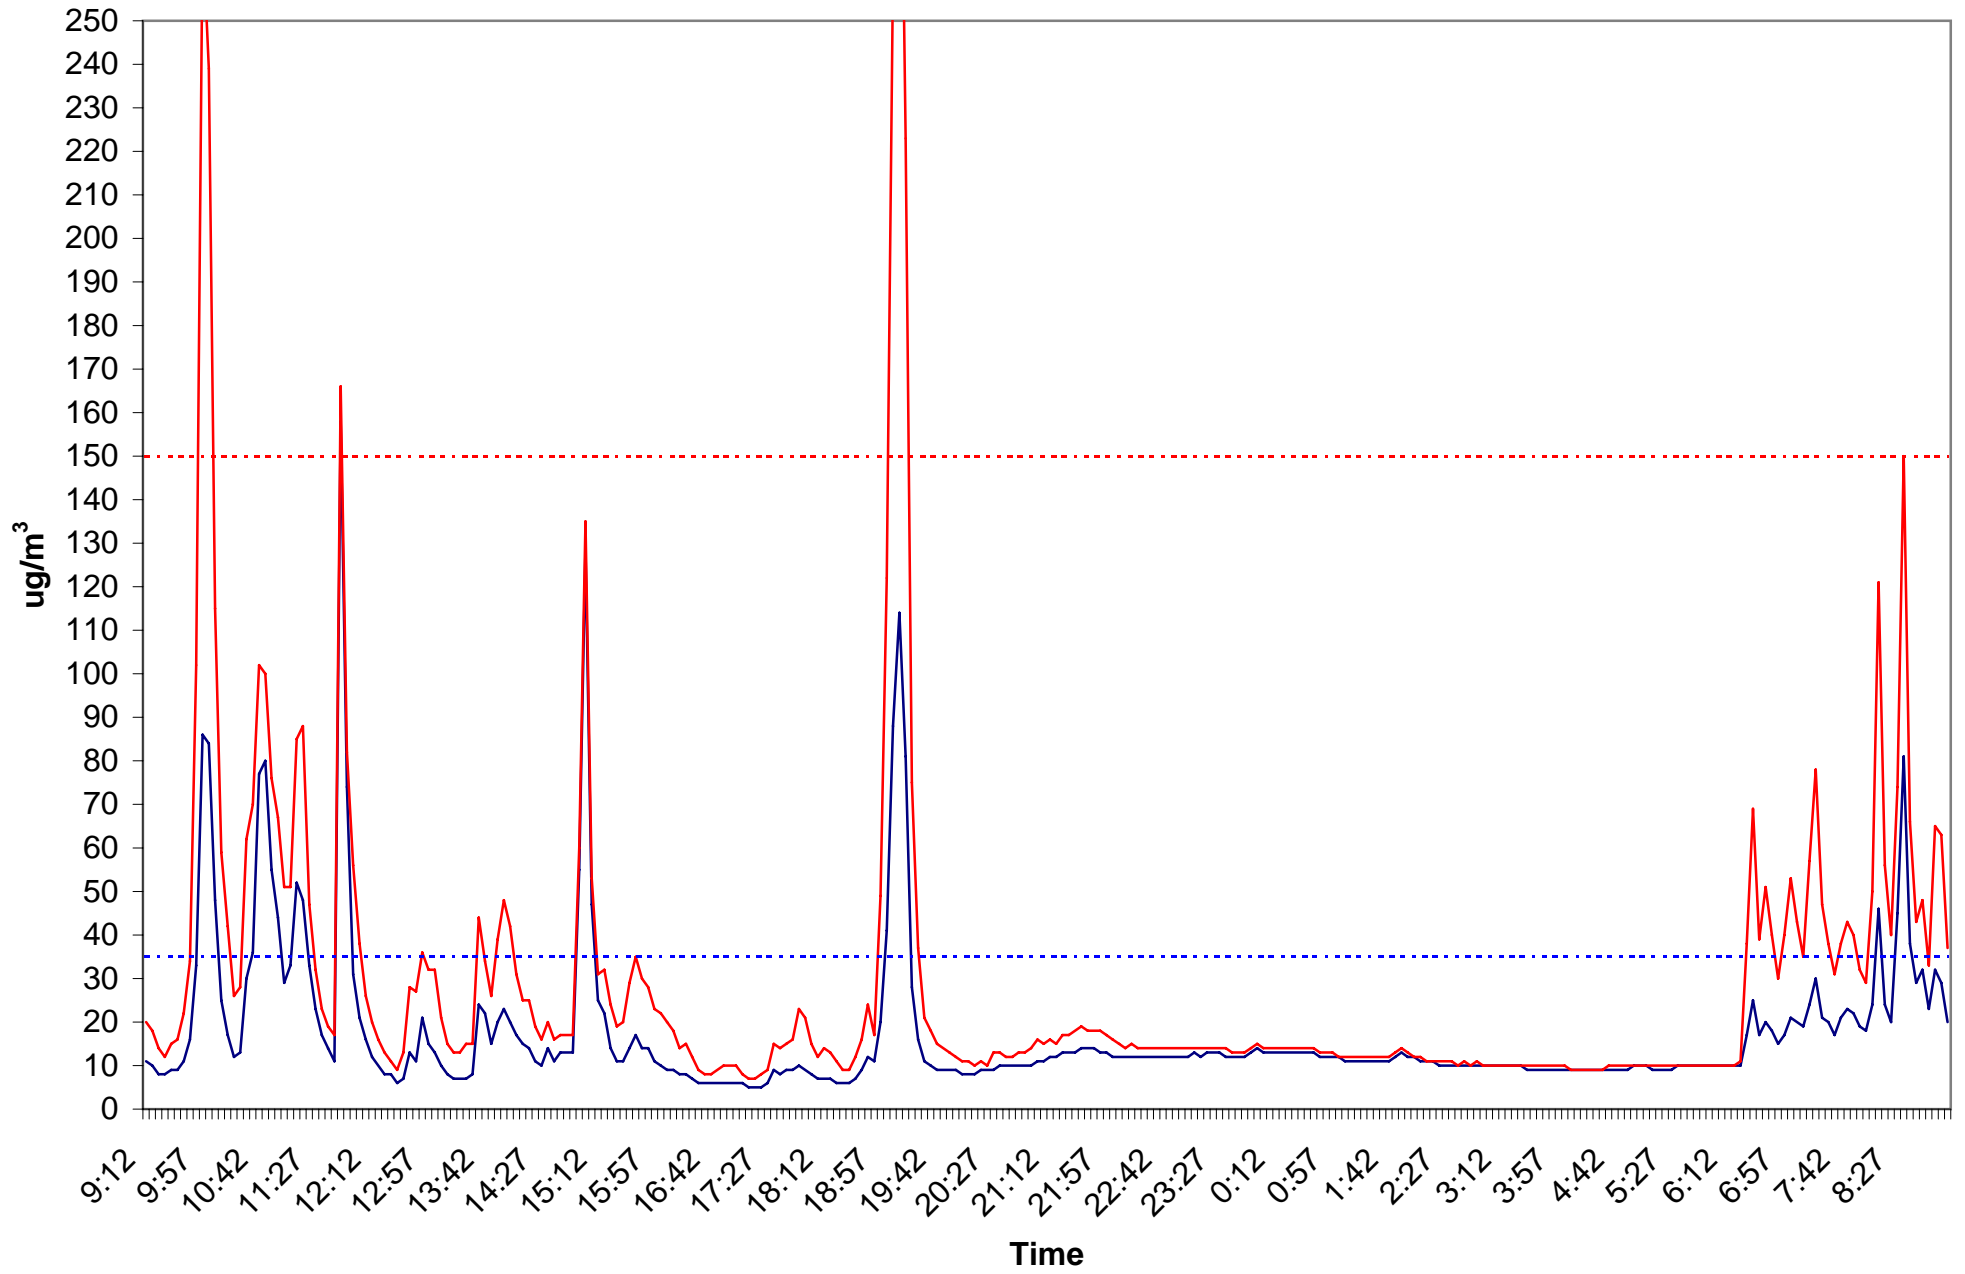


Site-18 Hall by Room 6

12/09-10/2010

AQM# 10-510


— PM2.5 — PM10 - - - EPA PM2.5 Limit - - - EPA PM10 Limit

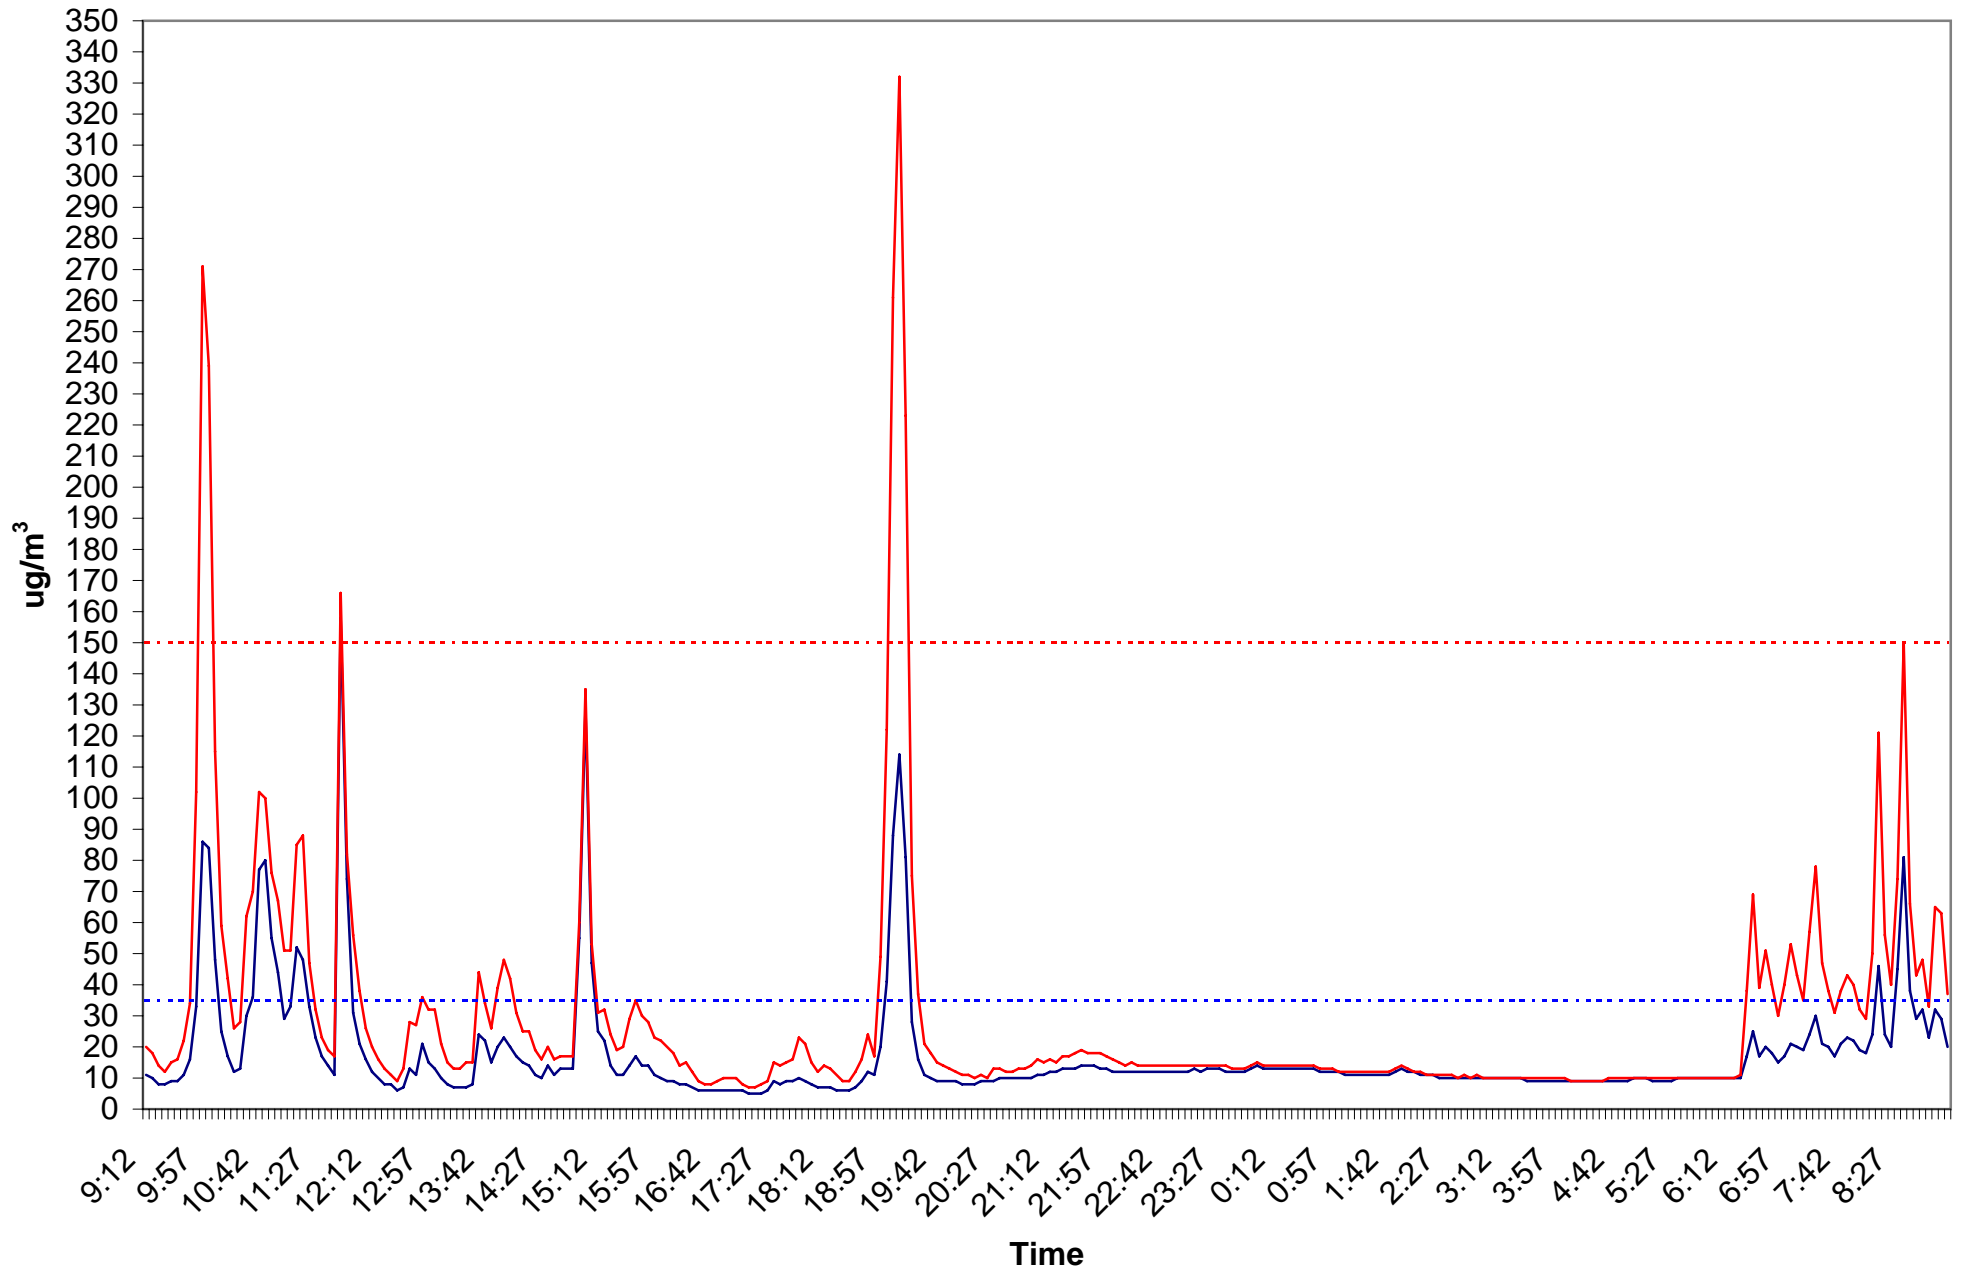

Site-6 Room 105 CO₂ Data


12/09-10/2010

AQM# 10-510

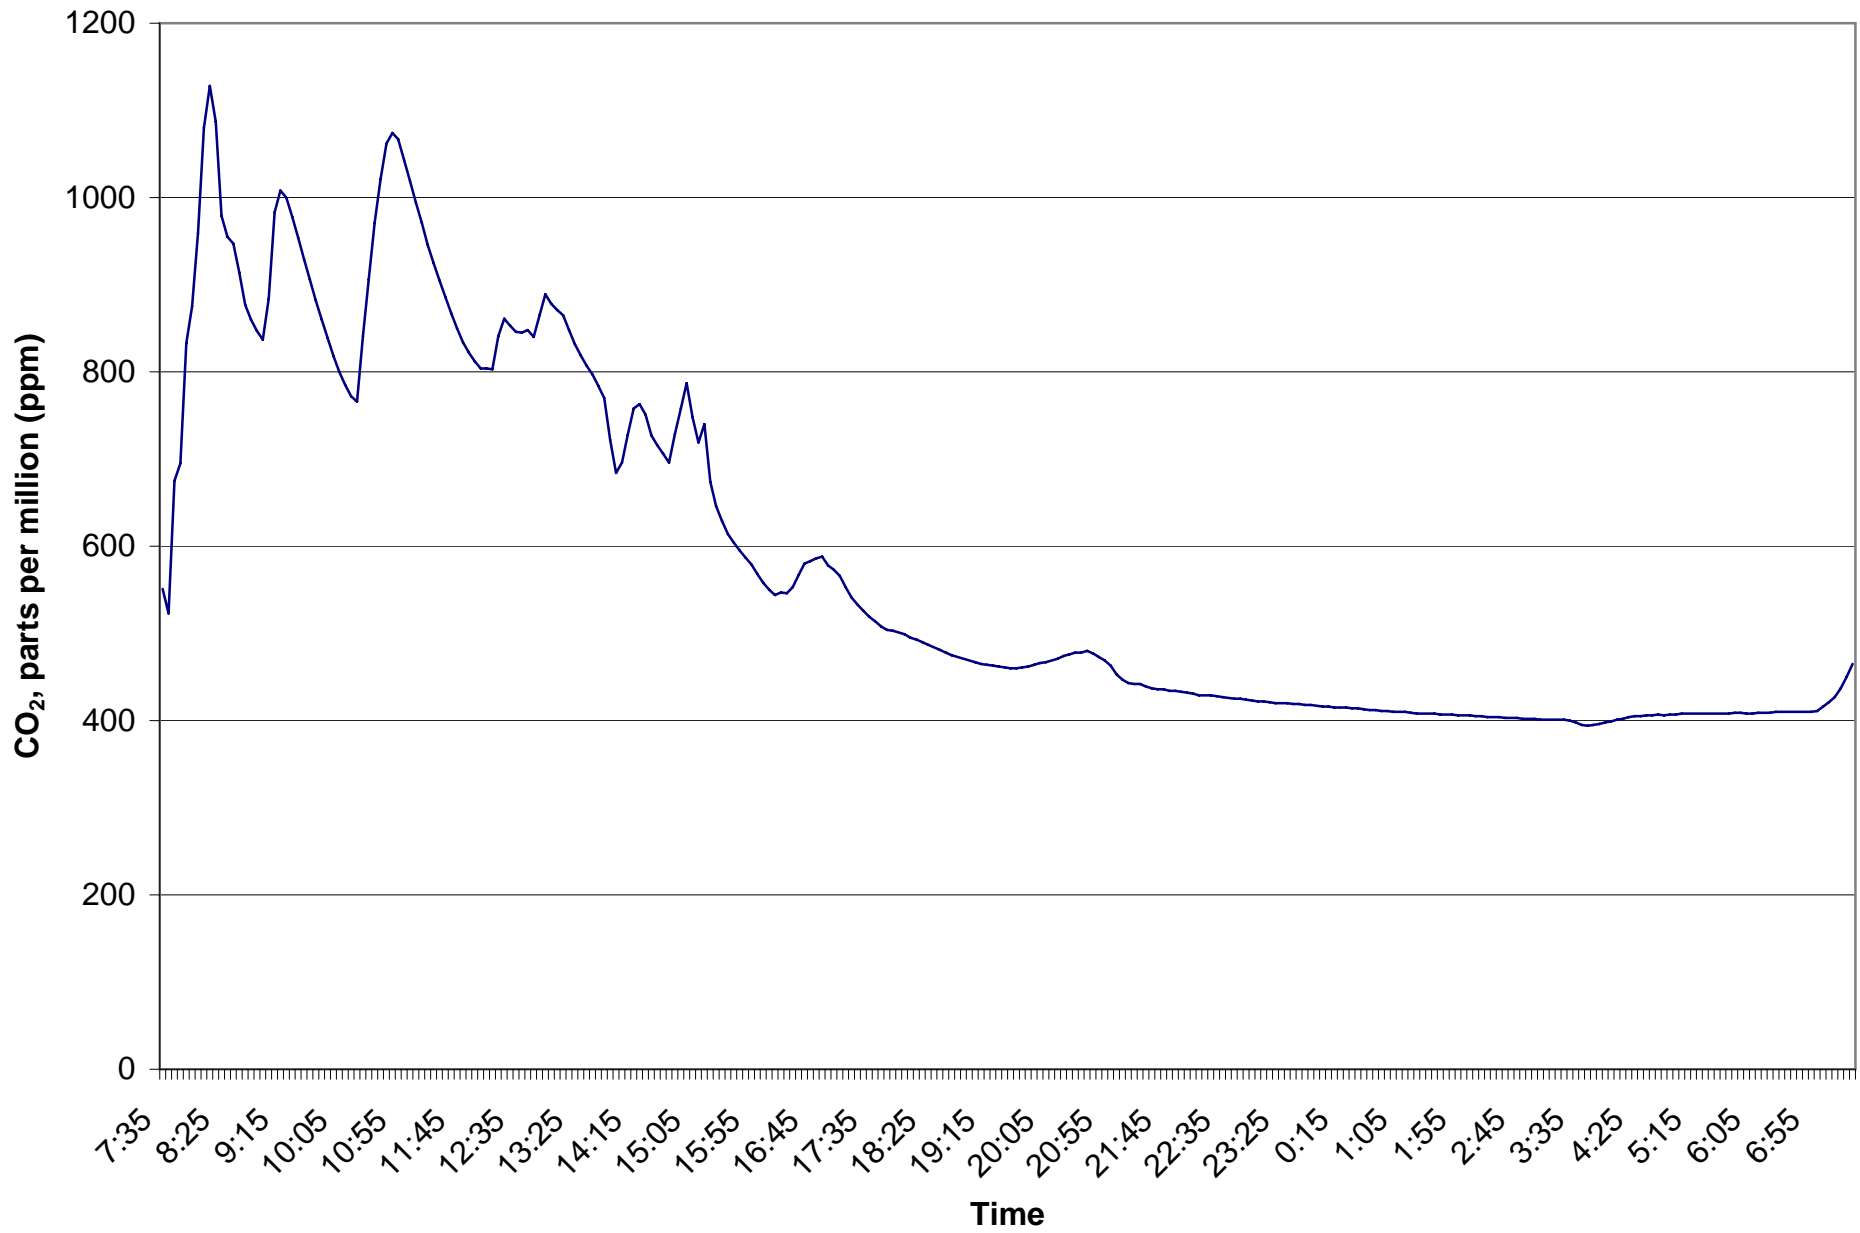


Site-7 Room 107 CO₂ Data

12/09-10/2010
AQM# 10-510

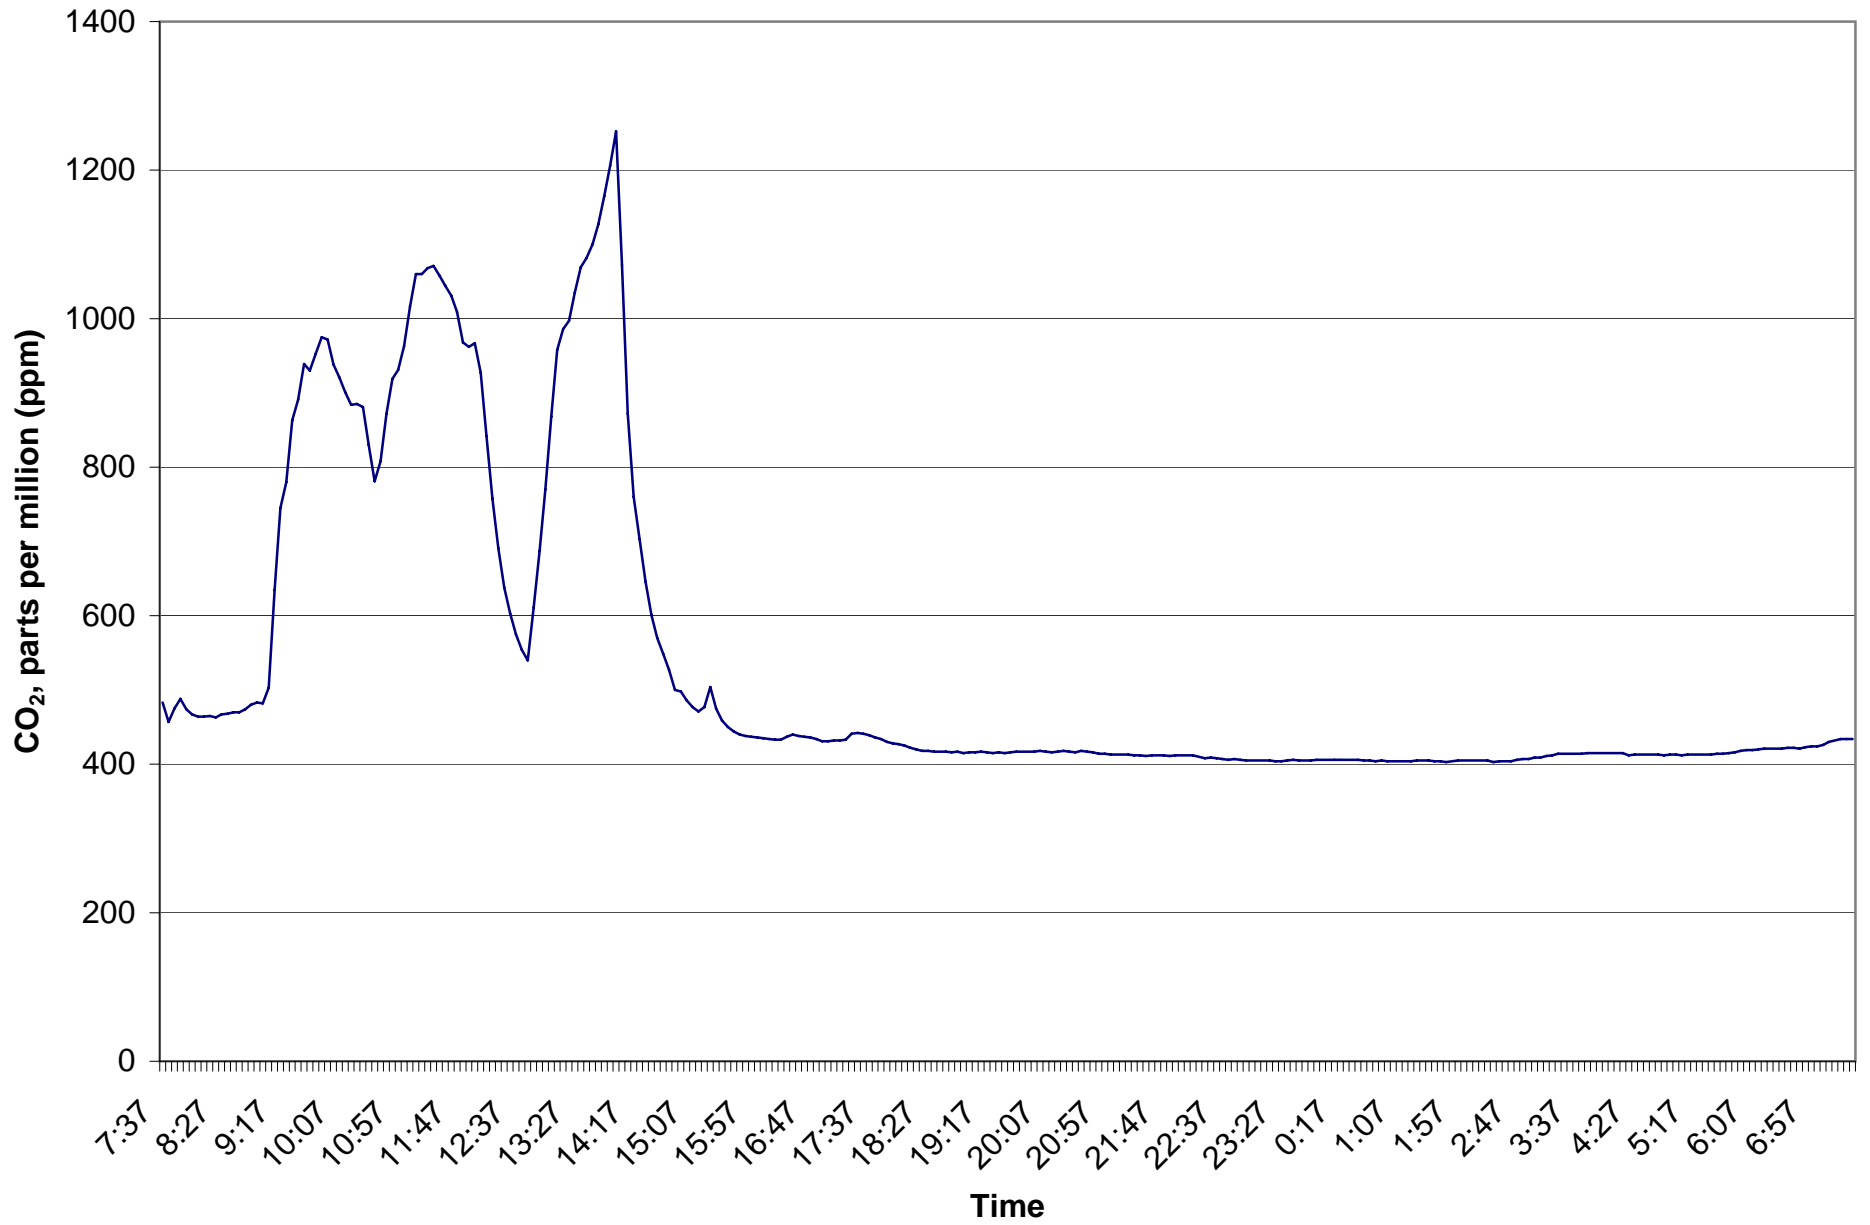


Site-11 Room 4 CO₂ Data

12/09-10/2010
AQM# 10-510

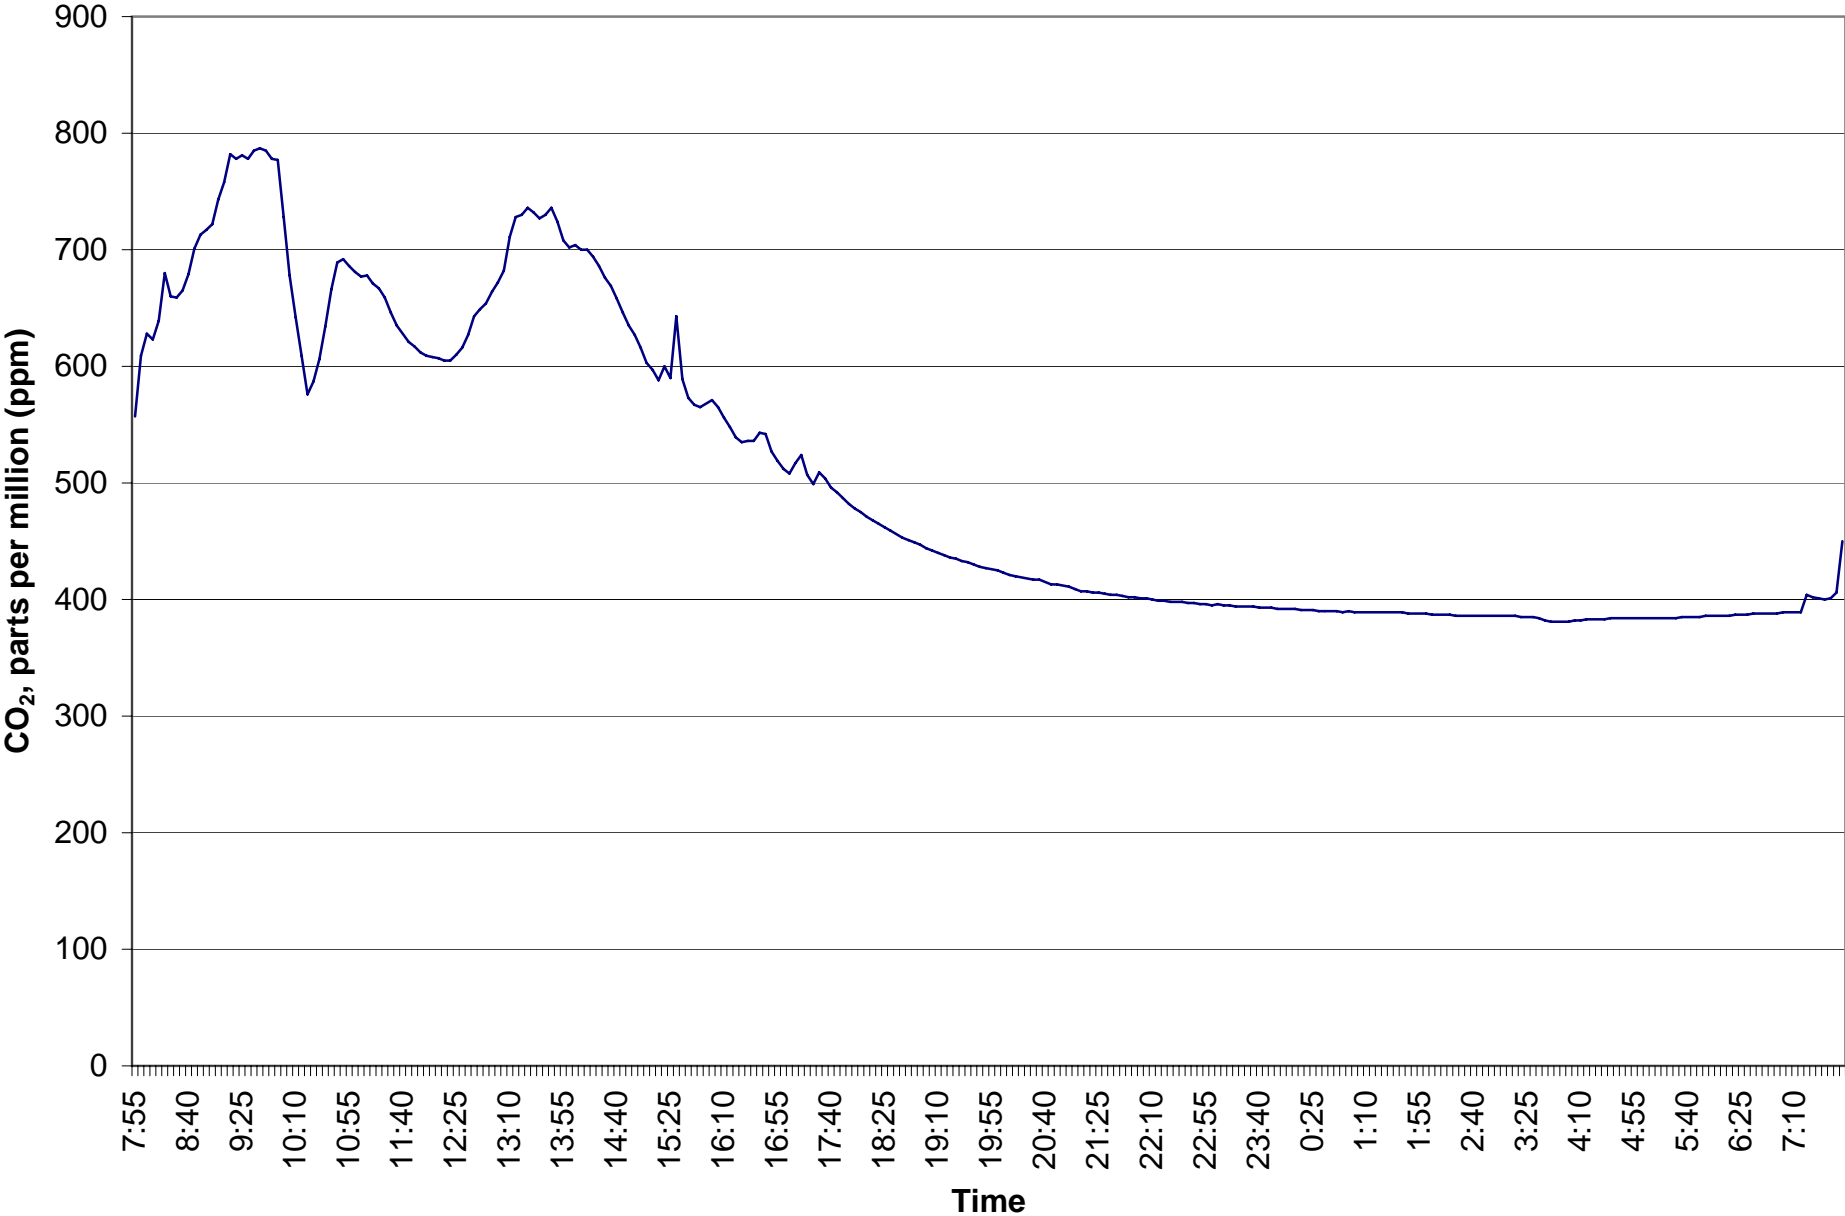


Site-13 Room 203 CO₂ Data

12/09-10/2010
AQ# 10-510

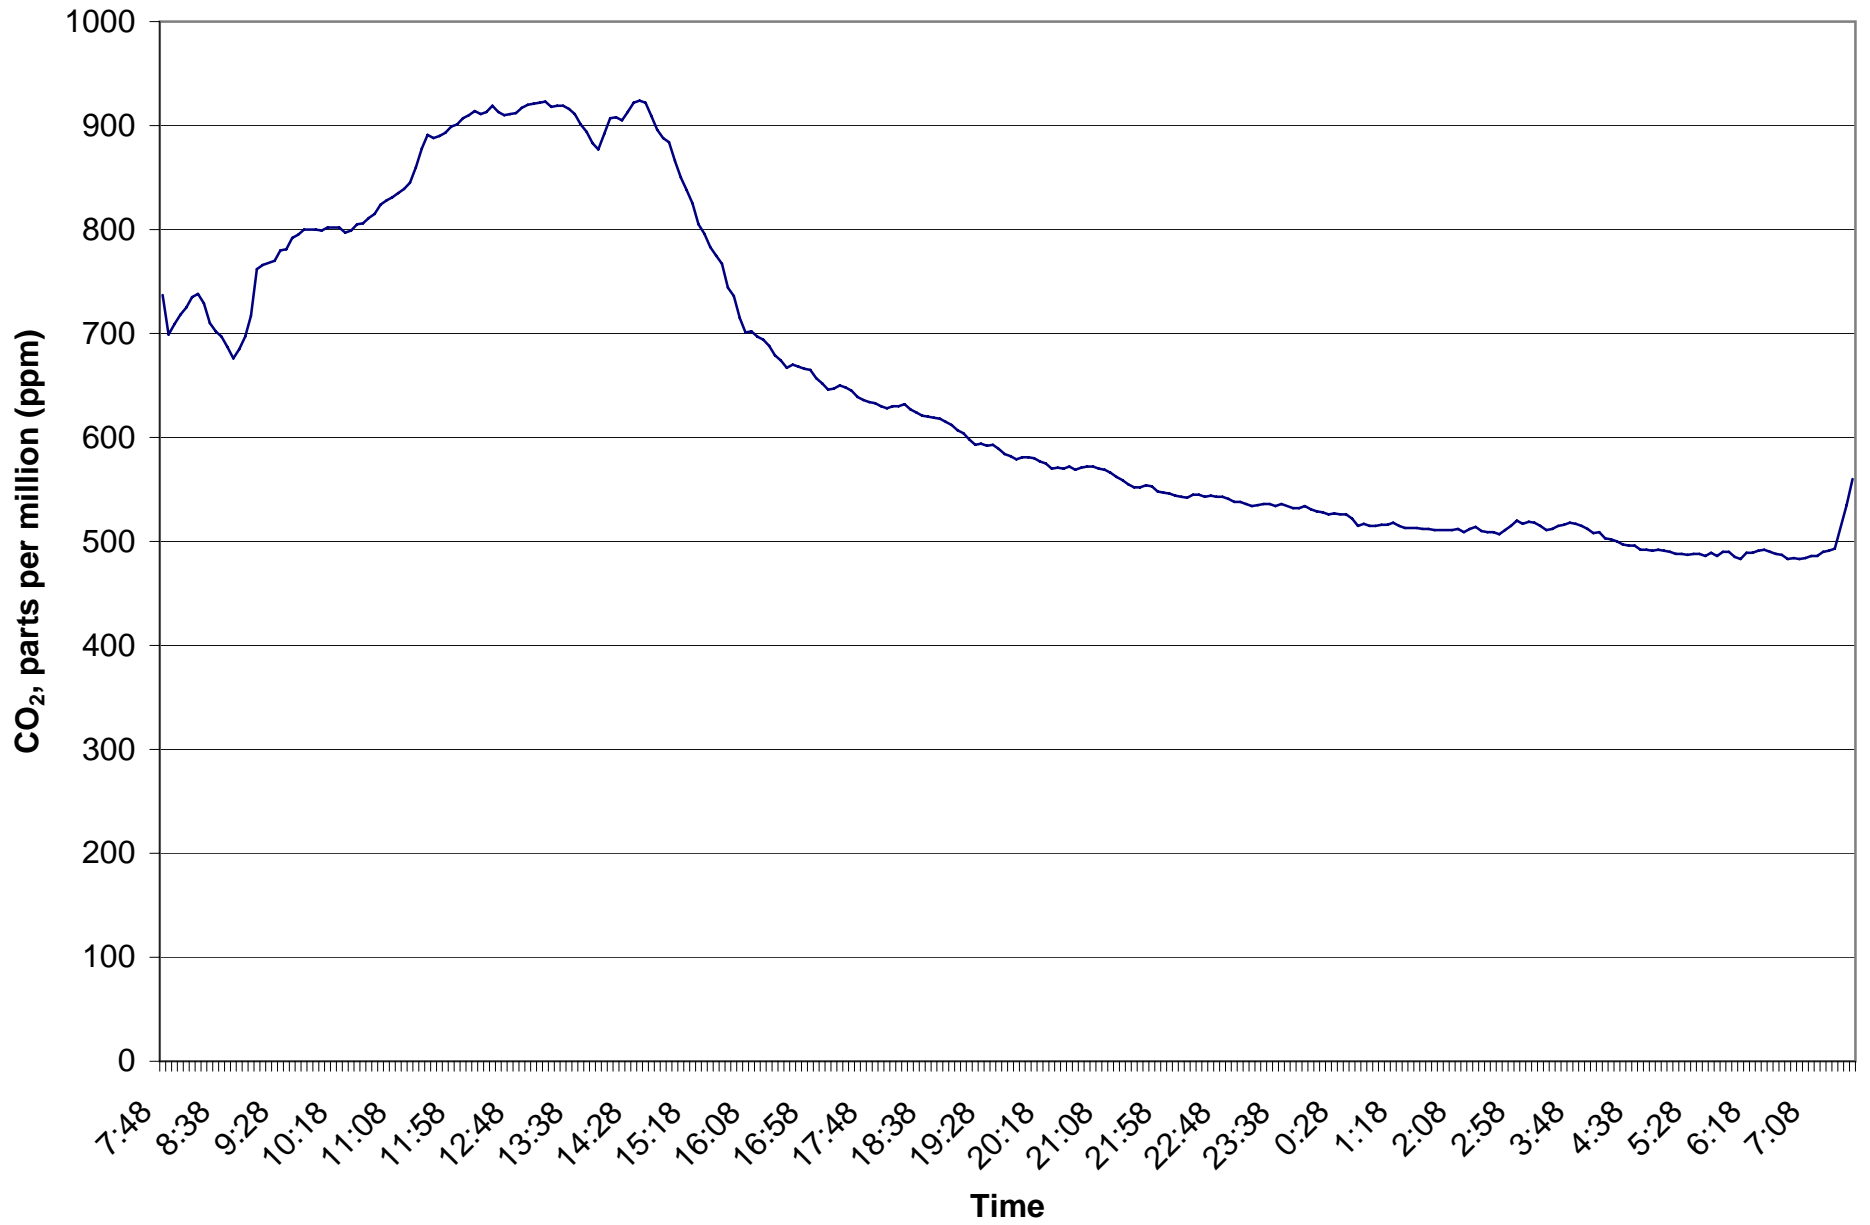

Site-15 Room 215 CO₂ Data

12/09-10/2010
AQM# 10-510

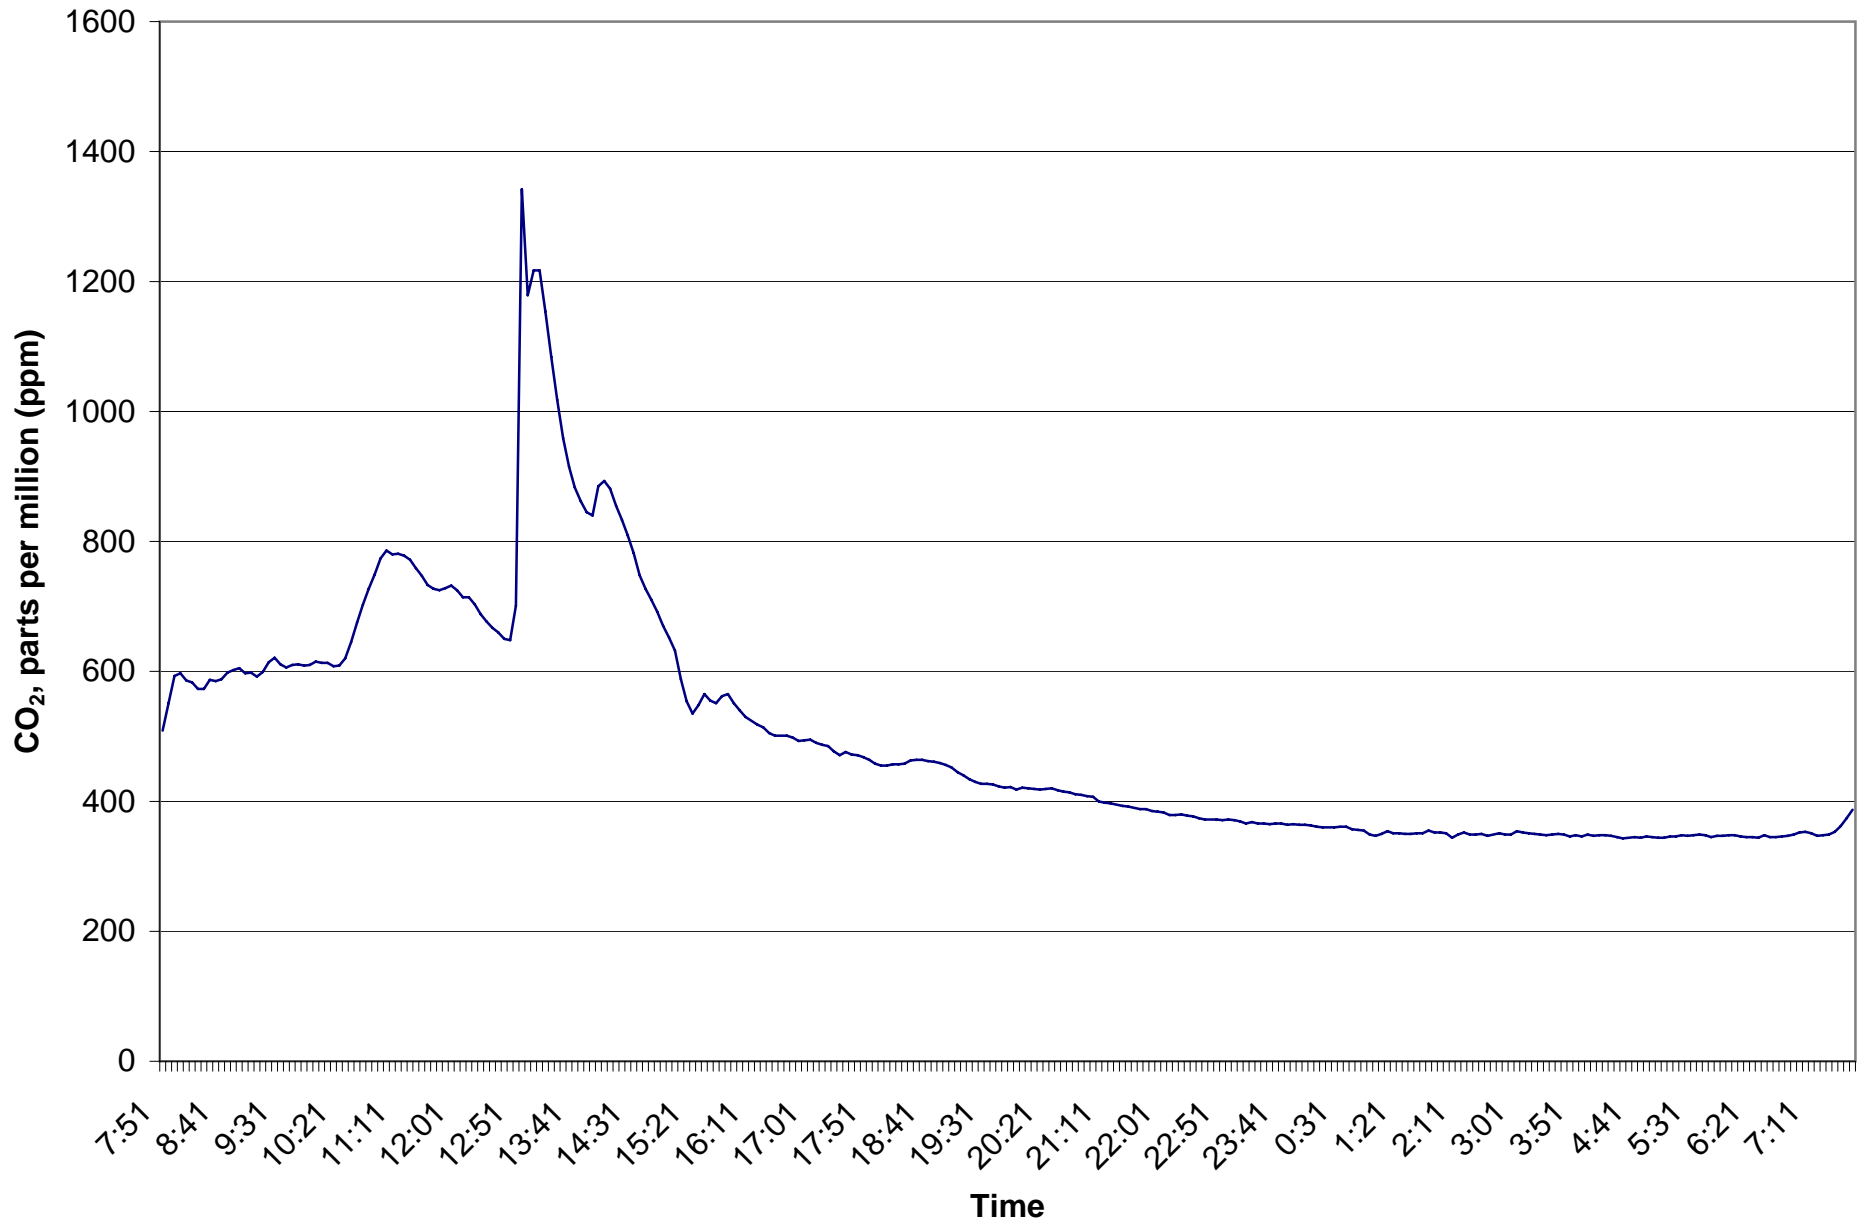

Instrument Data			Site-1			Hall by Speech Room 12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
7:36	0.044	0.079	11:51	0.045	0.08	16:06	0.023	0.039			
7:41	0.05	0.088	11:56	0.056	0.101	16:11	0.022	0.035			
7:46	0.048	0.084	12:01	0.065	0.114	16:16	0.02	0.033			
7:51	0.043	0.072	12:06	0.065	0.116	16:21	0.02	0.033			
7:56	0.038	0.063	12:11	0.054	0.098	16:26	0.023	0.038			
8:01	0.035	0.057	12:16	0.047	0.084	16:31	0.021	0.037			
8:06	0.033	0.053	12:21	0.041	0.073	16:36	0.023	0.041			
8:11	0.03	0.048	12:26	0.038	0.066	16:41	0.021	0.036			
8:16	0.028	0.045	12:31	0.037	0.064	16:46	0.021	0.037			
8:21	0.027	0.042	12:36	0.035	0.06	16:51	0.019	0.034			
8:26	0.026	0.041	12:41	0.036	0.062	16:56	0.017	0.03			
8:31	0.028	0.047	12:46	0.045	0.081	17:01	0.016	0.027			
8:36	0.029	0.051	12:51	0.04	0.073	17:06	0.015	0.024			
8:41	0.03	0.051	12:56	0.035	0.065	17:11	0.012	0.019			
8:46	0.031	0.054	13:01	0.033	0.061	17:16	0.012	0.02			
8:51	0.03	0.051	13:06	0.032	0.059	17:21	0.01	0.017			
8:56	0.033	0.057	13:11	0.033	0.06	17:26	0.01	0.017			
9:01	0.047	0.085	13:16	0.037	0.068	17:31	0.01	0.017			
9:06	0.044	0.082	13:21	0.039	0.072	17:36	0.011	0.016			
9:11	0.042	0.078	13:26	0.039	0.07	17:41	0.01	0.016			
9:16	0.04	0.074	13:31	0.04	0.075	17:46	0.021	0.042			
9:21	0.038	0.07	13:36	0.038	0.071	17:51	0.012	0.022			
9:26	0.04	0.071	13:41	0.036	0.067	17:56	0.011	0.018			
9:31	0.039	0.07	13:46	0.045	0.086	18:01	0.009	0.014			
9:36	0.04	0.072	13:51	0.041	0.077	18:06	0.01	0.015			
9:41	0.037	0.065	13:56	0.051	0.095	18:11	0.01	0.016			
9:46	0.034	0.059	14:01	0.051	0.098	18:16	0.018	0.026			
9:51	0.032	0.056	14:06	0.039	0.076	18:21	0.031	0.037			
9:56	0.032	0.057	14:11	0.038	0.072	18:26	0.055	0.062			
10:01	0.034	0.058	14:16	0.032	0.059	18:31	0.078	0.087			
10:06	0.034	0.059	14:21	0.033	0.065	18:36	0.072	0.08			
10:11	0.032	0.054	14:26	0.038	0.073	18:41	0.079	0.087			
10:16	0.037	0.063	14:31	0.041	0.082	18:46	0.079	0.088			
10:21	0.037	0.065	14:36	0.044	0.086	18:51	0.081	0.088			
10:26	0.038	0.066	14:41	0.042	0.081	18:56	0.073	0.079			
10:31	0.038	0.066	14:46	0.036	0.07	19:01	0.067	0.074			
10:36	0.047	0.083	14:51	0.033	0.06	19:06	0.139	0.237			
10:41	0.044	0.079	14:56	0.031	0.056	19:11	0.164	0.231			
10:46	0.04	0.072	15:01	0.03	0.052	19:16	0.187	0.236			
10:51	0.04	0.071	15:06	0.031	0.055	19:21	0.205	0.235			
10:56	0.038	0.069	15:11	0.037	0.067	19:26	0.193	0.212			
11:01	0.04	0.072	15:16	0.038	0.07	19:31	0.164	0.178			
11:06	0.043	0.079	15:21	0.037	0.068	19:36	0.132	0.144			
11:11	0.054	0.101	15:26	0.035	0.061	19:41	0.095	0.105			
11:16	0.059	0.107	15:31	0.038	0.067	19:46	0.085	0.096			
11:21	0.052	0.096	15:36	0.038	0.069	19:51	0.071	0.082			
11:26	0.048	0.087	15:41	0.032	0.058	19:56	0.059	0.066			
11:31	0.048	0.087	15:46	0.027	0.048	20:01	0.05	0.055			
11:36	0.048	0.084	15:51	0.027	0.047	20:06	0.044	0.049			
11:41	0.042	0.075	15:56	0.026	0.045	20:11	0.04	0.043			
11:46	0.042	0.074	16:01	0.023	0.041	20:16	0.035	0.038			

Instrument Data			Site-2 Hall by Cafeteria Entry 12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:38	0.058	0.18	11:53	0.039	0.114	16:08	0.021	0.053
7:43	0.052	0.162	11:58	0.038	0.112	16:13	0.02	0.048
7:48	0.045	0.134	12:03	0.04	0.115	16:18	0.019	0.044
7:53	0.04	0.114	12:08	0.039	0.113	16:23	0.018	0.04
7:58	0.038	0.105	12:13	0.035	0.1	16:28	0.017	0.036
8:03	0.036	0.096	12:18	0.033	0.094	16:33	0.016	0.033
8:08	0.035	0.092	12:23	0.032	0.088	16:38	0.016	0.031
8:13	0.033	0.086	12:28	0.033	0.095	16:43	0.015	0.028
8:18	0.033	0.086	12:33	0.03	0.082	16:48	0.014	0.026
8:23	0.032	0.082	12:38	0.031	0.08	16:53	0.014	0.025
8:28	0.032	0.082	12:43	0.028	0.074	16:58	0.014	0.024
8:33	0.031	0.079	12:48	0.029	0.079	17:03	0.013	0.021
8:38	0.032	0.083	12:53	0.029	0.085	17:08	0.013	0.021
8:43	0.035	0.093	12:58	0.028	0.079	17:13	0.013	0.022
8:48	0.049	0.148	13:03	0.028	0.081	17:18	0.012	0.019
8:53	0.045	0.138	13:08	0.032	0.093	17:23	0.012	0.017
8:58	0.037	0.11	13:13	0.036	0.109	17:28	0.011	0.017
9:03	0.04	0.119	13:18	0.041	0.125	17:33	0.011	0.016
9:08	0.037	0.102	13:23	0.039	0.12	17:38	0.011	0.017
9:13	0.035	0.097	13:28	0.039	0.12	17:43	0.011	0.016
9:18	0.034	0.088	13:33	0.039	0.122	17:48	0.011	0.015
9:23	0.032	0.08	13:38	0.042	0.131	17:53	0.011	0.015
9:28	0.028	0.069	13:43	0.048	0.153	17:58	0.011	0.015
9:33	0.026	0.061	13:48	0.045	0.145	18:03	0.011	0.015
9:38	0.025	0.059	13:53	0.04	0.125	18:08	0.013	0.017
9:43	0.029	0.064	13:58	0.035	0.105	18:13	0.034	0.039
9:48	0.031	0.068	14:03	0.039	0.123	18:18	0.074	0.079
9:53	0.032	0.073	14:08	0.037	0.112	18:23	0.101	0.106
9:58	0.037	0.089	14:13	0.04	0.123	18:28	0.115	0.12
10:03	0.043	0.118	14:18	0.038	0.116	18:33	0.109	0.113
10:08	0.069	0.213	14:23	0.047	0.148	18:38	0.11	0.114
10:13	0.069	0.225	14:28	0.039	0.117	18:43	0.103	0.107
10:18	0.059	0.189	14:33	0.037	0.108	18:48	0.096	0.1
10:23	0.059	0.183	14:38	0.036	0.108	18:53	0.09	0.095
10:28	0.057	0.178	14:43	0.03	0.082	18:58	0.084	0.089
10:33	0.045	0.126	14:48	0.029	0.077	19:03	0.079	0.083
10:38	0.05	0.149	14:53	0.028	0.074	19:08	0.076	0.08
10:43	0.055	0.171	14:58	0.027	0.07	19:13	0.073	0.077
10:48	0.052	0.166	15:03	0.027	0.071	19:18	0.069	0.073
10:53	0.054	0.175	15:08	0.028	0.075	19:23	0.067	0.07
10:58	0.05	0.159	15:13	0.026	0.069	19:28	0.064	0.068
11:03	0.045	0.138	15:18	0.027	0.077	19:33	0.062	0.066
11:08	0.043	0.122	15:23	0.033	0.098	19:38	0.06	0.064
11:13	0.038	0.105	15:28	0.033	0.099	19:43	0.057	0.061
11:18	0.04	0.116	15:33	0.034	0.107	19:48	0.054	0.058
11:23	0.039	0.113	15:38	0.031	0.093	19:53	0.051	0.055
11:28	0.038	0.113	15:43	0.029	0.089	19:58	0.049	0.052
11:33	0.037	0.106	15:48	0.027	0.078	20:03	0.047	0.05
11:38	0.035	0.102	15:53	0.025	0.067	20:08	0.044	0.048
11:43	0.037	0.109	15:58	0.024	0.062	20:13	0.042	0.045
11:48	0.038	0.113	16:03	0.022	0.057	20:18	0.04	0.042

Instrument Data			Site-2 Hall by Cafeteria Entry 12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:23	0.038	0.04	0:38	0.021	0.022	4:53	0.013	0.013
20:28	0.03	0.036	0:43	0.02	0.022	4:58	0.013	0.014
20:33	0.032	0.062	0:48	0.02	0.021	5:03	0.013	0.014
20:38	0.036	0.077	0:53	0.019	0.02	5:08	0.013	0.014
20:43	0.029	0.055	0:58	0.019	0.02	5:13	0.013	0.013
20:48	0.026	0.043	1:03	0.018	0.019	5:18	0.013	0.013
20:53	0.025	0.041	1:08	0.018	0.02	5:23	0.013	0.013
20:58	0.025	0.037	1:13	0.018	0.019	5:28	0.013	0.013
21:03	0.022	0.033	1:18	0.018	0.019	5:33	0.013	0.014
21:08	0.023	0.032	1:23	0.018	0.019	5:38	0.013	0.014
21:13	0.023	0.03	1:28	0.017	0.018	5:43	0.015	0.021
21:18	0.03	0.035	1:33	0.017	0.018	5:48	0.014	0.018
21:23	0.027	0.033	1:38	0.017	0.018	5:53	0.013	0.015
21:28	0.027	0.033	1:43	0.017	0.018	5:58	0.014	0.015
21:33	0.026	0.032	1:48	0.017	0.018	6:03	0.014	0.015
21:38	0.029	0.035	1:53	0.017	0.017	6:08	0.013	0.015
21:43	0.029	0.037	1:58	0.016	0.017	6:13	0.013	0.015
21:48	0.029	0.036	2:03	0.016	0.017	6:18	0.014	0.016
21:53	0.03	0.036	2:08	0.016	0.017	6:23	0.015	0.02
21:58	0.03	0.036	2:13	0.016	0.017	6:28	0.017	0.032
22:03	0.029	0.035	2:18	0.016	0.017	6:33	0.018	0.038
22:08	0.029	0.035	2:23	0.016	0.017	6:38	0.018	0.036
22:13	0.027	0.033	2:28	0.016	0.016	6:43	0.019	0.039
22:18	0.028	0.034	2:33	0.015	0.016	6:48	0.019	0.041
22:23	0.028	0.034	2:38	0.015	0.016	6:53	0.019	0.039
22:28	0.027	0.033	2:43	0.015	0.016	6:58	0.022	0.049
22:33	0.026	0.031	2:48	0.015	0.016	7:03	0.023	0.056
22:38	0.026	0.031	2:53	0.015	0.016	7:08	0.025	0.06
22:43	0.025	0.029	2:58	0.015	0.015	7:13	0.025	0.058
22:48	0.026	0.031	3:03	0.015	0.015	7:18	0.025	0.061
22:53	0.026	0.03	3:08	0.014	0.015	7:23	0.027	0.069
22:58	0.025	0.029	3:13	0.014	0.015	7:28	0.027	0.069
23:03	0.025	0.029	3:18	0.014	0.015	7:33	0.029	0.073
23:08	0.025	0.028	3:23	0.014	0.015			
23:13	0.024	0.028	3:28	0.014	0.015			
23:18	0.023	0.027	3:33	0.014	0.015			
23:23	0.024	0.027	3:38	0.014	0.014			
23:28	0.022	0.026	3:43	0.014	0.014			
23:33	0.023	0.025	3:48	0.014	0.014			
23:38	0.022	0.024	3:53	0.014	0.014			
23:43	0.022	0.024	3:58	0.013	0.014			
23:48	0.021	0.023	4:03	0.013	0.014			
23:53	0.021	0.024	4:08	0.013	0.014			
23:58	0.022	0.024	4:13	0.013	0.014			
0:03	0.022	0.024	4:18	0.013	0.014			
0:08	0.022	0.024	4:23	0.013	0.014			
0:13	0.022	0.023	4:28	0.013	0.014			
0:18	0.021	0.022	4:33	0.013	0.014			
0:23	0.021	0.022	4:38	0.013	0.013			
0:28	0.021	0.023	4:43	0.013	0.014			
0:33	0.021	0.022	4:48	0.013	0.014			

Instrument Data			Site-3 Hall by Girls' Gym			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:40	0.092	0.183	11:55	0.043	0.094	16:10	0.009	0.015
7:45	0.026	0.052	12:00	0.045	0.096	16:15	0.008	0.015
7:50	0.022	0.042	12:05	0.043	0.088	16:20	0.008	0.014
7:55	0.023	0.042	12:10	0.036	0.077	16:25	0.008	0.014
8:00	0.024	0.048	12:15	0.029	0.06	16:30	0.008	0.013
8:05	0.02	0.039	12:20	0.03	0.059	16:35	0.011	0.015
8:10	0.021	0.041	12:25	0.028	0.054	16:40	0.008	0.013
8:15	0.022	0.044	12:30	0.026	0.051	16:45	0.007	0.011
8:20	0.023	0.045	12:35	0.03	0.062	16:50	0.007	0.012
8:25	0.021	0.039	12:40	0.039	0.078	16:55	0.009	0.014
8:30	0.018	0.034	12:45	0.048	0.102	17:00	0.008	0.011
8:35	0.018	0.035	12:50	0.046	0.1	17:05	0.008	0.011
8:40	0.019	0.036	12:55	0.039	0.084	17:10	0.019	0.033
8:45	0.016	0.031	13:00	0.039	0.085	17:15	0.018	0.038
8:50	0.017	0.033	13:05	0.042	0.096	17:20	0.012	0.027
8:55	0.017	0.031	13:10	0.063	0.147	17:25	0.012	0.022
9:00	0.017	0.033	13:15	0.064	0.146	17:30	0.11	0.245
9:05	0.018	0.034	13:20	0.051	0.116	17:35	0.072	0.176
9:10	0.022	0.046	13:25	0.044	0.097	17:40	0.017	0.037
9:15	0.032	0.065	13:30	0.04	0.087	17:45	0.01	0.02
9:20	0.025	0.051	13:35	0.034	0.074	17:50	0.273	0.608
9:25	0.027	0.053	13:40	0.033	0.071	17:55	0.053	0.129
9:30	0.028	0.06	13:45	0.028	0.061	18:00	0.02	0.046
9:35	0.029	0.061	13:50	0.026	0.055	18:05	0.015	0.031
9:40	0.028	0.058	13:55	0.023	0.052	18:10	0.013	0.026
9:45	0.03	0.062	14:00	0.022	0.049	18:15	0.02	0.037
9:50	0.033	0.071	14:05	0.019	0.039	18:20	0.014	0.025
9:55	0.038	0.085	14:10	0.023	0.049	18:25	0.012	0.021
10:00	0.034	0.073	14:15	0.024	0.051	18:30	0.012	0.02
10:05	0.03	0.061	14:20	0.523	1.03	18:35	0.012	0.019
10:10	0.023	0.046	14:25	0.366	0.744	18:40	0.013	0.02
10:15	0.021	0.043	14:30	0.085	0.206	18:45	0.012	0.019
10:20	0.029	0.059	14:35	0.058	0.142	18:50	0.013	0.019
10:25	0.03	0.059	14:40	0.042	0.1	18:55	0.013	0.019
10:30	0.022	0.043	14:45	0.031	0.073	19:00	0.015	0.023
10:35	0.021	0.044	14:50	0.026	0.059	19:05	0.014	0.02
10:40	0.026	0.054	14:55	0.022	0.047	19:10	0.02	0.03
10:45	0.022	0.043	15:00	0.021	0.044	19:15	0.018	0.027
10:50	0.028	0.054	15:05	0.019	0.041	19:20	0.022	0.033
10:55	0.04	0.081	15:10	0.019	0.039	19:25	0.02	0.03
11:00	0.048	0.103	15:15	0.017	0.037	19:30	0.021	0.03
11:05	0.034	0.069	15:20	0.017	0.035	19:35	0.019	0.027
11:10	0.035	0.071	15:25	0.022	0.049	19:40	0.021	0.033
11:15	0.031	0.062	15:30	0.025	0.055	19:45	0.014	0.023
11:20	0.027	0.055	15:35	0.028	0.061	19:50	0.01	0.015
11:25	0.025	0.051	15:40	0.016	0.034	19:55	0.008	0.013
11:30	0.027	0.055	15:45	0.013	0.026	20:00	0.008	0.012
11:35	0.029	0.058	15:50	0.011	0.022	20:05	0.008	0.01
11:40	0.048	0.105	15:55	0.01	0.019	20:10	0.007	0.009
11:45	0.052	0.111	16:00	0.009	0.017	20:15	0.007	0.009
11:50	0.047	0.101	16:05	0.009	0.017	20:20	0.007	0.009

Instrument Data			Site-3 Hall by Girls' Gym			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:25	0.007	0.008	0:40	0.014	0.014	4:55	0.008	0.008
20:30	0.008	0.01	0:45	0.014	0.014	5:00	0.007	0.008
20:35	0.037	0.063	0:50	0.013	0.014	5:05	0.007	0.007
20:40	0.009	0.013	0:55	0.013	0.014	5:10	0.008	0.008
20:45	0.007	0.009	1:00	0.012	0.013	5:15	0.007	0.008
20:50	0.007	0.009	1:05	0.011	0.012	5:20	0.007	0.008
20:55	0.007	0.009	1:10	0.011	0.011	5:25	0.008	0.008
21:00	0.008	0.012	1:15	0.011	0.011	5:30	0.007	0.008
21:05	0.007	0.008	1:20	0.011	0.011	5:35	0.007	0.007
21:10	0.007	0.008	1:25	0.011	0.011	5:40	0.007	0.007
21:15	0.007	0.009	1:30	0.011	0.011	5:45	0.008	0.009
21:20	0.008	0.009	1:35	0.01	0.011	5:50	0.009	0.011
21:25	0.008	0.01	1:40	0.01	0.011	5:55	0.01	0.013
21:30	0.009	0.01	1:45	0.011	0.011	6:00	0.009	0.011
21:35	0.013	0.016	1:50	0.01	0.011	6:05	0.008	0.01
21:40	0.015	0.021	1:55	0.011	0.011	6:10	0.006	0.006
21:45	0.014	0.017	2:00	0.01	0.011	6:15	0.006	0.006
21:50	0.014	0.018	2:05	0.01	0.01	6:20	0.006	0.006
21:55	0.014	0.018	2:10	0.01	0.01	6:25	0.006	0.006
22:00	0.014	0.017	2:15	0.01	0.01	6:30	0.007	0.009
22:05	0.014	0.017	2:20	0.01	0.01	6:35	0.008	0.013
22:10	0.014	0.017	2:25	0.009	0.01	6:40	0.009	0.014
22:15	0.013	0.016	2:30	0.009	0.01	6:45	0.011	0.018
22:20	0.013	0.016	2:35	0.009	0.01	6:50	0.011	0.019
22:25	0.013	0.016	2:40	0.009	0.01	6:55	0.011	0.019
22:30	0.013	0.015	2:45	0.009	0.009	7:00	0.024	0.054
22:35	0.013	0.015	2:50	0.009	0.009	7:05	0.028	0.066
22:40	0.013	0.014	2:55	0.009	0.009	7:10	0.039	0.093
22:45	0.013	0.015	3:00	0.009	0.009	7:15	0.035	0.078
22:50	0.013	0.015	3:05	0.009	0.01	7:20	0.039	0.085
22:55	0.012	0.014	3:10	0.009	0.009	7:25	0.045	0.094
23:00	0.013	0.014	3:15	0.009	0.009	7:30	0.041	0.088
23:05	0.013	0.014	3:20	0.009	0.009	7:35	0.06	0.126
23:10	0.012	0.013	3:25	0.009	0.009			
23:15	0.013	0.014	3:30	0.008	0.009			
23:20	0.013	0.014	3:35	0.008	0.009			
23:25	0.013	0.014	3:40	0.009	0.009			
23:30	0.013	0.014	3:45	0.009	0.009			
23:35	0.012	0.013	3:50	0.008	0.009			
23:40	0.012	0.013	3:55	0.008	0.009			
23:45	0.012	0.013	4:00	0.008	0.009			
23:50	0.012	0.012	4:05	0.008	0.008			
23:55	0.012	0.013	4:10	0.008	0.008			
0:00	0.014	0.015	4:15	0.008	0.008			
0:05	0.014	0.015	4:20	0.008	0.008			
0:10	0.014	0.015	4:25	0.008	0.008			
0:15	0.014	0.015	4:30	0.008	0.008			
0:20	0.014	0.015	4:35	0.008	0.008			
0:25	0.014	0.015	4:40	0.008	0.008			
0:30	0.014	0.014	4:45	0.008	0.008			
0:35	0.014	0.014	4:50	0.007	0.008			

Instrument Data			Site-4			Hall by Room 112			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:35	0.031	0.041	11:50	0.062	0.087	16:05	0.037	0.047						
7:40	0.033	0.044	11:55	0.096	0.119	16:10	0.035	0.045						
7:45	0.043	0.062	12:00	0.111	0.141	16:15	0.033	0.041						
7:50	0.039	0.057	12:05	0.1	0.141	16:20	0.031	0.038						
7:55	0.034	0.046	12:10	0.088	0.122	16:25	0.032	0.04						
8:00	0.043	0.064	12:15	0.067	0.091	16:30	0.029	0.034						
8:05	0.034	0.046	12:20	0.066	0.086	16:35	0.028	0.033						
8:10	0.031	0.04	12:25	0.057	0.074	16:40	0.027	0.031						
8:15	0.03	0.038	12:30	0.051	0.063	16:45	0.034	0.039						
8:20	0.029	0.036	12:35	0.051	0.062	16:50	0.039	0.044						
8:25	0.03	0.038	12:40	0.05	0.062	16:55	0.041	0.044						
8:30	0.03	0.04	12:45	0.061	0.085	17:00	0.039	0.042						
8:35	0.028	0.034	12:50	0.073	0.103	17:05	0.036	0.04						
8:40	0.028	0.034	12:55	0.057	0.082	17:10	0.054	0.075						
8:45	0.03	0.039	13:00	0.049	0.066	17:15	0.042	0.061						
8:50	0.034	0.045	13:05	0.05	0.065	17:20	0.05	0.075						
8:55	0.032	0.042	13:10	0.049	0.067	17:25	0.043	0.065						
9:00	0.042	0.06	13:15	0.046	0.061	17:30	0.033	0.046						
9:05	0.054	0.083	13:20	0.046	0.064	17:35	0.031	0.04						
9:10	0.044	0.071	13:25	0.043	0.059	17:40	0.028	0.034						
9:15	0.036	0.052	13:30	0.039	0.052	17:45	0.027	0.032						
9:20	0.035	0.049	13:35	0.043	0.061	17:50	0.026	0.031						
9:25	0.029	0.037	13:40	0.046	0.063	17:55	0.027	0.032						
9:30	0.029	0.035	13:45	0.057	0.077	18:00	0.029	0.038						
9:35	0.027	0.033	13:50	0.066	0.087	18:05	0.03	0.04						
9:40	0.025	0.03	13:55	0.109	0.137	18:10	0.028	0.037						
9:45	0.025	0.03	14:00	0.132	0.166	18:15	0.027	0.034						
9:50	0.026	0.03	14:05	0.155	0.19	18:20	0.026	0.032						
9:55	0.03	0.034	14:10	0.186	0.214	18:25	0.026	0.031						
10:00	0.035	0.04	14:15	0.221	0.247	18:30	0.025	0.029						
10:05	0.056	0.066	14:20	0.154	0.193	18:35	0.025	0.028						
10:10	0.05	0.059	14:25	0.152	0.187	18:40	0.025	0.028						
10:15	0.07	0.101	14:30	0.143	0.18	18:45	0.024	0.027						
10:20	0.071	0.105	14:35	0.371	0.413	18:50	0.029	0.037						
10:25	0.062	0.092	14:40	0.203	0.246	18:55	0.027	0.034						
10:30	0.054	0.08	14:45	0.221	0.241	19:00	0.026	0.03						
10:35	0.066	0.105	14:50	0.116	0.131	19:05	0.03	0.036						
10:40	0.078	0.131	14:55	0.073	0.087	19:10	0.044	0.067						
10:45	0.066	0.104	15:00	0.064	0.076	19:15	0.073	0.127						
10:50	0.071	0.105	15:05	0.149	0.158	19:20	0.083	0.147						
10:55	0.071	0.099	15:10	0.159	0.171	19:25	0.088	0.155						
11:00	0.064	0.086	15:15	0.125	0.136	19:30	0.065	0.108						
11:05	0.057	0.076	15:20	0.212	0.226	19:35	0.052	0.08						
11:10	0.056	0.079	15:25	0.105	0.122	19:40	0.045	0.065						
11:15	0.064	0.086	15:30	0.065	0.086	19:45	0.042	0.058						
11:20	0.063	0.083	15:35	0.056	0.077	19:50	0.043	0.055						
11:25	0.067	0.083	15:40	0.055	0.077	19:55	0.043	0.052						
11:30	0.074	0.089	15:45	0.089	0.108	20:00	0.041	0.048						
11:35	0.063	0.074	15:50	0.098	0.115	20:05	0.038	0.043						
11:40	0.059	0.071	15:55	0.052	0.068	20:10	0.037	0.041						
11:45	0.059	0.077	16:00	0.045	0.058	20:15	0.035	0.039						

Instrument Data			Site-4 Hall by Room 112			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:20	0.035	0.038	0:35	0.03	0.03	4:50	0.023	0.023
20:25	0.034	0.037	0:40	0.029	0.03	4:55	0.024	0.024
20:30	0.039	0.048	0:45	0.029	0.03	5:00	0.024	0.024
20:35	0.038	0.048	0:50	0.029	0.029	5:05	0.024	0.024
20:40	0.035	0.044	0:55	0.029	0.029	5:10	0.024	0.024
20:45	0.047	0.073	1:00	0.029	0.029	5:15	0.024	0.024
20:50	0.053	0.098	1:05	0.028	0.029	5:20	0.023	0.024
20:55	0.045	0.074	1:10	0.028	0.028	5:25	0.023	0.024
21:00	0.041	0.063	1:15	0.028	0.028	5:30	0.023	0.023
21:05	0.037	0.051	1:20	0.028	0.028	5:35	0.023	0.024
21:10	0.037	0.05	1:25	0.028	0.028	5:40	0.023	0.024
21:15	0.036	0.046	1:30	0.027	0.028	5:45	0.024	0.024
21:20	0.034	0.042	1:35	0.027	0.028	5:50	0.024	0.024
21:25	0.033	0.039	1:40	0.027	0.028	5:55	0.024	0.024
21:30	0.033	0.037	1:45	0.027	0.028	6:00	0.024	0.024
21:35	0.032	0.035	1:50	0.027	0.027	6:05	0.024	0.024
21:40	0.032	0.035	1:55	0.027	0.027	6:10	0.024	0.024
21:45	0.031	0.035	2:00	0.027	0.028	6:15	0.024	0.024
21:50	0.032	0.035	2:05	0.028	0.028	6:20	0.024	0.025
21:55	0.031	0.033	2:10	0.027	0.028	6:25	0.024	0.025
22:00	0.031	0.033	2:15	0.027	0.027	6:30	0.027	0.03
22:05	0.031	0.033	2:20	0.027	0.027	6:35	0.031	0.04
22:10	0.03	0.032	2:25	0.027	0.027	6:40	0.029	0.035
22:15	0.03	0.031	2:30	0.026	0.027	6:45	0.027	0.032
22:20	0.029	0.031	2:35	0.026	0.027	6:50	0.028	0.032
22:25	0.029	0.031	2:40	0.026	0.027	6:55	0.027	0.032
22:30	0.029	0.03	2:45	0.026	0.026	7:00	0.027	0.031
22:35	0.029	0.03	2:50	0.026	0.026	7:05	0.027	0.031
22:40	0.029	0.03	2:55	0.026	0.026	7:10	0.028	0.033
22:45	0.029	0.03	3:00	0.025	0.026	7:15	0.029	0.034
22:50	0.029	0.03	3:05	0.025	0.026	7:20	0.031	0.039
22:55	0.029	0.03	3:10	0.026	0.026	7:25	0.043	0.066
23:00	0.029	0.03	3:15	0.025	0.026	7:30	0.07	0.136
23:05	0.028	0.03	3:20	0.025	0.026			
23:10	0.029	0.03	3:25	0.025	0.025			
23:15	0.029	0.03	3:30	0.025	0.025			
23:20	0.029	0.03	3:35	0.025	0.025			
23:25	0.029	0.03	3:40	0.025	0.025			
23:30	0.029	0.029	3:45	0.025	0.025			
23:35	0.029	0.029	3:50	0.024	0.025			
23:40	0.029	0.029	3:55	0.024	0.025			
23:45	0.029	0.029	4:00	0.024	0.024			
23:50	0.028	0.029	4:05	0.024	0.024			
23:55	0.029	0.029	4:10	0.024	0.024			
0:00	0.029	0.03	4:15	0.024	0.024			
0:05	0.029	0.03	4:20	0.024	0.024			
0:10	0.029	0.03	4:25	0.024	0.024			
0:15	0.029	0.03	4:30	0.023	0.023			
0:20	0.03	0.03	4:35	0.023	0.023			
0:25	0.03	0.03	4:40	0.023	0.023			
0:30	0.03	0.03	4:45	0.023	0.023			

Instrument Data (No Data = Instrument Failure)			Site-5 Little Theater			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
8:01	No Data	0.015	12:16	No Data	0.004	16:31	No Data	0.007			
8:06	No Data	0.016	12:21	No Data	0.004	16:36	No Data	0.005			
8:11	No Data	0.013	12:26	No Data	0.004	16:41	No Data	0.005			
8:16	No Data	0.012	12:31	No Data	0.004	16:46	No Data	0.005			
8:21	No Data	0.012	12:36	No Data	0.004	16:51	No Data	0.005			
8:26	No Data	0.011	12:41	No Data	0.005	16:56	No Data	0.005			
8:31	No Data	0.01	12:46	No Data	0.005	17:01	No Data	0.004			
8:36	No Data	0.01	12:51	No Data	0.005	17:06	No Data	0.005			
8:41	No Data	0.01	12:56	No Data	0.005	17:11	No Data	0.005			
8:46	No Data	0.009	13:01	No Data	0.007	17:16	No Data	0.007			
8:51	No Data	0.01	13:06	No Data	0.006	17:21	No Data	0.004			
8:56	No Data	0.008	13:11	No Data	0.005	17:26	No Data	0.004			
9:01	No Data	0.008	13:16	No Data	0.006	17:31	No Data	0.004			
9:06	No Data	0.007	13:21	No Data	0.006	17:36	No Data	0.008			
9:11	No Data	0.008	13:26	No Data	0.005	17:41	No Data	0.005			
9:16	No Data	0.008	13:31	No Data	0.005	17:46	No Data	0.005			
9:21	No Data	0.009	13:36	No Data	0.006	17:51	No Data	0.004			
9:26	No Data	0.012	13:41	No Data	0.006	17:56	No Data	0.004			
9:31	No Data	0.008	13:46	No Data	0.006	18:01	No Data	0.005			
9:36	No Data	0.009	13:51	No Data	0.006	18:06	No Data	0.004			
9:41	No Data	0.008	13:56	No Data	0.005	18:11	No Data	0.004			
9:46	No Data	0.007	14:01	No Data	0.005	18:16	No Data	0.004			
9:51	No Data	0.007	14:06	No Data	0.005	18:21	No Data	0.004			
9:56	No Data	0.007	14:11	No Data	0.005	18:26	No Data	0.005			
10:01	No Data	0.006	14:16	No Data	0.005	18:31	No Data	0.004			
10:06	No Data	0.007	14:21	No Data	0.005	18:36	No Data	0.004			
10:11	No Data	0.006	14:26	No Data	0.005	18:41	No Data	0.004			
10:16	No Data	0.006	14:31	No Data	0.005	18:46	No Data	0.004			
10:21	No Data	0.006	14:36	No Data	0.005	18:51	No Data	0.004			
10:26	No Data	0.007	14:41	No Data	0.005	18:56	No Data	0.005			
10:31	No Data	0.007	14:46	No Data	0.005	19:01	No Data	0.005			
10:36	No Data	0.008	14:51	No Data	0.004	19:06	No Data	0.005			
10:41	No Data	0.007	14:56	No Data	0.004	19:11	No Data	0.005			
10:46	No Data	0.006	15:01	No Data	0.004	19:16	No Data	0.005			
10:51	No Data	0.006	15:06	No Data	0.004	19:21	No Data	0.005			
10:56	No Data	0.006	15:11	No Data	0.004	19:26	No Data	0.005			
11:01	No Data	0.005	15:16	No Data	0.005	19:31	No Data	0.005			
11:06	No Data	0.005	15:21	No Data	0.005	19:36	No Data	0.005			
11:11	No Data	0.005	15:26	No Data	0.005	19:41	No Data	0.005			
11:16	No Data	0.006	15:31	No Data	0.005	19:46	No Data	0.006			
11:21	No Data	0.005	15:36	No Data	0.007	19:51	No Data	0.007			
11:26	No Data	0.006	15:41	No Data	0.011	19:56	No Data	0.007			
11:31	No Data	0.005	15:46	No Data	0.009	20:01	No Data	0.006			
11:36	No Data	0.005	15:51	No Data	0.009	20:06	No Data	0.006			
11:41	No Data	0.004	15:56	No Data	0.007	20:11	No Data	0.006			
11:46	No Data	0.008	16:01	No Data	0.008	20:16	No Data	0.006			
11:51	No Data	0.005	16:06	No Data	0.013	20:21	No Data	0.006			
11:56	No Data	0.006	16:11	No Data	0.007	20:26	No Data	0.006			
12:01	No Data	0.005	16:16	No Data	0.006	20:31	No Data	0.007			
12:06	No Data	0.005	16:21	No Data	0.006	20:36	No Data	0.007			
12:11	No Data	0.004	16:26	No Data	0.006	20:41	No Data	0.007			

Instrument Data (No Data = Instrument Failure)			Site-5 Little Theater			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
20:46	No Data	0.007	1:01	No Data	0.009	5:16	No Data	0.007			
20:51	No Data	0.007	1:06	No Data	0.009	5:21	No Data	0.007			
20:56	No Data	0.008	1:11	No Data	0.009	5:26	No Data	0.007			
21:01	No Data	0.007	1:16	No Data	0.009	5:31	No Data	0.007			
21:06	No Data	0.007	1:21	No Data	0.009	5:36	No Data	0.007			
21:11	No Data	0.01	1:26	No Data	0.009	5:41	No Data	0.007			
21:16	No Data	0.016	1:31	No Data	0.009	5:46	No Data	0.007			
21:21	No Data	0.013	1:36	No Data	0.009	5:51	No Data	0.007			
21:26	No Data	0.01	1:41	No Data	0.009	5:56	No Data	0.007			
21:31	No Data	0.01	1:46	No Data	0.009	6:01	No Data	0.007			
21:36	No Data	0.009	1:51	No Data	0.009	6:06	No Data	0.007			
21:41	No Data	0.008	1:56	No Data	0.009	6:11	No Data	0.008			
21:46	No Data	0.01	2:01	No Data	0.009	6:16	No Data	0.009			
21:51	No Data	0.011	2:06	No Data	0.008	6:21	No Data	0.007			
21:56	No Data	0.01	2:11	No Data	0.008	6:26	No Data	0.008			
22:01	No Data	0.009	2:16	No Data	0.008	6:31	No Data	0.05			
22:06	No Data	0.009	2:21	No Data	0.008	6:36	No Data	0.011			
22:11	No Data	0.009	2:26	No Data	0.008	6:41	No Data	0.008			
22:16	No Data	0.009	2:31	No Data	0.008	6:46	No Data	0.014			
22:21	No Data	0.009	2:36	No Data	0.008	6:51	No Data	0.009			
22:26	No Data	0.009	2:41	No Data	0.008	6:56	No Data	0.012			
22:31	No Data	0.009	2:46	No Data	0.008	7:01	No Data	0.027			
22:36	No Data	0.009	2:51	No Data	0.008	7:06	No Data	0.01			
22:41	No Data	0.009	2:56	No Data	0.008	7:11	No Data	0.009			
22:46	No Data	0.009	3:01	No Data	0.008	7:16	No Data	0.01			
22:51	No Data	0.008	3:06	No Data	0.008	7:21	No Data	0.015			
22:56	No Data	0.009	3:11	No Data	0.008	7:26	No Data	0.009			
23:01	No Data	0.009	3:16	No Data	0.008	7:31	No Data	0.008			
23:06	No Data	0.009	3:21	No Data	0.007	7:36	No Data	0.008			
23:11	No Data	0.009	3:26	No Data	0.008	7:41	No Data	0.011			
23:16	No Data	0.009	3:31	No Data	0.008	7:46	No Data	0.011			
23:21	No Data	0.009	3:36	No Data	0.007	7:51	No Data	0.012			
23:26	No Data	0.009	3:41	No Data	0.007	7:56	No Data	0.013			
23:31	No Data	0.009	3:46	No Data	0.007						
23:36	No Data	0.009	3:51	No Data	0.007						
23:41	No Data	0.009	3:56	No Data	0.007						
23:46	No Data	0.009	4:01	No Data	0.007						
23:51	No Data	0.009	4:06	No Data	0.007						
23:56	No Data	0.011	4:11	No Data	0.007						
0:01	No Data	0.01	4:16	No Data	0.007						
0:06	No Data	0.01	4:21	No Data	0.007						
0:11	No Data	0.01	4:26	No Data	0.007						
0:16	No Data	0.011	4:31	No Data	0.007						
0:21	No Data	0.01	4:36	No Data	0.007						
0:26	No Data	0.01	4:41	No Data	0.007						
0:31	No Data	0.009	4:46	No Data	0.007						
0:36	No Data	0.009	4:51	No Data	0.007						
0:41	No Data	0.009	4:56	No Data	0.007						
0:46	No Data	0.01	5:01	No Data	0.007						
0:51	No Data	0.009	5:06	No Data	0.007						
0:56	No Data	0.009	5:11	No Data	0.007						

Instrument Data			Site-6 Room 105			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:35	0.019	0.028	11:50	0.029	0.037	16:05	0.018	0.029			
7:40	0.019	0.026	11:55	0.028	0.037	16:10	0.019	0.027			
7:45	0.02	0.03	12:00	0.029	0.038	16:15	0.018	0.027			
7:50	0.021	0.038	12:05	0.03	0.04	16:20	0.016	0.024			
7:55	0.022	0.036	12:10	0.033	0.045	16:25	0.017	0.023			
8:00	0.021	0.031	12:15	0.034	0.045	16:30	0.016	0.024			
8:05	0.021	0.032	12:20	0.036	0.055	16:35	0.015	0.027			
8:10	0.02	0.035	12:25	0.034	0.054	16:40	0.016	0.028			
8:15	0.02	0.029	12:30	0.033	0.05	16:45	0.016	0.027			
8:20	0.021	0.032	12:35	0.031	0.047	16:50	0.015	0.026			
8:25	0.021	0.028	12:40	0.031	0.047	16:55	0.015	0.023			
8:30	0.02	0.027	12:45	0.031	0.046	17:00	0.013	0.022			
8:35	0.02	0.028	12:50	0.028	0.042	17:05	0.013	0.021			
8:40	0.022	0.029	12:55	0.026	0.045	17:10	0.012	0.017			
8:45	0.022	0.029	13:00	0.025	0.043	17:15	0.012	0.017			
8:50	0.023	0.031	13:05	0.025	0.04	17:20	0.011	0.017			
8:55	0.024	0.03	13:10	0.026	0.037	17:25	0.01	0.013			
9:00	0.024	0.033	13:15	0.026	0.036	17:30	0.01	0.013			
9:05	0.025	0.042	13:20	0.026	0.035	17:35	0.009	0.012			
9:10	0.025	0.044	13:25	0.026	0.037	17:40	0.009	0.011			
9:15	0.024	0.038	13:30	0.027	0.037	17:45	0.009	0.011			
9:20	0.023	0.042	13:35	0.028	0.038	17:50	0.009	0.01			
9:25	0.022	0.032	13:40	0.03	0.039	17:55	0.009	0.01			
9:30	0.024	0.034	13:45	0.03	0.04	18:00	0.008	0.009			
9:35	0.024	0.033	13:50	0.028	0.038	18:05	0.008	0.01			
9:40	0.024	0.035	13:55	0.026	0.041	18:10	0.008	0.009			
9:45	0.025	0.033	14:00	0.026	0.038	18:15	0.008	0.009			
9:50	0.025	0.034	14:05	0.027	0.043	18:20	0.008	0.01			
9:55	0.026	0.033	14:10	0.026	0.043	18:25	0.008	0.009			
10:00	0.025	0.033	14:15	0.025	0.041	18:30	0.009	0.01			
10:05	0.024	0.033	14:20	0.024	0.039	18:35	0.011	0.013			
10:10	0.024	0.03	14:25	0.022	0.037	18:40	0.017	0.016			
10:15	0.023	0.03	14:30	0.023	0.037	18:45	0.022	0.022			
10:20	0.022	0.036	14:35	0.023	0.038	18:50	0.027	0.026			
10:25	0.025	0.035	14:40	0.022	0.042	18:55	0.033	0.03			
10:30	0.024	0.034	14:45	0.022	0.037	19:00	0.033	0.032			
10:35	0.024	0.04	14:50	0.024	0.047	19:05	0.035	0.033			
10:40	0.024	0.047	14:55	0.023	0.051	19:10	0.035	0.034			
10:45	0.023	0.039	15:00	0.061	0.346	19:15	0.035	0.033			
10:50	0.024	0.036	15:05	0.048	0.254	19:20	0.037	0.038			
10:55	0.024	0.036	15:10	0.035	0.136	19:25	0.046	0.048			
11:00	0.023	0.031	15:15	0.029	0.089	19:30	0.061	0.059			
11:05	0.023	0.032	15:20	0.029	0.07	19:35	0.077	0.072			
11:10	0.024	0.033	15:25	0.027	0.065	19:40	0.086	0.085			
11:15	0.024	0.032	15:30	0.024	0.057	19:45	0.088	0.084			
11:20	0.026	0.035	15:35	0.023	0.049	19:50	0.082	0.079			
11:25	0.027	0.036	15:40	0.022	0.041	19:55	0.072	0.072			
11:30	0.027	0.037	15:45	0.021	0.037	20:00	0.066	0.065			
11:35	0.029	0.037	15:50	0.021	0.036	20:05	0.059	0.06			
11:40	0.028	0.038	15:55	0.019	0.032	20:10	0.053	0.053			
11:45	0.029	0.038	16:00	0.018	0.031	20:15	0.047	0.048			

Instrument Data			Site-6 Room 105			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:20	0.042	0.044	0:35	0.014	0.012	4:50	0.009	0.007			
20:25	0.038	0.038	0:40	0.013	0.012	4:55	0.009	0.008			
20:30	0.034	0.034	0:45	0.013	0.012	5:00	0.009	0.008			
20:35	0.031	0.033	0:50	0.013	0.012	5:05	0.009	0.008			
20:40	0.026	0.032	0:55	0.013	0.012	5:10	0.009	0.008			
20:45	0.025	0.028	1:00	0.013	0.012	5:15	0.009	0.008			
20:50	0.024	0.027	1:05	0.013	0.012	5:20	0.009	0.008			
20:55	0.022	0.024	1:10	0.013	0.011	5:25	0.009	0.007			
21:00	0.018	0.021	1:15	0.013	0.011	5:30	0.009	0.008			
21:05	0.016	0.019	1:20	0.013	0.011	5:35	0.009	0.008			
21:10	0.016	0.017	1:25	0.013	0.011	5:40	0.009	0.008			
21:15	0.015	0.017	1:30	0.013	0.011	5:45	0.009	0.008			
21:20	0.017	0.017	1:35	0.013	0.011	5:50	0.009	0.008			
21:25	0.017	0.018	1:40	0.013	0.011	5:55	0.009	0.008			
21:30	0.017	0.017	1:45	0.013	0.011	6:00	0.009	0.008			
21:35	0.016	0.017	1:50	0.012	0.011	6:05	0.009	0.008			
21:40	0.016	0.016	1:55	0.012	0.011	6:10	0.009	0.008			
21:45	0.016	0.016	2:00	0.012	0.01	6:15	0.009	0.008			
21:50	0.016	0.016	2:05	0.012	0.011	6:20	0.009	0.008			
21:55	0.016	0.016	2:10	0.012	0.01	6:25	0.009	0.008			
22:00	0.016	0.016	2:15	0.012	0.01	6:30	0.009	0.01			
22:05	0.015	0.015	2:20	0.012	0.01	6:35	0.01	0.013			
22:10	0.015	0.015	2:25	0.012	0.01	6:40	0.01	0.013			
22:15	0.015	0.015	2:30	0.012	0.01	6:45	0.01	0.013			
22:20	0.015	0.015	2:35	0.012	0.01	6:50	0.01	0.013			
22:25	0.015	0.014	2:40	0.012	0.01	6:55	0.01	0.012			
22:30	0.015	0.014	2:45	0.012	0.01	7:00	0.01	0.012			
22:35	0.015	0.014	2:50	0.011	0.01	7:05	0.011	0.013			
22:40	0.014	0.014	2:55	0.011	0.009	7:10	0.01	0.014			
22:45	0.014	0.014	3:00	0.011	0.01	7:15	0.011	0.014			
22:50	0.014	0.014	3:05	0.011	0.009	7:20	0.011	0.014			
22:55	0.014	0.014	3:10	0.011	0.009	7:25	0.016	0.019			
23:00	0.014	0.013	3:15	0.011	0.009	7:30	0.022	0.03			
23:05	0.014	0.013	3:20	0.011	0.009						
23:10	0.014	0.013	3:25	0.011	0.009						
23:15	0.014	0.013	3:30	0.011	0.009						
23:20	0.014	0.013	3:35	0.011	0.009						
23:25	0.014	0.013	3:40	0.011	0.008						
23:30	0.014	0.013	3:45	0.01	0.008						
23:35	0.014	0.012	3:50	0.01	0.009						
23:40	0.014	0.012	3:55	0.01	0.008						
23:45	0.014	0.012	4:00	0.01	0.008						
23:50	0.014	0.012	4:05	0.01	0.008						
23:55	0.014	0.013	4:10	0.01	0.008						
0:00	0.014	0.013	4:15	0.01	0.008						
0:05	0.014	0.012	4:20	0.01	0.008						
0:10	0.014	0.012	4:25	0.009	0.008						
0:15	0.014	0.013	4:30	0.009	0.008						
0:20	0.014	0.012	4:35	0.009	0.008						
0:25	0.014	0.012	4:40	0.009	0.008						
0:30	0.014	0.012	4:45	0.009	0.007						

Instrument Data			Site-7 Room 107			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:33	0.035	0.05	11:48	0.035	0.05	16:03	0.029	0.031			
7:38	0.036	0.05	11:53	0.039	0.069	16:08	0.027	0.028			
7:43	0.034	0.04	11:58	0.044	0.076	16:13	0.026	0.022			
7:48	0.032	0.036	12:03	0.048	0.086	16:18	0.024	0.019			
7:53	0.033	0.036	12:08	0.048	0.082	16:23	0.023	0.017			
7:58	0.033	0.04	12:13	0.046	0.077	16:28	0.021	0.015			
8:03	0.035	0.044	12:18	0.042	0.066	16:33	0.021	0.014			
8:08	0.035	0.044	12:23	0.039	0.054	16:38	0.02	0.012			
8:13	0.035	0.042	12:28	0.035	0.044	16:43	0.02	0.013			
8:18	0.034	0.046	12:33	0.033	0.041	16:48	0.019	0.011			
8:23	0.034	0.044	12:38	0.03	0.035	16:53	0.018	0.009			
8:28	0.033	0.042	12:43	0.028	0.03	16:58	0.018	0.008			
8:33	0.034	0.044	12:48	0.026	0.033	17:03	0.018	0.008			
8:38	0.035	0.05	12:53	0.024	0.027	17:08	0.017	0.007			
8:43	0.037	0.054	12:58	0.023	0.027	17:13	0.017	0.008			
8:48	0.037	0.055	13:03	0.022	0.026	17:18	0.018	0.035			
8:53	0.041	0.066	13:08	0.021	0.022	17:23	0.018	0.018			
8:58	0.044	0.076	13:13	0.02	0.017	17:28	0.017	0.018			
9:03	0.045	0.083	13:18	0.02	0.018	17:33	0.017	0.012			
9:08	0.04	0.073	13:23	0.021	0.041	17:38	0.016	0.011			
9:13	0.037	0.058	13:28	0.022	0.051	17:43	0.016	0.009			
9:18	0.032	0.046	13:33	0.025	0.047	17:48	0.016	0.008			
9:23	0.029	0.041	13:38	0.029	0.04	17:53	0.016	0.007			
9:28	0.027	0.032	13:43	0.029	0.04	17:58	0.015	0.006			
9:33	0.025	0.029	13:48	0.04	0.038	18:03	0.015	0.005			
9:38	0.023	0.023	13:53	0.057	0.057	18:08	0.015	0.005			
9:43	0.022	0.02	13:58	0.067	0.086	18:13	0.015	0.005			
9:48	0.024	0.021	14:03	0.072	0.072	18:18	0.015	0.005			
9:53	0.025	0.027	14:08	0.072	0.078	18:23	0.015	0.005			
9:58	0.028	0.04	14:13	0.064	0.081	18:28	0.016	0.005			
10:03	0.032	0.05	14:18	0.046	0.107	18:33	0.016	0.005			
10:08	0.042	0.073	14:23	0.052	0.104	18:38	0.015	0.005			
10:13	0.055	0.108	14:28	0.064	0.122	18:43	0.016	0.004			
10:18	0.058	0.12	14:33	0.055	0.091	18:48	0.016	0.005			
10:23	0.054	0.101	14:38	0.056	0.096	18:53	0.016	0.005			
10:28	0.05	0.091	14:43	0.05	0.073	18:58	0.016	0.005			
10:33	0.051	0.101	14:48	0.047	0.062	19:03	0.016	0.005			
10:38	0.064	0.143	14:53	0.043	0.052	19:08	0.016	0.005			
10:43	0.063	0.136	14:58	0.043	0.06	19:13	0.016	0.005			
10:48	0.06	0.12	15:03	0.044	0.065	19:18	0.016	0.006			
10:53	0.058	0.116	15:08	0.05	0.075	19:23	0.016	0.005			
10:58	0.051	0.089	15:13	0.05	0.077	19:28	0.017	0.005			
11:03	0.045	0.072	15:18	0.047	0.077	19:33	0.017	0.005			
11:08	0.043	0.068	15:23	0.043	0.062	19:38	0.017	0.006			
11:13	0.039	0.057	15:28	0.04	0.053	19:43	0.017	0.006			
11:18	0.037	0.059	15:33	0.038	0.047	19:48	0.017	0.006			
11:23	0.036	0.045	15:38	0.036	0.047	19:53	0.018	0.007			
11:28	0.033	0.043	15:43	0.036	0.045	19:58	0.018	0.007			
11:33	0.031	0.039	15:48	0.035	0.049	20:03	0.018	0.007			
11:38	0.031	0.038	15:53	0.034	0.046	20:08	0.018	0.007			
11:43	0.032	0.045	15:58	0.032	0.035	20:13	0.018	0.008			

Instrument Data			Site-7 Room 107			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:18	0.019	0.008	0:33	0.025	0.015	4:48	0.017	0.007
20:23	0.019	0.008	0:38	0.025	0.015	4:53	0.017	0.008
20:28	0.019	0.008	0:43	0.025	0.015	4:58	0.018	0.007
20:33	0.019	0.008	0:48	0.024	0.014	5:03	0.018	0.007
20:38	0.019	0.008	0:53	0.024	0.014	5:08	0.018	0.007
20:43	0.02	0.008	0:58	0.024	0.014	5:13	0.018	0.007
20:48	0.02	0.008	1:03	0.023	0.013	5:18	0.018	0.007
20:53	0.02	0.009	1:08	0.023	0.013	5:23	0.018	0.007
20:58	0.02	0.009	1:13	0.023	0.012	5:28	0.018	0.007
21:03	0.02	0.009	1:18	0.022	0.012	5:33	0.018	0.007
21:08	0.02	0.009	1:23	0.022	0.012	5:38	0.018	0.007
21:13	0.021	0.01	1:28	0.022	0.012	5:43	0.018	0.008
21:18	0.027	0.016	1:33	0.022	0.011	5:48	0.018	0.008
21:23	0.029	0.02	1:38	0.021	0.011	5:53	0.018	0.008
21:28	0.031	0.02	1:43	0.021	0.011	5:58	0.018	0.008
21:33	0.03	0.021	1:48	0.021	0.011	6:03	0.019	0.008
21:38	0.029	0.02	1:53	0.021	0.011	6:08	0.019	0.008
21:43	0.029	0.02	1:58	0.021	0.011	6:13	0.019	0.009
21:48	0.029	0.019	2:03	0.021	0.011	6:18	0.019	0.009
21:53	0.028	0.019	2:08	0.021	0.01	6:23	0.019	0.009
21:58	0.028	0.019	2:13	0.02	0.01	6:28	0.02	0.024
22:03	0.028	0.018	2:18	0.02	0.01	6:33	0.02	0.028
22:08	0.027	0.017	2:23	0.02	0.01	6:38	0.021	0.02
22:13	0.027	0.017	2:28	0.02	0.01	6:43	0.021	0.018
22:18	0.027	0.017	2:33	0.02	0.01	6:48	0.021	0.018
22:23	0.027	0.016	2:38	0.019	0.009	6:53	0.021	0.017
22:28	0.026	0.016	2:43	0.019	0.009	6:58	0.02	0.017
22:33	0.025	0.015	2:48	0.019	0.009	7:03	0.02	0.018
22:38	0.025	0.015	2:53	0.019	0.009	7:08	0.02	0.015
22:43	0.025	0.015	2:58	0.019	0.008	7:13	0.021	0.016
22:48	0.025	0.014	3:03	0.019	0.008	7:18	0.021	0.016
22:53	0.024	0.014	3:08	0.019	0.008	7:23	0.022	0.018
22:58	0.024	0.014	3:13	0.019	0.008	7:28	0.022	0.019
23:03	0.024	0.014	3:18	0.018	0.008			
23:08	0.024	0.014	3:23	0.018	0.008			
23:13	0.024	0.014	3:28	0.018	0.008			
23:18	0.024	0.014	3:33	0.018	0.008			
23:23	0.024	0.014	3:38	0.018	0.008			
23:28	0.024	0.014	3:43	0.018	0.008			
23:33	0.024	0.013	3:48	0.018	0.008			
23:38	0.023	0.013	3:53	0.018	0.008			
23:43	0.023	0.013	3:58	0.018	0.007			
23:48	0.023	0.013	4:03	0.018	0.007			
23:53	0.024	0.014	4:08	0.018	0.007			
23:58	0.025	0.014	4:13	0.018	0.007			
0:03	0.025	0.015	4:18	0.018	0.007			
0:08	0.025	0.015	4:23	0.018	0.007			
0:13	0.025	0.015	4:28	0.017	0.007			
0:18	0.026	0.016	4:33	0.017	0.007			
0:23	0.026	0.016	4:38	0.018	0.007			
0:28	0.026	0.016	4:43	0.017	0.007			

Instrument Data			Site-8 Balcony by Chorus			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:55	0.217	0.231	12:10	0.224	0.238	16:25	0.221	0.229
8:00	0.225	0.234	12:15	0.221	0.23	16:30	0.219	0.224
8:05	0.225	0.231	12:20	0.219	0.224	16:35	0.218	0.221
8:10	0.224	0.229	12:25	0.218	0.222	16:40	0.218	0.221
8:15	0.223	0.228	12:30	0.217	0.221	16:45	0.217	0.219
8:20	0.222	0.225	12:35	0.216	0.219	16:50	0.218	0.222
8:25	0.221	0.224	12:40	0.217	0.221	16:55	0.218	0.221
8:30	0.221	0.224	12:45	0.23	0.251	17:00	0.218	0.222
8:35	0.221	0.224	12:50	0.23	0.254	17:05	0.218	0.22
8:40	0.22	0.223	12:55	0.227	0.244	17:10	0.218	0.219
8:45	0.22	0.223	13:00	0.228	0.249	17:15	0.217	0.219
8:50	0.22	0.223	13:05	0.228	0.246	17:20	0.217	0.219
8:55	0.22	0.223	13:10	0.22	0.229	17:25	0.217	0.219
9:00	0.259	0.314	13:15	0.219	0.224	17:30	0.218	0.221
9:05	0.243	0.285	13:20	0.218	0.223	17:35	0.217	0.221
9:10	0.229	0.247	13:25	0.217	0.221	17:40	0.218	0.221
9:15	0.225	0.234	13:30	0.219	0.225	17:45	0.218	0.22
9:20	0.222	0.229	13:35	0.219	0.225	17:50	0.217	0.22
9:25	0.222	0.229	13:40	0.247	0.268	17:55	0.229	0.25
9:30	0.22	0.224	13:45	0.229	0.237	18:00	0.225	0.24
9:35	0.22	0.224	13:50	0.223	0.229	18:05	0.222	0.232
9:40	0.22	0.223	13:55	0.235	0.256	18:10	0.22	0.226
9:45	0.219	0.221	14:00	0.246	0.278	18:15	0.221	0.228
9:50	0.223	0.226	14:05	0.236	0.257	18:20	0.221	0.227
9:55	0.227	0.231	14:10	0.231	0.243	18:25	0.22	0.224
10:00	0.239	0.242	14:15	0.229	0.238	18:30	0.22	0.223
10:05	0.236	0.242	14:20	0.225	0.231	18:35	0.218	0.221
10:10	0.224	0.228	14:25	0.222	0.229	18:40	0.218	0.22
10:15	0.243	0.28	14:30	0.222	0.227	18:45	0.218	0.22
10:20	0.24	0.276	14:35	0.228	0.233	18:50	0.219	0.221
10:25	0.226	0.243	14:40	0.222	0.227	18:55	0.218	0.221
10:30	0.229	0.243	14:45	0.226	0.229	19:00	0.232	0.251
10:35	0.248	0.283	14:50	0.226	0.23	19:05	0.283	0.376
10:40	0.274	0.305	14:55	0.225	0.23	19:10	0.336	0.502
10:45	0.301	0.316	15:00	0.315	0.32	19:15	0.308	0.436
10:50	0.281	0.289	15:05	0.414	0.423	19:20	0.262	0.322
10:55	0.229	0.235	15:10	0.239	0.247	19:25	0.238	0.265
11:00	0.226	0.232	15:15	0.229	0.235	19:30	0.228	0.241
11:05	0.222	0.225	15:20	0.229	0.235	19:35	0.225	0.234
11:10	0.223	0.228	15:25	0.229	0.239	19:40	0.223	0.228
11:15	0.226	0.234	15:30	0.225	0.237	19:45	0.222	0.227
11:20	0.229	0.237	15:35	0.225	0.237	19:50	0.222	0.227
11:25	0.227	0.233	15:40	0.233	0.255	19:55	0.221	0.224
11:30	0.222	0.227	15:45	0.229	0.246	20:00	0.221	0.224
11:35	0.223	0.227	15:50	0.227	0.241	20:05	0.221	0.224
11:40	0.222	0.226	15:55	0.225	0.236	20:10	0.221	0.223
11:45	0.223	0.229	16:00	0.223	0.233	20:15	0.221	0.222
11:50	0.243	0.248	16:05	0.224	0.235	20:20	0.221	0.222
11:55	0.227	0.232	16:10	0.225	0.237	20:25	0.221	0.223
12:00	0.253	0.296	16:15	0.22	0.228	20:30	0.224	0.225
12:05	0.231	0.255	16:20	0.22	0.227	20:35	0.222	0.223

Instrument Data			Site-8 Balcony by Chorus			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:40	0.222	0.223	0:55	0.226	0.226	5:10	0.223	0.223
20:45	0.224	0.227	1:00	0.225	0.226	5:15	0.223	0.223
20:50	0.225	0.231	1:05	0.225	0.226	5:20	0.223	0.223
20:55	0.224	0.229	1:10	0.225	0.226	5:25	0.223	0.223
21:00	0.225	0.23	1:15	0.225	0.226	5:30	0.223	0.223
21:05	0.229	0.238	1:20	0.225	0.226	5:35	0.223	0.223
21:10	0.226	0.232	1:25	0.225	0.226	5:40	0.223	0.224
21:15	0.226	0.231	1:30	0.225	0.226	5:45	0.223	0.223
21:20	0.226	0.231	1:35	0.225	0.225	5:50	0.223	0.223
21:25	0.226	0.231	1:40	0.225	0.225	5:55	0.223	0.224
21:30	0.227	0.232	1:45	0.225	0.226	6:00	0.223	0.223
21:35	0.228	0.236	1:50	0.227	0.228	6:05	0.223	0.224
21:40	0.227	0.234	1:55	0.227	0.227	6:10	0.223	0.224
21:45	0.227	0.234	2:00	0.226	0.226	6:15	0.223	0.224
21:50	0.228	0.234	2:05	0.225	0.226	6:20	0.223	0.224
21:55	0.227	0.232	2:10	0.225	0.225	6:25	0.224	0.226
22:00	0.226	0.231	2:15	0.224	0.225	6:30	0.225	0.227
22:05	0.226	0.23	2:20	0.224	0.225	6:35	0.224	0.227
22:10	0.225	0.229	2:25	0.224	0.224	6:40	0.224	0.226
22:15	0.225	0.228	2:30	0.224	0.224	6:45	0.224	0.225
22:20	0.225	0.228	2:35	0.224	0.224	6:50	0.224	0.226
22:25	0.225	0.227	2:40	0.224	0.224	6:55	0.225	0.227
22:30	0.225	0.228	2:45	0.223	0.224	7:00	0.225	0.228
22:35	0.225	0.228	2:50	0.223	0.224	7:05	0.232	0.237
22:40	0.226	0.228	2:55	0.223	0.224	7:10	0.233	0.241
22:45	0.225	0.227	3:00	0.223	0.224	7:15	0.227	0.231
22:50	0.225	0.227	3:05	0.223	0.224	7:20	0.232	0.242
22:55	0.225	0.227	3:10	0.223	0.224	7:25	0.234	0.249
23:00	0.225	0.227	3:15	0.223	0.223	7:30	0.228	0.232
23:05	0.226	0.227	3:20	0.223	0.223	7:35	0.229	0.233
23:10	0.226	0.228	3:25	0.223	0.223	7:40	0.229	0.235
23:15	0.226	0.227	3:30	0.223	0.223	7:45	0.245	0.267
23:20	0.226	0.227	3:35	0.223	0.223	7:50	0.243	0.265
23:25	0.226	0.227	3:40	0.223	0.223			
23:30	0.226	0.227	3:45	0.223	0.223			
23:35	0.226	0.226	3:50	0.223	0.223			
23:40	0.225	0.226	3:55	0.223	0.223			
23:45	0.226	0.227	4:00	0.223	0.223			
23:50	0.227	0.227	4:05	0.223	0.223			
23:55	0.227	0.228	4:10	0.223	0.223			
0:00	0.227	0.228	4:15	0.222	0.223			
0:05	0.227	0.228	4:20	0.222	0.223			
0:10	0.227	0.228	4:25	0.222	0.223			
0:15	0.227	0.228	4:30	0.222	0.223			
0:20	0.227	0.228	4:35	0.222	0.223			
0:25	0.227	0.228	4:40	0.223	0.223			
0:30	0.227	0.227	4:45	0.223	0.223			
0:35	0.227	0.227	4:50	0.223	0.223			
0:40	0.227	0.227	4:55	0.223	0.224			
0:45	0.226	0.227	5:00	0.223	0.224			
0:50	0.226	0.226	5:05	0.223	0.223			

Instrument Data			Site-9			Hall by Room 14			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:52	0.03	0.051	12:07	0.084	0.102	16:22	0.018	0.029						
7:57	0.029	0.047	12:12	0.061	0.077	16:27	0.017	0.028						
8:02	0.026	0.041	12:17	0.05	0.072	16:32	0.015	0.022						
8:07	0.026	0.038	12:22	0.054	0.096	16:37	0.013	0.019						
8:12	0.022	0.032	12:27	0.035	0.056	16:42	0.012	0.019						
8:17	0.021	0.029	12:32	0.039	0.066	16:47	0.012	0.018						
8:22	0.021	0.03	12:37	0.036	0.065	16:52	0.014	0.022						
8:27	0.018	0.026	12:42	0.051	0.096	16:57	0.012	0.018						
8:32	0.02	0.029	12:47	0.053	0.106	17:02	0.022	0.047						
8:37	0.018	0.026	12:52	0.043	0.087	17:07	0.028	0.059						
8:42	0.02	0.029	12:57	0.043	0.087	17:12	0.026	0.055						
8:47	0.018	0.028	13:02	0.037	0.073	17:17	0.017	0.029						
8:52	0.022	0.035	13:07	0.032	0.061	17:22	0.014	0.025						
8:57	0.03	0.052	13:12	0.029	0.053	17:27	0.019	0.037						
9:02	0.043	0.084	13:17	0.028	0.051	17:32	0.016	0.033						
9:07	0.037	0.071	13:22	0.029	0.053	17:37	0.032	0.07						
9:12	0.03	0.058	13:27	0.03	0.056	17:42	0.105	0.27						
9:17	0.06	0.124	13:32	0.032	0.06	17:47	0.073	0.179						
9:22	0.237	0.558	13:37	0.032	0.059	17:52	0.058	0.147						
9:27	0.1	0.242	13:42	0.03	0.056	17:57	0.041	0.099						
9:32	0.045	0.098	13:47	0.029	0.053	18:02	0.022	0.047						
9:37	0.033	0.067	13:52	0.031	0.055	18:07	0.018	0.038						
9:42	0.034	0.068	13:57	0.044	0.086	18:12	0.012	0.022						
9:47	0.031	0.061	14:02	0.037	0.072	18:17	0.011	0.019						
9:52	0.024	0.045	14:07	0.033	0.061	18:22	0.01	0.016						
9:57	0.021	0.037	14:12	0.029	0.05	18:27	0.011	0.017						
10:02	0.023	0.04	14:17	0.029	0.049	18:32	0.013	0.021						
10:07	0.026	0.04	14:22	0.035	0.065	18:37	0.012	0.018						
10:12	0.034	0.05	14:27	0.03	0.051	18:42	0.012	0.016						
10:17	0.038	0.06	14:32	0.036	0.063	18:47	0.014	0.018						
10:22	0.035	0.058	14:37	0.041	0.076	18:52	0.015	0.02						
10:27	0.029	0.049	14:42	0.042	0.078	18:57	0.016	0.022						
10:32	0.03	0.051	14:47	0.045	0.08	19:02	0.044	0.076						
10:37	0.035	0.064	14:52	0.048	0.089	19:07	0.395	0.767						
10:42	0.03	0.052	14:57	0.051	0.094	19:12	0.202	0.399						
10:47	0.045	0.063	15:02	0.044	0.079	19:17	0.084	0.165						
10:52	0.057	0.074	15:07	0.049	0.092	19:22	0.102	0.203						
10:57	0.066	0.08	15:12	0.056	0.081	19:27	0.076	0.142						
11:02	0.061	0.073	15:17	0.054	0.075	19:32	0.048	0.083						
11:07	0.053	0.07	15:22	0.043	0.061	19:37	0.033	0.052						
11:12	0.057	0.086	15:27	0.036	0.052	19:42	0.029	0.042						
11:17	0.053	0.082	15:32	0.076	0.15	19:47	0.028	0.038						
11:22	0.056	0.078	15:37	0.075	0.156	19:52	0.023	0.03						
11:27	0.051	0.07	15:42	0.045	0.089	19:57	0.022	0.028						
11:32	0.049	0.071	15:47	0.029	0.056	20:02	0.021	0.025						
11:37	0.045	0.064	15:52	0.024	0.044	20:07	0.02	0.024						
11:42	0.043	0.061	15:57	0.022	0.039	20:12	0.018	0.021						
11:47	0.033	0.046	16:02	0.023	0.039	20:17	0.017	0.02						
11:52	0.029	0.039	16:07	0.023	0.038	20:22	0.018	0.021						
11:57	0.056	0.074	16:12	0.021	0.035	20:27	0.017	0.02						
12:02	0.097	0.119	16:17	0.019	0.031	20:32	0.017	0.02						

Instrument Data			Site-10 Girls' Locker Room			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
8:07	0.021	0.033	12:22	0.008	0.011	16:37	0.009	0.01			
8:12	0.017	0.023	12:27	0.008	0.011	16:42	0.011	0.015			
8:17	0.015	0.019	12:32	0.008	0.011	16:47	0.019	0.029			
8:22	0.014	0.018	12:37	0.01	0.015	16:52	0.012	0.018			
8:27	0.013	0.017	12:42	0.011	0.018	16:57	0.01	0.013			
8:32	0.013	0.016	12:47	0.011	0.019	17:02	0.008	0.011			
8:37	0.012	0.015	12:52	0.012	0.019	17:07	0.008	0.01			
8:42	0.012	0.017	12:57	0.012	0.02	17:12	0.009	0.011			
8:47	0.012	0.015	13:02	0.012	0.02	17:17	0.008	0.01			
8:52	0.013	0.016	13:07	0.012	0.02	17:22	0.007	0.009			
8:57	0.018	0.028	13:12	0.012	0.019	17:27	0.007	0.009			
9:02	0.024	0.043	13:17	0.014	0.024	17:32	0.009	0.015			
9:07	0.031	0.057	13:22	0.016	0.025	17:37	0.009	0.014			
9:12	0.03	0.054	13:27	0.015	0.024	17:42	0.007	0.009			
9:17	0.026	0.052	13:32	0.013	0.021	17:47	0.008	0.009			
9:22	0.028	0.057	13:37	0.013	0.019	17:52	0.008	0.01			
9:27	0.045	0.09	13:42	0.012	0.017	17:57	0.008	0.012			
9:32	0.056	0.115	13:47	0.012	0.016	18:02	0.009	0.014			
9:37	0.027	0.054	13:52	0.011	0.015	18:07	0.009	0.012			
9:42	0.024	0.048	13:57	0.014	0.02	18:12	0.01	0.013			
9:47	0.024	0.046	14:02	0.016	0.025	18:17	0.01	0.012			
9:52	0.025	0.048	14:07	0.022	0.037	18:22	0.009	0.012			
9:57	0.024	0.046	14:12	0.02	0.032	18:27	0.009	0.011			
10:02	0.029	0.054	14:17	0.017	0.03	18:32	0.01	0.012			
10:07	0.03	0.057	14:22	0.022	0.042	18:37	0.009	0.011			
10:12	0.034	0.06	14:27	0.027	0.053	18:42	0.009	0.012			
10:17	0.023	0.04	14:32	0.021	0.041	18:47	0.01	0.012			
10:22	0.021	0.036	14:37	0.016	0.032	18:52	0.013	0.016			
10:27	0.016	0.027	14:42	0.012	0.022	18:57	0.012	0.016			
10:32	0.014	0.023	14:47	0.011	0.019	19:02	0.02	0.033			
10:37	0.02	0.032	14:52	0.01	0.015	19:07	0.06	0.131			
10:42	0.026	0.044	14:57	0.011	0.018	19:12	0.063	0.146			
10:47	0.02	0.034	15:02	0.01	0.016	19:17	0.046	0.099			
10:52	0.018	0.028	15:07	0.011	0.017	19:22	0.037	0.08			
10:57	0.015	0.024	15:12	0.008	0.012	19:27	0.03	0.059			
11:02	0.013	0.02	15:17	0.008	0.011	19:32	0.029	0.051			
11:07	0.013	0.02	15:22	0.007	0.01	19:37	0.022	0.034			
11:12	0.014	0.023	15:27	0.008	0.01	19:42	0.03	0.041			
11:17	0.013	0.022	15:32	0.008	0.011	19:47	0.031	0.042			
11:22	0.011	0.017	15:37	0.01	0.015	19:52	0.034	0.047			
11:27	0.01	0.014	15:42	0.009	0.014	19:57	0.03	0.041			
11:32	0.009	0.012	15:47	0.01	0.014	20:02	0.033	0.055			
11:37	0.009	0.013	15:52	0.01	0.014	20:07	0.032	0.042			
11:42	0.011	0.016	15:57	0.01	0.014	20:12	0.023	0.028			
11:47	0.019	0.03	16:02	0.01	0.014	20:17	0.027	0.035			
11:52	0.017	0.026	16:07	0.011	0.016	20:22	0.036	0.054			
11:57	0.015	0.023	16:12	0.013	0.019	20:27	0.048	0.08			
12:02	0.01	0.014	16:17	0.011	0.014	20:32	0.114	0.216			
12:07	0.009	0.013	16:22	0.013	0.018	20:37	0.076	0.144			
12:12	0.009	0.012	16:27	0.011	0.016	20:42	0.064	0.122			
12:17	0.009	0.012	16:32	0.009	0.012	20:47	0.056	0.107			

Instrument Data			Site-10 Girls' Locker Room			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
20:52	0.047	0.087	1:07	0.022	0.023	5:22	0.012	0.013			
20:57	0.038	0.066	1:12	0.022	0.022	5:27	0.012	0.013			
21:02	0.032	0.052	1:17	0.022	0.022	5:32	0.012	0.013			
21:07	0.03	0.047	1:22	0.021	0.022	5:37	0.013	0.014			
21:12	0.03	0.044	1:27	0.021	0.022	5:42	0.013	0.013			
21:17	0.029	0.041	1:32	0.02	0.021	5:47	0.013	0.013			
21:22	0.03	0.04	1:37	0.02	0.02	5:52	0.013	0.013			
21:27	0.031	0.04	1:42	0.02	0.02	5:57	0.013	0.013			
21:32	0.032	0.045	1:47	0.019	0.02	6:02	0.013	0.013			
21:37	0.03	0.04	1:52	0.019	0.02	6:07	0.013	0.013			
21:42	0.029	0.038	1:57	0.019	0.019	6:12	0.013	0.014			
21:47	0.031	0.04	2:02	0.019	0.019	6:17	0.014	0.017			
21:52	0.032	0.041	2:07	0.018	0.018	6:22	0.013	0.015			
21:57	0.034	0.043	2:12	0.018	0.018	6:27	0.027	0.051			
22:02	0.034	0.043	2:17	0.018	0.018	6:32	0.028	0.054			
22:07	0.033	0.042	2:22	0.018	0.018	6:37	0.023	0.04			
22:12	0.033	0.041	2:27	0.017	0.017	6:42	0.021	0.033			
22:17	0.034	0.041	2:32	0.017	0.017	6:47	0.021	0.033			
22:22	0.034	0.04	2:37	0.017	0.017	6:52	0.019	0.029			
22:27	0.035	0.041	2:42	0.016	0.017	6:57	0.021	0.034			
22:32	0.034	0.039	2:47	0.016	0.016	7:02	0.022	0.035			
22:37	0.035	0.04	2:52	0.016	0.016	7:07	0.02	0.031			
22:42	0.035	0.04	2:57	0.016	0.016	7:12	0.024	0.042			
22:47	0.035	0.04	3:02	0.016	0.016	7:17	0.04	0.083			
22:52	0.035	0.04	3:07	0.015	0.016	7:22	0.046	0.1			
22:57	0.035	0.039	3:12	0.015	0.015	7:27	0.053	0.117			
23:02	0.035	0.039	3:17	0.015	0.015	7:32	0.051	0.107			
23:07	0.035	0.038	3:22	0.015	0.015	7:37	0.038	0.071			
23:12	0.035	0.038	3:27	0.015	0.015	7:42	0.032	0.054			
23:17	0.034	0.037	3:32	0.015	0.015	7:47	0.029	0.045			
23:22	0.034	0.037	3:37	0.015	0.015	7:52	0.028	0.041			
23:27	0.033	0.036	3:42	0.014	0.015	7:57	0.029	0.045			
23:32	0.033	0.036	3:47	0.014	0.015	8:02	0.03	0.047			
23:37	0.033	0.035	3:52	0.014	0.014						
23:42	0.031	0.033	3:57	0.014	0.014						
23:47	0.032	0.035	4:02	0.014	0.014						
23:52	0.031	0.033	4:07	0.014	0.014						
23:57	0.03	0.032	4:12	0.014	0.014						
0:02	0.027	0.029	4:17	0.013	0.014						
0:07	0.027	0.029	4:22	0.013	0.013						
0:12	0.027	0.028	4:27	0.013	0.014						
0:17	0.026	0.027	4:32	0.013	0.014						
0:22	0.026	0.027	4:37	0.013	0.014						
0:27	0.025	0.026	4:42	0.013	0.013						
0:32	0.024	0.025	4:47	0.013	0.013						
0:37	0.024	0.025	4:52	0.013	0.013						
0:42	0.023	0.024	4:57	0.013	0.013						
0:47	0.022	0.022	5:02	0.013	0.013						
0:52	0.022	0.023	5:07	0.013	0.013						
0:57	0.021	0.022	5:12	0.013	0.013						
1:02	0.023	0.023	5:17	0.013	0.013						

Instrument Data			Site-11 Room 4			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
7:51	0.011	0.02	12:06	0.014	0.018	16:21	0.011	0.016			
7:56	0.01	0.022	12:11	0.015	0.019	16:26	0.011	0.016			
8:01	0.011	0.02	12:16	0.015	0.019	16:31	0.01	0.015			
8:06	0.012	0.019	12:21	0.015	0.019	16:36	0.01	0.019			
8:11	0.012	0.025	12:26	0.015	0.02	16:41	0.01	0.014			
8:16	0.012	0.023	12:31	0.014	0.022	16:46	0.01	0.013			
8:21	0.012	0.018	12:36	0.014	0.021	16:51	0.009	0.012			
8:26	0.012	0.018	12:41	0.014	0.023	16:56	0.009	0.011			
8:31	0.012	0.021	12:46	0.014	0.025	17:01	0.011	0.011			
8:36	0.012	0.021	12:51	0.013	0.021	17:06	0.009	0.069			
8:41	0.012	0.022	12:56	0.013	0.022	17:11	0.009	0.018			
8:46	0.012	0.021	13:01	0.014	0.036	17:16	0.008	0.012			
8:51	0.012	0.021	13:06	0.013	0.031	17:21	0.016	0.014			
8:56	0.012	0.021	13:11	0.013	0.025	17:26	0.016	0.136			
9:01	0.012	0.032	13:16	0.013	0.021	17:31	0.015	0.116			
9:06	0.011	0.027	13:21	0.012	0.023	17:36	0.015	0.122			
9:11	0.011	0.023	13:26	0.013	0.022	17:41	0.013	0.101			
9:16	0.012	0.027	13:31	0.014	0.027	17:46	0.013	0.084			
9:21	0.013	0.027	13:36	0.014	0.028	17:51	0.012	0.074			
9:26	0.013	0.034	13:41	0.014	0.026	17:56	0.012	0.059			
9:31	0.013	0.033	13:46	0.014	0.026	18:01	0.011	0.049			
9:36	0.013	0.03	13:51	0.014	0.028	18:06	0.01	0.045			
9:41	0.012	0.028	13:56	0.013	0.028	18:11	0.01	0.039			
9:46	0.013	0.026	14:01	0.012	0.026	18:16	0.01	0.033			
9:51	0.013	0.051	14:06	0.011	0.023	18:21	0.009	0.029			
9:56	0.013	0.041	14:11	0.012	0.019	18:26	0.009	0.027			
10:01	0.011	0.044	14:16	0.011	0.018	18:31	0.009	0.023			
10:06	0.01	0.027	14:21	0.011	0.017	18:36	0.009	0.021			
10:11	0.01	0.02	14:26	0.011	0.017	18:41	0.008	0.019			
10:16	0.01	0.019	14:31	0.011	0.017	18:46	0.008	0.017			
10:21	0.01	0.019	14:36	0.012	0.017	18:51	0.008	0.016			
10:26	0.01	0.016	14:41	0.012	0.017	18:56	0.008	0.015			
10:31	0.01	0.016	14:46	0.012	0.02	19:01	0.008	0.014			
10:36	0.01	0.016	14:51	0.012	0.022	19:06	0.008	0.012			
10:41	0.01	0.015	14:56	0.013	0.022	19:11	0.008	0.012			
10:46	0.01	0.015	15:01	0.014	0.022	19:16	0.008	0.012			
10:51	0.011	0.016	15:06	0.017	0.029	19:21	0.008	0.012			
10:56	0.011	0.019	15:11	0.022	0.034	19:26	0.008	0.01			
11:01	0.012	0.019	15:16	0.023	0.037	19:31	0.008	0.01			
11:06	0.013	0.018	15:21	0.023	0.037	19:36	0.008	0.01			
11:11	0.013	0.021	15:26	0.022	0.034	19:41	0.008	0.009			
11:16	0.013	0.021	15:31	0.021	0.032	19:46	0.008	0.009			
11:21	0.014	0.021	15:36	0.019	0.035	19:51	0.008	0.009			
11:26	0.014	0.021	15:41	0.018	0.043	19:56	0.009	0.009			
11:31	0.014	0.021	15:46	0.017	0.042	20:01	0.009	0.009			
11:36	0.014	0.02	15:51	0.016	0.035	20:06	0.009	0.009			
11:41	0.013	0.019	15:56	0.014	0.028	20:11	0.009	0.009			
11:46	0.013	0.018	16:01	0.013	0.025	20:16	0.009	0.009			
11:51	0.013	0.017	16:06	0.013	0.022	20:21	0.009	0.009			
11:56	0.013	0.017	16:11	0.012	0.02	20:26	0.009	0.009			
12:01	0.014	0.017	16:16	0.012	0.018	20:31	0.009	0.009			

Instrument Data			Site-11 Room 4			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
20:36	0.009	0.009	0:51	0.011	0.011	5:06	0.007	0.007			
20:41	0.01	0.009	0:56	0.011	0.011	5:11	0.007	0.007			
20:46	0.01	0.009	1:01	0.011	0.011	5:16	0.007	0.006			
20:51	0.01	0.009	1:06	0.011	0.011	5:21	0.007	0.006			
20:56	0.01	0.009	1:11	0.011	0.011	5:26	0.008	0.007			
21:01	0.01	0.009	1:16	0.011	0.011	5:31	0.008	0.006			
21:06	0.011	0.01	1:21	0.011	0.011	5:36	0.007	0.006			
21:11	0.012	0.011	1:26	0.011	0.011	5:41	0.008	0.007			
21:16	0.013	0.012	1:31	0.011	0.01	5:46	0.008	0.007			
21:21	0.013	0.013	1:36	0.011	0.01	5:51	0.008	0.007			
21:26	0.012	0.012	1:41	0.011	0.011	5:56	0.008	0.007			
21:31	0.012	0.012	1:46	0.01	0.01	6:01	0.008	0.007			
21:36	0.012	0.012	1:51	0.01	0.01	6:06	0.008	0.007			
21:41	0.012	0.012	1:56	0.01	0.01	6:11	0.008	0.007			
21:46	0.012	0.012	2:01	0.01	0.01	6:16	0.008	0.008			
21:51	0.012	0.012	2:06	0.01	0.01	6:21	0.009	0.007			
21:56	0.012	0.012	2:11	0.01	0.01	6:26	0.009	0.013			
22:01	0.012	0.012	2:16	0.01	0.009	6:31	0.009	0.016			
22:06	0.012	0.012	2:21	0.009	0.009	6:36	0.009	0.017			
22:11	0.012	0.012	2:26	0.009	0.009	6:41	0.009	0.015			
22:16	0.012	0.011	2:31	0.009	0.009	6:46	0.009	0.015			
22:21	0.012	0.012	2:36	0.009	0.009	6:51	0.009	0.014			
22:26	0.011	0.011	2:41	0.009	0.009	6:56	0.009	0.013			
22:31	0.011	0.011	2:46	0.009	0.009	7:01	0.009	0.013			
22:36	0.011	0.011	2:51	0.009	0.009	7:06	0.01	0.014			
22:41	0.011	0.011	2:56	0.009	0.009	7:11	0.01	0.013			
22:46	0.011	0.011	3:01	0.009	0.009	7:16	0.01	0.013			
22:51	0.011	0.011	3:06	0.009	0.008	7:21	0.01	0.014			
22:56	0.011	0.011	3:11	0.009	0.008	7:26	0.01	0.012			
23:01	0.012	0.011	3:16	0.009	0.008	7:31	0.01	0.012			
23:06	0.012	0.011	3:21	0.008	0.008	7:36	0.012	0.012			
23:11	0.012	0.011	3:26	0.008	0.008	7:41	0.011	0.013			
23:16	0.012	0.011	3:31	0.008	0.008	7:46	0.012	0.022			
23:21	0.012	0.011	3:36	0.008	0.008						
23:26	0.011	0.011	3:41	0.008	0.007						
23:31	0.011	0.011	3:46	0.008	0.007						
23:36	0.011	0.011	3:51	0.008	0.007						
23:41	0.012	0.011	3:56	0.008	0.007						
23:46	0.012	0.012	4:01	0.008	0.007						
23:51	0.012	0.012	4:06	0.007	0.007						
23:56	0.012	0.012	4:11	0.007	0.007						
0:01	0.012	0.012	4:16	0.007	0.007						
0:06	0.012	0.012	4:21	0.007	0.007						
0:11	0.012	0.012	4:26	0.007	0.007						
0:16	0.012	0.012	4:31	0.007	0.007						
0:21	0.012	0.012	4:36	0.007	0.007						
0:26	0.012	0.012	4:41	0.007	0.006						
0:31	0.012	0.012	4:46	0.007	0.006						
0:36	0.012	0.012	4:51	0.007	0.007						
0:41	0.012	0.012	4:56	0.007	0.007						
0:46	0.011	0.012	5:01	0.007	0.006						

Instrument Data			Site-12 Hall by Room 223			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:44	0.023	0.029	11:59	0.03	0.036	16:14	0.011	0.013
7:49	0.021	0.024	12:04	0.029	0.033	16:19	0.015	0.017
7:54	0.018	0.02	12:09	0.026	0.028	16:24	0.012	0.014
7:59	0.016	0.019	12:14	0.024	0.026	16:29	0.012	0.014
8:04	0.016	0.019	12:19	0.024	0.026	16:34	0.011	0.013
8:09	0.016	0.018	12:24	0.025	0.029	16:39	0.011	0.013
8:14	0.015	0.017	12:29	0.022	0.026	16:44	0.01	0.012
8:19	0.015	0.017	12:34	0.019	0.022	16:49	0.009	0.011
8:24	0.014	0.016	12:39	0.03	0.041	16:54	0.01	0.011
8:29	0.014	0.016	12:44	0.027	0.035	16:59	0.009	0.01
8:34	0.014	0.016	12:49	0.021	0.027	17:04	0.008	0.009
8:39	0.016	0.019	12:54	0.068	0.093	17:09	0.009	0.011
8:44	0.017	0.02	12:59	0.054	0.076	17:14	0.009	0.011
8:49	0.015	0.017	13:04	0.026	0.034	17:19	0.009	0.011
8:54	0.018	0.022	13:09	0.021	0.026	17:24	0.01	0.011
8:59	0.032	0.041	13:14	0.022	0.027	17:29	0.009	0.011
9:04	0.042	0.057	13:19	0.021	0.025	17:34	0.009	0.01
9:09	0.034	0.046	13:24	0.021	0.025	17:39	0.01	0.012
9:14	0.029	0.038	13:29	0.018	0.022	17:44	0.01	0.012
9:19	0.021	0.027	13:34	0.017	0.021	17:49	0.01	0.013
9:24	0.021	0.027	13:39	0.019	0.023	17:54	0.009	0.011
9:29	0.021	0.027	13:44	0.019	0.023	17:59	0.011	0.015
9:34	0.02	0.025	13:49	0.022	0.027	18:04	0.01	0.013
9:39	0.018	0.022	13:54	0.024	0.031	18:09	0.012	0.014
9:44	0.016	0.019	13:59	0.022	0.028	18:14	0.019	0.02
9:49	0.017	0.02	14:04	0.02	0.025	18:19	0.03	0.031
9:54	0.016	0.019	14:09	0.017	0.021	18:24	0.036	0.037
9:59	0.019	0.022	14:14	0.018	0.023	18:29	0.037	0.038
10:04	0.015	0.018	14:19	0.022	0.03	18:34	0.036	0.037
10:09	0.018	0.022	14:24	0.026	0.035	18:39	0.034	0.036
10:14	0.021	0.026	14:29	0.023	0.029	18:44	0.036	0.037
10:19	0.02	0.024	14:34	0.02	0.024	18:49	0.032	0.033
10:24	0.019	0.022	14:39	0.02	0.024	18:54	0.028	0.029
10:29	0.024	0.03	14:44	0.018	0.022	18:59	0.041	0.049
10:34	0.024	0.03	14:49	0.019	0.022	19:04	0.078	0.088
10:39	0.021	0.026	14:54	0.02	0.024	19:09	0.146	0.161
10:44	0.021	0.025	14:59	0.023	0.027	19:14	0.113	0.124
10:49	0.022	0.026	15:04	0.021	0.025	19:19	0.083	0.09
10:54	0.023	0.026	15:09	0.02	0.025	19:24	0.066	0.073
10:59	0.025	0.029	15:14	0.021	0.025	19:29	0.057	0.063
11:04	0.027	0.031	15:19	0.023	0.027	19:34	0.048	0.052
11:09	0.031	0.038	15:24	0.026	0.029	19:39	0.038	0.04
11:14	0.032	0.04	15:29	0.023	0.026	19:44	0.032	0.033
11:19	0.027	0.033	15:34	0.022	0.026	19:49	0.027	0.028
11:24	0.029	0.034	15:39	0.019	0.023	19:54	0.024	0.025
11:29	0.031	0.037	15:44	0.018	0.022	19:59	0.022	0.023
11:34	0.029	0.034	15:49	0.018	0.021	20:04	0.021	0.021
11:39	0.027	0.032	15:54	0.016	0.019	20:09	0.019	0.019
11:44	0.025	0.03	15:59	0.014	0.016	20:14	0.019	0.02
11:49	0.026	0.031	16:04	0.013	0.015	20:19	0.023	0.025
11:54	0.027	0.033	16:09	0.012	0.013	20:24	0.02	0.021

Instrument Data			Site-12 Hall by Room 223			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:29	0.016	0.018	0:44	0.012	0.012	4:59	0.009	0.009
20:34	0.015	0.016	0:49	0.012	0.012	5:04	0.009	0.009
20:39	0.014	0.015	0:54	0.012	0.012	5:09	0.009	0.009
20:44	0.014	0.015	0:59	0.012	0.012	5:14	0.009	0.009
20:49	0.014	0.015	1:04	0.011	0.012	5:19	0.009	0.009
20:54	0.013	0.014	1:09	0.011	0.012	5:24	0.009	0.009
20:59	0.012	0.012	1:14	0.011	0.011	5:29	0.009	0.009
21:04	0.012	0.012	1:19	0.011	0.011	5:34	0.009	0.009
21:09	0.012	0.012	1:24	0.011	0.011	5:39	0.009	0.009
21:14	0.012	0.012	1:29	0.011	0.011	5:44	0.009	0.009
21:19	0.012	0.013	1:34	0.011	0.011	5:49	0.009	0.009
21:24	0.012	0.012	1:39	0.011	0.011	5:54	0.009	0.009
21:29	0.012	0.012	1:44	0.011	0.011	5:59	0.01	0.01
21:34	0.012	0.013	1:49	0.011	0.011	6:04	0.009	0.009
21:39	0.012	0.013	1:54	0.011	0.011	6:09	0.009	0.01
21:44	0.012	0.013	1:59	0.011	0.011	6:14	0.01	0.011
21:49	0.012	0.012	2:04	0.011	0.011	6:19	0.01	0.01
21:54	0.013	0.013	2:09	0.011	0.011	6:24	0.012	0.014
21:59	0.013	0.013	2:14	0.011	0.011	6:29	0.013	0.015
22:04	0.013	0.013	2:19	0.011	0.011	6:34	0.012	0.013
22:09	0.013	0.013	2:24	0.011	0.011	6:39	0.012	0.013
22:14	0.012	0.013	2:29	0.01	0.01	6:44	0.015	0.018
22:19	0.012	0.012	2:34	0.01	0.01	6:49	0.016	0.019
22:24	0.012	0.012	2:39	0.01	0.01	6:54	0.016	0.019
22:29	0.012	0.012	2:44	0.01	0.01	6:59	0.022	0.026
22:34	0.012	0.012	2:49	0.01	0.01	7:04	0.023	0.028
22:39	0.012	0.012	2:54	0.01	0.01	7:09	0.021	0.025
22:44	0.012	0.012	2:59	0.01	0.01	7:14	0.024	0.029
22:49	0.012	0.012	3:04	0.01	0.01	7:19	0.023	0.027
22:54	0.012	0.012	3:09	0.01	0.01	7:24	0.021	0.024
22:59	0.012	0.012	3:14	0.01	0.01	7:29	0.021	0.025
23:04	0.012	0.012	3:19	0.01	0.01	7:34	0.03	0.038
23:09	0.012	0.012	3:24	0.009	0.01	7:39	0.026	0.033
23:14	0.012	0.012	3:29	0.01	0.01			
23:19	0.012	0.012	3:34	0.009	0.009			
23:24	0.012	0.012	3:39	0.009	0.009			
23:29	0.012	0.012	3:44	0.009	0.009			
23:34	0.012	0.012	3:49	0.009	0.009			
23:39	0.012	0.012	3:54	0.009	0.009			
23:44	0.012	0.012	3:59	0.009	0.009			
23:49	0.012	0.012	4:04	0.009	0.009			
23:54	0.013	0.013	4:09	0.009	0.009			
23:59	0.012	0.012	4:14	0.009	0.009			
0:04	0.012	0.012	4:19	0.009	0.009			
0:09	0.013	0.013	4:24	0.009	0.009			
0:14	0.013	0.013	4:29	0.009	0.009			
0:19	0.013	0.013	4:34	0.009	0.009			
0:24	0.012	0.012	4:39	0.009	0.009			
0:29	0.012	0.012	4:44	0.009	0.009			
0:34	0.012	0.012	4:49	0.009	0.009			
0:39	0.012	0.012	4:54	0.009	0.009			

Instrument Data			Site-13 Room 203			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
7:43	0.028	0.048	11:58	0.041	0.066	16:13	0.025	0.04			
7:48	0.031	0.054	12:03	0.037	0.059	16:18	0.025	0.039			
7:53	0.032	0.057	12:08	0.037	0.057	16:23	0.023	0.036			
7:58	0.032	0.057	12:13	0.036	0.055	16:28	0.022	0.033			
8:03	0.03	0.051	12:18	0.033	0.05	16:33	0.021	0.032			
8:08	0.029	0.049	12:23	0.032	0.048	16:38	0.02	0.03			
8:13	0.027	0.045	12:28	0.031	0.045	16:43	0.02	0.028			
8:18	0.026	0.043	12:33	0.03	0.044	16:48	0.019	0.027			
8:23	0.024	0.037	12:38	0.03	0.042	16:53	0.018	0.025			
8:28	0.023	0.036	12:43	0.028	0.04	16:58	0.017	0.024			
8:33	0.022	0.034	12:48	0.03	0.043	17:03	0.017	0.022			
8:38	0.021	0.033	12:53	0.029	0.042	17:08	0.016	0.022			
8:43	0.021	0.033	12:58	0.027	0.038	17:13	0.015	0.02			
8:48	0.023	0.038	13:03	0.027	0.039	17:18	0.015	0.02			
8:53	0.023	0.037	13:08	0.028	0.041	17:23	0.015	0.019			
8:58	0.025	0.04	13:13	0.028	0.044	17:28	0.014	0.019			
9:03	0.029	0.049	13:18	0.028	0.044	17:33	0.014	0.019			
9:08	0.025	0.041	13:23	0.028	0.044	17:38	0.014	0.019			
9:13	0.024	0.041	13:28	0.028	0.043	17:43	0.014	0.019			
9:18	0.024	0.041	13:33	0.026	0.04	17:48	0.014	0.02			
9:23	0.023	0.039	13:38	0.026	0.04	17:53	0.014	0.02			
9:28	0.023	0.039	13:43	0.026	0.039	17:58	0.013	0.02			
9:33	0.025	0.043	13:48	0.025	0.037	18:03	0.013	0.018			
9:38	0.023	0.039	13:53	0.024	0.037	18:08	0.013	0.019			
9:43	0.023	0.038	13:58	0.029	0.046	18:13	0.013	0.018			
9:48	0.023	0.037	14:03	0.034	0.059	18:18	0.012	0.017			
9:53	0.023	0.037	14:08	0.035	0.064	18:23	0.012	0.017			
9:58	0.022	0.037	14:13	0.036	0.067	18:28	0.012	0.017			
10:03	0.02	0.032	14:18	0.035	0.062	18:33	0.012	0.017			
10:08	0.02	0.031	14:23	0.035	0.063	18:38	0.012	0.017			
10:13	0.02	0.031	14:28	0.117	0.266	18:43	0.011	0.015			
10:18	0.019	0.029	14:33	0.111	0.271	18:48	0.011	0.015			
10:23	0.019	0.03	14:38	0.087	0.212	18:53	0.012	0.015			
10:28	0.019	0.03	14:43	0.074	0.178	18:58	0.012	0.015			
10:33	0.02	0.03	14:48	0.063	0.148	19:03	0.012	0.015			
10:38	0.02	0.031	14:53	0.056	0.132	19:08	0.015	0.02			
10:43	0.02	0.032	14:58	0.048	0.108	19:13	0.016	0.023			
10:48	0.02	0.032	15:03	0.042	0.09	19:18	0.013	0.017			
10:53	0.02	0.032	15:08	0.041	0.088	19:23	0.014	0.019			
10:58	0.021	0.033	15:13	0.039	0.082	19:28	0.016	0.021			
11:03	0.021	0.033	15:18	0.038	0.076	19:33	0.017	0.023			
11:08	0.02	0.031	15:23	0.034	0.066	19:38	0.018	0.023			
11:13	0.02	0.031	15:28	0.032	0.06	19:43	0.021	0.026			
11:18	0.026	0.04	15:33	0.03	0.054	19:48	0.022	0.028			
11:23	0.03	0.048	15:38	0.029	0.05	19:53	0.02	0.026			
11:28	0.037	0.059	15:43	0.033	0.058	19:58	0.019	0.024			
11:33	0.038	0.061	15:48	0.033	0.058	20:03	0.02	0.024			
11:38	0.037	0.057	15:53	0.032	0.056	20:08	0.019	0.023			
11:43	0.036	0.055	15:58	0.031	0.053	20:13	0.019	0.023			
11:48	0.04	0.064	16:03	0.029	0.048	20:18	0.019	0.022			
11:53	0.04	0.064	16:08	0.027	0.043	20:23	0.019	0.023			

Instrument Data			Site-13 Room 203			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
20:28	0.019	0.022	0:43	0.012	0.012	4:58	0.007	0.007			
20:33	0.019	0.022	0:48	0.012	0.012	5:03	0.007	0.007			
20:38	0.019	0.022	0:53	0.012	0.012	5:08	0.007	0.007			
20:43	0.018	0.021	0:58	0.012	0.012	5:13	0.007	0.007			
20:48	0.018	0.021	1:03	0.012	0.012	5:18	0.007	0.007			
20:53	0.018	0.021	1:08	0.012	0.012	5:23	0.007	0.007			
20:58	0.018	0.021	1:13	0.011	0.012	5:28	0.007	0.007			
21:03	0.018	0.02	1:18	0.011	0.012	5:33	0.007	0.007			
21:08	0.018	0.02	1:23	0.011	0.011	5:38	0.007	0.007			
21:13	0.017	0.02	1:28	0.011	0.011	5:43	0.007	0.007			
21:18	0.017	0.019	1:33	0.011	0.011	5:48	0.007	0.007			
21:23	0.016	0.019	1:38	0.011	0.011	5:53	0.007	0.007			
21:28	0.015	0.017	1:43	0.011	0.011	5:58	0.007	0.007			
21:33	0.015	0.017	1:48	0.011	0.011	6:03	0.007	0.007			
21:38	0.015	0.017	1:53	0.011	0.011	6:08	0.007	0.007			
21:43	0.015	0.017	1:58	0.011	0.011	6:13	0.007	0.007			
21:48	0.015	0.016	2:03	0.011	0.011	6:18	0.007	0.007			
21:53	0.015	0.016	2:08	0.011	0.011	6:23	0.007	0.007			
21:58	0.015	0.016	2:13	0.011	0.011	6:28	0.007	0.007			
22:03	0.015	0.016	2:18	0.011	0.011	6:33	0.007	0.007			
22:08	0.014	0.015	2:23	0.011	0.011	6:38	0.007	0.008			
22:13	0.014	0.015	2:28	0.011	0.011	6:43	0.007	0.008			
22:18	0.014	0.015	2:33	0.011	0.011	6:48	0.007	0.008			
22:23	0.014	0.015	2:38	0.01	0.011	6:53	0.008	0.009			
22:28	0.014	0.015	2:43	0.01	0.01	6:58	0.008	0.009			
22:33	0.014	0.014	2:48	0.01	0.01	7:03	0.008	0.009			
22:38	0.013	0.014	2:53	0.01	0.01	7:08	0.008	0.009			
22:43	0.013	0.014	2:58	0.01	0.01	7:13	0.009	0.011			
22:48	0.013	0.014	3:03	0.01	0.01	7:18	0.009	0.012			
22:53	0.013	0.014	3:08	0.01	0.01	7:23	0.011	0.016			
22:58	0.013	0.014	3:13	0.01	0.01	7:28	0.021	0.034			
23:03	0.013	0.013	3:18	0.01	0.01	7:33	0.025	0.042			
23:08	0.013	0.013	3:23	0.01	0.01	7:38	0.026	0.045			
23:13	0.012	0.013	3:28	0.01	0.01						
23:18	0.012	0.013	3:33	0.01	0.01						
23:23	0.012	0.013	3:38	0.01	0.01						
23:28	0.012	0.013	3:43	0.009	0.01						
23:33	0.012	0.013	3:48	0.009	0.009						
23:38	0.012	0.013	3:53	0.009	0.009						
23:43	0.012	0.012	3:58	0.009	0.009						
23:48	0.012	0.012	4:03	0.009	0.009						
23:53	0.012	0.012	4:08	0.009	0.009						
23:58	0.012	0.012	4:13	0.009	0.009						
0:03	0.012	0.012	4:18	0.008	0.009						
0:08	0.012	0.012	4:23	0.008	0.008						
0:13	0.012	0.012	4:28	0.008	0.008						
0:18	0.012	0.012	4:33	0.008	0.008						
0:23	0.012	0.012	4:38	0.008	0.008						
0:28	0.012	0.012	4:43	0.008	0.008						
0:33	0.012	0.012	4:48	0.008	0.008						
0:38	0.012	0.012	4:53	0.007	0.008						

Instrument Data			Site-14 Hall by Room 207			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
7:46	0.041	0.069	12:01	0.061	0.087	16:16	0.015	0.027			
7:51	0.04	0.069	12:06	0.055	0.084	16:21	0.013	0.023			
7:56	0.035	0.06	12:11	0.061	0.092	16:26	0.016	0.027			
8:01	0.033	0.055	12:16	0.056	0.086	16:31	0.014	0.025			
8:06	0.033	0.055	12:21	0.05	0.075	16:36	0.012	0.019			
8:11	0.029	0.047	12:26	0.045	0.066	16:41	0.011	0.016			
8:16	0.024	0.036	12:31	0.038	0.058	16:46	0.01	0.015			
8:21	0.022	0.033	12:36	0.033	0.049	16:51	0.009	0.013			
8:26	0.024	0.038	12:41	0.03	0.046	16:56	0.009	0.013			
8:31	0.022	0.035	12:46	0.037	0.061	17:01	0.009	0.012			
8:36	0.021	0.032	12:51	0.046	0.081	17:06	0.008	0.011			
8:41	0.022	0.032	12:56	0.041	0.074	17:11	0.009	0.013			
8:46	0.019	0.028	13:01	0.034	0.064	17:16	0.01	0.016			
8:51	0.024	0.04	13:06	0.03	0.053	17:21	0.008	0.012			
8:56	0.039	0.067	13:11	0.034	0.062	17:26	0.007	0.01			
9:01	0.055	0.098	13:16	0.035	0.064	17:31	0.007	0.01			
9:06	0.048	0.092	13:21	0.031	0.056	17:36	0.01	0.014			
9:11	0.04	0.075	13:26	0.03	0.052	17:41	0.01	0.015			
9:16	0.027	0.049	13:31	0.03	0.053	17:46	0.01	0.015			
9:21	0.025	0.044	13:36	0.027	0.05	17:51	0.009	0.014			
9:26	0.029	0.054	13:41	0.031	0.057	17:56	0.01	0.015			
9:31	0.028	0.051	13:46	0.034	0.062	18:01	0.01	0.018			
9:36	0.027	0.048	13:51	0.042	0.071	18:06	0.014	0.026			
9:41	0.022	0.038	13:56	0.041	0.071	18:11	0.014	0.026			
9:46	0.019	0.03	14:01	0.037	0.069	18:16	0.011	0.019			
9:51	0.016	0.023	14:06	0.041	0.073	18:21	0.01	0.018			
9:56	0.019	0.027	14:11	0.033	0.058	18:26	0.01	0.015			
10:01	0.024	0.032	14:16	0.036	0.061	18:31	0.01	0.015			
10:06	0.036	0.048	14:21	0.04	0.067	18:36	0.01	0.014			
10:11	0.037	0.057	14:26	0.044	0.079	18:41	0.01	0.014			
10:16	0.074	0.133	14:31	0.065	0.131	18:46	0.011	0.015			
10:21	0.066	0.118	14:36	0.042	0.08	18:51	0.017	0.026			
10:26	0.054	0.099	14:41	0.022	0.033	18:56	0.018	0.031			
10:31	0.056	0.103	14:46	0.017	0.025	19:01	0.016	0.022			
10:36	0.072	0.137	14:51	0.017	0.023	19:06	0.02	0.03			
10:41	0.06	0.117	14:56	0.018	0.024	19:11	0.044	0.08			
10:46	0.053	0.095	15:01	0.024	0.036	19:16	0.076	0.149			
10:51	0.055	0.087	15:06	0.051	0.06	19:21	0.086	0.172			
10:56	0.042	0.06	15:11	0.079	0.089	19:26	0.09	0.173			
11:01	0.037	0.053	15:16	0.048	0.058	19:31	0.068	0.123			
11:06	0.025	0.036	15:21	0.043	0.053	19:36	0.051	0.085			
11:11	0.027	0.037	15:26	0.071	0.084	19:41	0.054	0.084			
11:16	0.034	0.045	15:31	0.082	0.105	19:46	0.049	0.07			
11:21	0.03	0.043	15:36	0.052	0.079	19:51	0.045	0.061			
11:26	0.031	0.043	15:41	0.032	0.056	19:56	0.039	0.05			
11:31	0.033	0.043	15:46	0.028	0.049	20:01	0.035	0.045			
11:36	0.027	0.036	15:51	0.025	0.046	20:06	0.03	0.037			
11:41	0.03	0.042	15:56	0.019	0.034	20:11	0.028	0.035			
11:46	0.03	0.043	16:01	0.018	0.032	20:16	0.025	0.03			
11:51	0.028	0.043	16:06	0.017	0.031	20:21	0.023	0.027			
11:56	0.058	0.072	16:11	0.017	0.03	20:26	0.021	0.024			

Instrument Data			Site-14 Hall by Room 207			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
20:31	0.02	0.024	0:46	0.015	0.015	5:01	0.01	0.011
20:36	0.018	0.022	0:51	0.015	0.016	5:06	0.01	0.011
20:41	0.017	0.022	0:56	0.015	0.015	5:11	0.01	0.01
20:46	0.016	0.02	1:01	0.014	0.015	5:16	0.011	0.011
20:51	0.015	0.019	1:06	0.014	0.014	5:21	0.011	0.011
20:56	0.015	0.019	1:11	0.014	0.014	5:26	0.01	0.011
21:01	0.014	0.019	1:16	0.014	0.014	5:31	0.011	0.011
21:06	0.014	0.018	1:21	0.014	0.014	5:36	0.01	0.011
21:11	0.014	0.018	1:26	0.013	0.014	5:41	0.01	0.011
21:16	0.014	0.018	1:31	0.013	0.013	5:46	0.01	0.011
21:21	0.015	0.018	1:36	0.013	0.013	5:51	0.01	0.011
21:26	0.016	0.02	1:41	0.013	0.013	5:56	0.011	0.011
21:31	0.016	0.019	1:46	0.013	0.013	6:01	0.011	0.011
21:36	0.016	0.019	1:51	0.013	0.013	6:06	0.011	0.011
21:41	0.016	0.019	1:56	0.013	0.013	6:11	0.011	0.011
21:46	0.016	0.019	2:01	0.013	0.013	6:16	0.011	0.011
21:51	0.016	0.019	2:06	0.013	0.014	6:21	0.011	0.012
21:56	0.016	0.019	2:11	0.013	0.013	6:26	0.011	0.012
22:01	0.016	0.018	2:16	0.013	0.013	6:31	0.012	0.013
22:06	0.016	0.018	2:21	0.013	0.013	6:36	0.014	0.019
22:11	0.016	0.018	2:26	0.012	0.013	6:41	0.015	0.022
22:16	0.015	0.017	2:31	0.012	0.012	6:46	0.015	0.021
22:21	0.015	0.017	2:36	0.012	0.012	6:51	0.015	0.021
22:26	0.015	0.016	2:41	0.012	0.012	6:56	0.015	0.021
22:31	0.014	0.016	2:46	0.012	0.012	7:01	0.015	0.021
22:36	0.014	0.016	2:51	0.012	0.012	7:06	0.016	0.022
22:41	0.014	0.015	2:56	0.012	0.012	7:11	0.018	0.026
22:46	0.014	0.015	3:01	0.011	0.012	7:16	0.02	0.032
22:51	0.014	0.015	3:06	0.011	0.012	7:21	0.026	0.043
22:56	0.014	0.015	3:11	0.011	0.011	7:26	0.039	0.076
23:01	0.014	0.015	3:16	0.011	0.012	7:31	0.074	0.167
23:06	0.014	0.015	3:21	0.011	0.012	7:36	0.109	0.26
23:11	0.014	0.015	3:26	0.011	0.011	7:41	0.089	0.194
23:16	0.014	0.015	3:31	0.011	0.011			
23:21	0.014	0.015	3:36	0.011	0.011			
23:26	0.014	0.015	3:41	0.011	0.011			
23:31	0.014	0.015	3:46	0.011	0.011			
23:36	0.014	0.014	3:51	0.011	0.011			
23:41	0.014	0.015	3:56	0.011	0.011			
23:46	0.014	0.014	4:01	0.011	0.011			
23:51	0.014	0.015	4:06	0.011	0.011			
23:56	0.014	0.015	4:11	0.011	0.011			
0:01	0.014	0.015	4:16	0.011	0.011			
0:06	0.015	0.015	4:21	0.011	0.011			
0:11	0.015	0.016	4:26	0.01	0.011			
0:16	0.015	0.016	4:31	0.01	0.011			
0:21	0.015	0.016	4:36	0.01	0.01			
0:26	0.016	0.016	4:41	0.01	0.01			
0:31	0.016	0.016	4:46	0.01	0.01			
0:36	0.015	0.016	4:51	0.01	0.01			
0:41	0.015	0.015	4:56	0.01	0.01			

Instrument Data			Site-15 Room 215			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
7:52	0.011	0.025	12:07	0.026	0.03	16:22	0.018	0.029			
7:57	0.014	0.027	12:12	0.026	0.031	16:27	0.016	0.025			
8:02	0.015	0.03	12:17	0.028	0.033	16:32	0.015	0.024			
8:07	0.014	0.021	12:22	0.028	0.032	16:37	0.014	0.023			
8:12	0.013	0.017	12:27	0.029	0.032	16:42	0.014	0.022			
8:17	0.013	0.015	12:32	0.029	0.032	16:47	0.013	0.023			
8:22	0.012	0.014	12:37	0.029	0.032	16:52	0.012	0.022			
8:27	0.012	0.014	12:42	0.029	0.035	16:57	0.011	0.017			
8:32	0.014	0.018	12:47	0.029	0.035	17:02	0.01	0.016			
8:37	0.014	0.021	12:52	0.029	0.049	17:07	0.01	0.015			
8:42	0.014	0.021	12:57	0.029	0.054	17:12	0.01	0.014			
8:47	0.014	0.02	13:02	0.026	0.05	17:17	0.009	0.013			
8:52	0.014	0.02	13:07	0.026	0.052	17:22	0.009	0.013			
8:57	0.013	0.016	13:12	0.024	0.047	17:27	0.009	0.012			
9:02	0.013	0.015	13:17	0.024	0.035	17:32	0.008	0.011			
9:07	0.013	0.015	13:22	0.022	0.031	17:37	0.008	0.011			
9:12	0.013	0.015	13:27	0.021	0.026	17:42	0.008	0.013			
9:17	0.012	0.015	13:32	0.019	0.025	17:47	0.008	0.01			
9:22	0.012	0.015	13:37	0.019	0.021	17:52	0.008	0.009			
9:27	0.012	0.014	13:42	0.017	0.022	17:57	0.008	0.009			
9:32	0.012	0.014	13:47	0.016	0.019	18:02	0.008	0.009			
9:37	0.012	0.014	13:52	0.016	0.019	18:07	0.007	0.008			
9:42	0.012	0.015	13:57	0.016	0.022	18:12	0.007	0.008			
9:47	0.012	0.014	14:02	0.017	0.03	18:17	0.007	0.008			
9:52	0.013	0.014	14:07	0.018	0.031	18:22	0.007	0.007			
9:57	0.013	0.013	14:12	0.017	0.031	18:27	0.007	0.008			
10:02	0.012	0.014	14:17	0.018	0.031	18:32	0.007	0.007			
10:07	0.012	0.014	14:22	0.019	0.029	18:37	0.007	0.009			
10:12	0.012	0.013	14:27	0.019	0.03	18:42	0.007	0.008			
10:17	0.012	0.013	14:32	0.021	0.031	18:47	0.007	0.007			
10:22	0.012	0.014	14:37	0.02	0.031	18:52	0.007	0.007			
10:27	0.013	0.015	14:42	0.02	0.026	18:57	0.008	0.007			
10:32	0.014	0.018	14:47	0.019	0.026	19:02	0.008	0.008			
10:37	0.015	0.019	14:52	0.019	0.024	19:07	0.009	0.009			
10:42	0.015	0.021	14:57	0.02	0.025	19:12	0.01	0.01			
10:47	0.016	0.021	15:02	0.022	0.026	19:17	0.011	0.011			
10:52	0.017	0.022	15:07	0.023	0.027	19:22	0.012	0.012			
10:57	0.017	0.024	15:12	0.024	0.046	19:27	0.013	0.013			
11:02	0.017	0.023	15:17	0.026	0.055	19:32	0.014	0.014			
11:07	0.017	0.023	15:22	0.031	0.048	19:37	0.016	0.016			
11:12	0.018	0.023	15:27	0.032	0.047	19:42	0.018	0.019			
11:17	0.019	0.027	15:32	0.035	0.046	19:47	0.021	0.023			
11:22	0.021	0.026	15:37	0.046	0.112	19:52	0.023	0.025			
11:27	0.022	0.028	15:42	0.045	0.089	19:57	0.026	0.027			
11:32	0.023	0.028	15:47	0.048	0.069	20:02	0.027	0.028			
11:37	0.023	0.029	15:52	0.042	0.057	20:07	0.028	0.029			
11:42	0.023	0.028	15:57	0.037	0.079	20:12	0.028	0.029			
11:47	0.024	0.029	16:02	0.031	0.058	20:17	0.027	0.028			
11:52	0.024	0.029	16:07	0.027	0.045	20:22	0.027	0.027			
11:57	0.026	0.031	16:12	0.023	0.04	20:27	0.025	0.025			
12:02	0.026	0.03	16:17	0.02	0.031	20:32	0.025	0.024			

Instrument Data			Site-15 Room 215			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
20:37	0.024	0.023	0:52	0.011	0.01	5:07	0.009	0.008			
20:42	0.023	0.022	0:57	0.011	0.01	5:12	0.009	0.008			
20:47	0.021	0.02	1:02	0.011	0.01	5:17	0.009	0.008			
20:52	0.02	0.019	1:07	0.011	0.01	5:22	0.01	0.008			
20:57	0.019	0.018	1:12	0.011	0.01	5:27	0.009	0.008			
21:02	0.018	0.017	1:17	0.011	0.01	5:32	0.009	0.008			
21:07	0.017	0.016	1:22	0.011	0.01	5:37	0.009	0.008			
21:12	0.016	0.015	1:27	0.011	0.01	5:42	0.009	0.008			
21:17	0.016	0.015	1:32	0.011	0.01	5:47	0.009	0.008			
21:22	0.015	0.014	1:37	0.011	0.01	5:52	0.009	0.008			
21:27	0.015	0.013	1:42	0.011	0.01	5:57	0.009	0.008			
21:32	0.014	0.013	1:47	0.011	0.01	6:02	0.009	0.008			
21:37	0.014	0.013	1:52	0.011	0.01	6:07	0.009	0.008			
21:42	0.013	0.012	1:57	0.011	0.01	6:12	0.009	0.008			
21:47	0.013	0.012	2:02	0.011	0.01	6:17	0.009	0.008			
21:52	0.013	0.011	2:07	0.011	0.01	6:22	0.009	0.008			
21:57	0.012	0.011	2:12	0.011	0.01	6:27	0.009	0.008			
22:02	0.012	0.011	2:17	0.011	0.01	6:32	0.009	0.008			
22:07	0.012	0.011	2:22	0.011	0.01	6:37	0.009	0.008			
22:12	0.012	0.011	2:27	0.011	0.01	6:42	0.009	0.008			
22:17	0.012	0.011	2:32	0.011	0.01	6:47	0.009	0.008			
22:22	0.012	0.011	2:37	0.011	0.01	6:52	0.009	0.008			
22:27	0.012	0.01	2:42	0.011	0.01	6:57	0.009	0.008			
22:32	0.012	0.01	2:47	0.011	0.009	7:02	0.009	0.008			
22:37	0.012	0.011	2:52	0.011	0.009	7:07	0.009	0.009			
22:42	0.012	0.01	2:57	0.011	0.009	7:12	0.01	0.009			
22:47	0.011	0.01	3:02	0.011	0.009	7:17	0.01	0.009			
22:52	0.011	0.01	3:07	0.011	0.009	7:22	0.01	0.009			
22:57	0.011	0.01	3:12	0.01	0.009	7:27	0.01	0.01			
23:02	0.011	0.01	3:17	0.01	0.009	7:32	0.01	0.01			
23:07	0.011	0.01	3:22	0.01	0.009	7:37	0.012	0.014			
23:12	0.011	0.01	3:27	0.01	0.009	7:42	0.013	0.024			
23:17	0.011	0.01	3:32	0.01	0.009	7:47	0.014	0.022			
23:22	0.011	0.01	3:37	0.01	0.009						
23:27	0.011	0.01	3:42	0.01	0.009						
23:32	0.011	0.01	3:47	0.01	0.009						
23:37	0.011	0.01	3:52	0.01	0.009						
23:42	0.011	0.01	3:57	0.01	0.009						
23:47	0.011	0.01	4:02	0.01	0.009						
23:52	0.011	0.01	4:07	0.01	0.009						
23:57	0.011	0.01	4:12	0.01	0.009						
0:02	0.012	0.01	4:17	0.01	0.008						
0:07	0.011	0.01	4:22	0.01	0.008						
0:12	0.011	0.01	4:27	0.01	0.008						
0:17	0.011	0.01	4:32	0.01	0.008						
0:22	0.011	0.01	4:37	0.01	0.008						
0:27	0.011	0.01	4:42	0.01	0.008						
0:32	0.011	0.01	4:47	0.01	0.008						
0:37	0.011	0.01	4:52	0.009	0.008						
0:42	0.011	0.01	4:57	0.009	0.008						
0:47	0.011	0.01	5:02	0.009	0.008						

Instrument Data			Site-16 Room 209			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
9:08	0.04	0.078	13:23	0.022	0.039	17:38	0.009	0.003
9:13	0.042	0.085	13:28	0.041	0.089	17:43	0.009	0.004
9:18	0.042	0.076	13:33	0.056	0.135	17:48	0.009	0.004
9:23	0.042	0.067	13:38	0.066	0.163	17:53	0.009	0.004
9:28	0.034	0.058	13:43	0.074	0.18	17:58	0.009	0.003
9:33	0.032	0.049	13:48	0.071	0.168	18:03	0.009	0.004
9:38	0.029	0.041	13:53	0.073	0.166	18:08	0.009	0.006
9:43	0.027	0.034	13:58	0.104	0.197	18:13	0.009	0.007
9:48	0.026	0.035	14:03	0.121	0.209	18:18	0.009	0.007
9:53	0.029	0.045	14:08	0.123	0.21	18:23	0.009	0.006
9:58	0.037	0.07	14:13	0.124	0.199	18:28	0.009	0.005
10:03	0.06	0.132	14:18	0.128	0.212	18:33	0.009	0.004
10:08	0.087	0.215	14:23	0.094	0.156	18:38	0.009	0.004
10:13	0.108	0.262	14:28	0.061	0.116	18:43	0.01	0.005
10:18	0.101	0.239	14:33	0.041	0.103	18:48	0.011	0.005
10:23	0.063	0.147	14:38	0.047	0.103	18:53	0.012	0.006
10:28	0.047	0.117	14:43	0.05	0.104	18:58	0.012	0.009
10:33	0.053	0.143	14:48	0.051	0.107	19:03	0.015	0.011
10:38	0.082	0.261	14:53	0.052	0.109	19:08	0.014	0.01
10:43	0.099	0.294	14:58	0.051	0.108	19:13	0.015	0.013
10:48	0.113	0.305	15:03	0.053	0.114	19:18	0.02	0.029
10:53	0.108	0.284	15:08	0.055	0.115	19:23	0.026	0.049
10:58	0.104	0.261	15:13	0.056	0.119	19:28	0.03	0.059
11:03	0.099	0.235	15:18	0.058	0.124	19:33	0.034	0.061
11:08	0.09	0.201	15:23	0.058	0.131	19:38	0.034	0.056
11:13	0.078	0.169	15:28	0.058	0.125	19:43	0.031	0.043
11:18	0.072	0.148	15:33	0.056	0.119	19:48	0.03	0.038
11:23	0.07	0.153	15:38	0.054	0.114	19:53	0.029	0.032
11:28	0.066	0.141	15:43	0.048	0.097	19:58	0.027	0.028
11:33	0.06	0.123	15:48	0.034	0.069	20:03	0.026	0.026
11:38	0.057	0.116	15:53	0.027	0.053	20:08	0.025	0.023
11:43	0.063	0.143	15:58	0.018	0.032	20:13	0.023	0.02
11:48	0.068	0.158	16:03	0.014	0.02	20:18	0.021	0.018
11:53	0.07	0.166	16:08	0.013	0.015	20:23	0.02	0.016
11:58	0.073	0.172	16:13	0.013	0.014	20:28	0.019	0.014
12:03	0.07	0.158	16:18	0.013	0.014	20:33	0.018	0.014
12:08	0.066	0.139	16:23	0.012	0.011	20:38	0.017	0.014
12:13	0.059	0.12	16:28	0.011	0.01	20:43	0.016	0.012
12:18	0.053	0.101	16:33	0.012	0.011	20:48	0.016	0.012
12:23	0.047	0.084	16:38	0.011	0.009	20:53	0.015	0.01
12:28	0.041	0.068	16:43	0.011	0.009	20:58	0.015	0.009
12:33	0.035	0.056	16:48	0.011	0.007	21:03	0.015	0.009
12:38	0.03	0.044	16:53	0.01	0.006	21:08	0.014	0.008
12:43	0.026	0.034	16:58	0.01	0.005	21:13	0.014	0.008
12:48	0.023	0.03	17:03	0.01	0.005	21:18	0.014	0.008
12:53	0.021	0.028	17:08	0.009	0.004	21:23	0.016	0.01
12:58	0.021	0.031	17:13	0.009	0.004	21:28	0.017	0.012
13:03	0.022	0.034	17:18	0.009	0.004	21:33	0.018	0.013
13:08	0.021	0.033	17:23	0.009	0.005	21:38	0.019	0.013
13:13	0.02	0.032	17:28	0.009	0.004	21:43	0.019	0.013
13:18	0.02	0.031	17:33	0.009	0.003	21:48	0.019	0.013

Instrument Data			Site-16 Room 209			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
21:53	0.019	0.013	2:08	0.013	0.006	6:23	0.011	0.004			
21:58	0.019	0.012	2:13	0.013	0.006	6:28	0.011	0.005			
22:03	0.019	0.012	2:18	0.013	0.006	6:33	0.011	0.005			
22:08	0.018	0.012	2:23	0.013	0.006	6:38	0.011	0.006			
22:13	0.018	0.012	2:28	0.012	0.006	6:43	0.012	0.007			
22:18	0.018	0.011	2:33	0.012	0.006	6:48	0.012	0.008			
22:23	0.017	0.011	2:38	0.012	0.006	6:53	0.012	0.01			
22:28	0.017	0.011	2:43	0.012	0.006	6:58	0.012	0.012			
22:33	0.016	0.01	2:48	0.012	0.005	7:03	0.014	0.015			
22:38	0.016	0.009	2:53	0.012	0.005	7:08	0.013	0.017			
22:43	0.015	0.009	2:58	0.012	0.005	7:13	0.013	0.014			
22:48	0.015	0.009	3:03	0.012	0.005	7:18	0.013	0.016			
22:53	0.015	0.008	3:08	0.012	0.005	7:23	0.014	0.021			
22:58	0.015	0.008	3:13	0.011	0.005	7:28	0.016	0.028			
23:03	0.015	0.008	3:18	0.011	0.005	7:33	0.018	0.045			
23:08	0.014	0.008	3:23	0.011	0.005	7:38	0.025	0.112			
23:13	0.014	0.008	3:28	0.011	0.005	7:43	0.029	0.13			
23:18	0.015	0.008	3:33	0.011	0.005	7:48	0.029	0.121			
23:23	0.015	0.008	3:38	0.011	0.005	7:53	0.029	0.085			
23:28	0.015	0.008	3:43	0.011	0.005	7:58	0.031	0.073			
23:33	0.015	0.008	3:48	0.011	0.005	8:03	0.031	0.071			
23:38	0.015	0.008	3:53	0.011	0.005	8:08	0.031	0.064			
23:43	0.014	0.008	3:58	0.011	0.005	8:13	0.034	0.068			
23:48	0.014	0.008	4:03	0.011	0.004	8:18	0.039	0.099			
23:53	0.014	0.008	4:08	0.011	0.004	8:23	0.049	0.143			
23:58	0.014	0.008	4:13	0.011	0.004	8:28	0.056	0.172			
0:03	0.014	0.008	4:18	0.011	0.004	8:33	0.061	0.184			
0:08	0.015	0.008	4:23	0.011	0.004	8:38	0.063	0.179			
0:13	0.015	0.008	4:28	0.011	0.004	8:43	0.063	0.173			
0:18	0.015	0.008	4:33	0.011	0.004	8:48	0.063	0.176			
0:23	0.015	0.009	4:38	0.011	0.004	8:53	0.071	0.193			
0:28	0.015	0.009	4:43	0.01	0.004	8:58	0.079	0.223			
0:33	0.016	0.009	4:48	0.01	0.004	9:03	0.086	0.248			
0:38	0.016	0.009	4:53	0.01	0.004						
0:43	0.016	0.009	4:58	0.01	0.004						
0:48	0.015	0.009	5:03	0.01	0.004						
0:53	0.015	0.009	5:08	0.01	0.004						
0:58	0.015	0.008	5:13	0.011	0.004						
1:03	0.015	0.008	5:18	0.011	0.004						
1:08	0.014	0.008	5:23	0.011	0.004						
1:13	0.014	0.008	5:28	0.011	0.004						
1:18	0.014	0.007	5:33	0.011	0.004						
1:23	0.014	0.007	5:38	0.011	0.004						
1:28	0.013	0.007	5:43	0.011	0.004						
1:33	0.013	0.007	5:48	0.011	0.004						
1:38	0.013	0.007	5:53	0.011	0.004						
1:43	0.013	0.007	5:58	0.011	0.004						
1:48	0.013	0.006	6:03	0.011	0.004						
1:53	0.013	0.006	6:08	0.011	0.004						
1:58	0.013	0.006	6:13	0.011	0.004						
2:03	0.013	0.007	6:18	0.011	0.004						

Instrument Data			Site-17 Hall by Room 216			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
8:54	0.024	0.057	13:09	0.045	0.124	17:24	0.011	0.021			
8:59	0.028	0.065	13:14	0.04	0.109	17:29	0.012	0.025			
9:04	0.034	0.078	13:19	0.039	0.107	17:34	0.012	0.027			
9:09	0.035	0.091	13:24	0.038	0.104	17:39	0.01	0.02			
9:14	0.038	0.104	13:29	0.036	0.098	17:44	0.011	0.021			
9:19	0.041	0.103	13:34	0.04	0.107	17:49	0.01	0.021			
9:24	0.045	0.119	13:39	0.039	0.106	17:54	0.013	0.029			
9:29	0.043	0.119	13:44	0.036	0.102	17:59	0.017	0.045			
9:34	0.032	0.081	13:49	0.035	0.092	18:04	0.022	0.06			
9:39	0.028	0.07	13:54	0.042	0.103	18:09	0.014	0.034			
9:44	0.023	0.057	13:59	0.053	0.128	18:14	0.011	0.025			
9:49	0.023	0.054	14:04	0.051	0.118	18:19	0.01	0.022			
9:54	0.02	0.045	14:09	0.044	0.101	18:24	0.013	0.024			
9:59	0.021	0.045	14:14	0.04	0.09	18:29	0.017	0.026			
10:04	0.025	0.055	14:19	0.04	0.09	18:34	0.023	0.032			
10:09	0.029	0.061	14:24	0.038	0.089	18:39	0.026	0.035			
10:14	0.037	0.077	14:29	0.041	0.095	18:44	0.031	0.04			
10:19	0.054	0.121	14:34	0.037	0.089	18:49	0.034	0.042			
10:24	0.046	0.108	14:39	0.041	0.103	18:54	0.035	0.045			
10:29	0.037	0.087	14:44	0.045	0.106	18:59	0.035	0.044			
10:34	0.04	0.094	14:49	0.049	0.113	19:04	0.047	0.079			
10:39	0.048	0.115	14:54	0.061	0.148	19:09	0.06	0.118			
10:44	0.042	0.106	14:59	0.049	0.107	19:14	0.061	0.128			
10:49	0.042	0.1	15:04	0.041	0.092	19:19	0.082	0.164			
10:54	0.047	0.104	15:09	0.043	0.101	19:24	0.113	0.218			
10:59	0.051	0.098	15:14	0.064	0.114	19:29	0.12	0.219			
11:04	0.052	0.098	15:19	0.06	0.118	19:34	0.1	0.167			
11:09	0.049	0.089	15:24	0.054	0.11	19:39	0.083	0.124			
11:14	0.042	0.08	15:29	0.053	0.1	19:44	0.074	0.103			
11:19	0.043	0.08	15:34	0.061	0.101	19:49	0.062	0.084			
11:24	0.043	0.082	15:39	0.054	0.102	19:54	0.055	0.075			
11:29	0.041	0.075	15:44	0.039	0.091	19:59	0.05	0.068			
11:34	0.042	0.076	15:49	0.068	0.157	20:04	0.042	0.056			
11:39	0.041	0.072	15:54	0.035	0.084	20:09	0.037	0.048			
11:44	0.039	0.07	15:59	0.032	0.079	20:14	0.034	0.042			
11:49	0.041	0.081	16:04	0.027	0.064	20:19	0.031	0.038			
11:54	0.04	0.084	16:09	0.025	0.058	20:24	0.029	0.037			
11:59	0.051	0.109	16:14	0.021	0.05	20:29	0.03	0.043			
12:04	0.076	0.136	16:19	0.021	0.047	20:34	0.029	0.045			
12:09	0.085	0.146	16:24	0.02	0.046	20:39	0.026	0.041			
12:14	0.07	0.132	16:29	0.022	0.05	20:44	0.032	0.064			
12:19	0.056	0.11	16:34	0.02	0.046	20:49	0.041	0.093			
12:24	0.047	0.1	16:39	0.018	0.039	20:54	0.03	0.064			
12:29	0.041	0.086	16:44	0.017	0.039	20:59	0.024	0.047			
12:34	0.038	0.08	16:49	0.015	0.035	21:04	0.02	0.039			
12:39	0.036	0.079	16:54	0.014	0.031	21:09	0.018	0.032			
12:44	0.041	0.092	16:59	0.014	0.031	21:14	0.018	0.029			
12:49	0.059	0.136	17:04	0.015	0.031	21:19	0.016	0.026			
12:54	0.048	0.123	17:09	0.014	0.028	21:24	0.016	0.025			
12:59	0.042	0.11	17:14	0.012	0.024	21:29	0.015	0.022			
13:04	0.038	0.096	17:19	0.012	0.023	21:34	0.015	0.021			

Instrument Data			Site-17 Hall by Room 216			12/9-10/2010			AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³			
21:39	0.016	0.022	1:54	0.013	0.014	6:09	0.011	0.012			
21:44	0.015	0.02	1:59	0.013	0.014	6:14	0.011	0.012			
21:49	0.015	0.02	2:04	0.014	0.014	6:19	0.011	0.012			
21:54	0.015	0.02	2:09	0.014	0.014	6:24	0.011	0.013			
21:59	0.015	0.019	2:14	0.014	0.014	6:29	0.012	0.014			
22:04	0.015	0.02	2:19	0.014	0.014	6:34	0.013	0.015			
22:09	0.015	0.019	2:24	0.013	0.014	6:39	0.012	0.015			
22:14	0.015	0.019	2:29	0.013	0.014	6:44	0.013	0.017			
22:19	0.015	0.018	2:34	0.013	0.014	6:49	0.013	0.018			
22:24	0.015	0.018	2:39	0.013	0.013	6:54	0.014	0.021			
22:29	0.015	0.017	2:44	0.013	0.013	6:59	0.014	0.021			
22:34	0.015	0.017	2:49	0.012	0.013	7:04	0.017	0.029			
22:39	0.014	0.017	2:54	0.012	0.013	7:09	0.02	0.038			
22:44	0.014	0.016	2:59	0.012	0.013	7:14	0.027	0.062			
22:49	0.014	0.016	3:04	0.012	0.013	7:19	0.034	0.084			
22:54	0.014	0.016	3:09	0.012	0.013	7:24	0.032	0.076			
22:59	0.014	0.016	3:14	0.012	0.012	7:29	0.031	0.072			
23:04	0.014	0.016	3:19	0.012	0.012	7:34	0.032	0.073			
23:09	0.014	0.016	3:24	0.012	0.012	7:39	0.032	0.072			
23:14	0.014	0.016	3:29	0.012	0.012	7:44	0.041	0.097			
23:19	0.014	0.016	3:34	0.012	0.012	7:49	0.044	0.103			
23:24	0.014	0.016	3:39	0.011	0.012	7:54	0.037	0.085			
23:29	0.015	0.016	3:44	0.011	0.012	7:59	0.035	0.079			
23:34	0.015	0.016	3:49	0.011	0.012	8:04	0.037	0.088			
23:39	0.014	0.016	3:54	0.011	0.012	8:09	0.034	0.075			
23:44	0.014	0.016	3:59	0.011	0.011	8:14	0.031	0.07			
23:49	0.014	0.016	4:04	0.011	0.011	8:19	0.032	0.073			
23:54	0.014	0.015	4:09	0.011	0.012	8:24	0.033	0.079			
23:59	0.014	0.015	4:14	0.011	0.011	8:29	0.034	0.083			
0:04	0.014	0.016	4:19	0.011	0.011	8:34	0.033	0.078			
0:09	0.015	0.016	4:24	0.011	0.011	8:39	0.036	0.085			
0:14	0.015	0.016	4:29	0.011	0.011	8:44	0.046	0.096			
0:19	0.015	0.016	4:34	0.011	0.011	8:49	0.04	0.075			
0:24	0.015	0.016	4:39	0.01	0.011						
0:29	0.015	0.016	4:44	0.01	0.011						
0:34	0.015	0.016	4:49	0.011	0.011						
0:39	0.015	0.016	4:54	0.011	0.011						
0:44	0.015	0.016	4:59	0.011	0.011						
0:49	0.015	0.016	5:04	0.01	0.011						
0:54	0.015	0.016	5:09	0.011	0.011						
0:59	0.014	0.015	5:14	0.011	0.012						
1:04	0.015	0.015	5:19	0.011	0.011						
1:09	0.014	0.015	5:24	0.011	0.011						
1:14	0.014	0.015	5:29	0.011	0.011						
1:19	0.014	0.015	5:34	0.011	0.011						
1:24	0.014	0.014	5:39	0.011	0.011						
1:29	0.014	0.014	5:44	0.011	0.011						
1:34	0.014	0.014	5:49	0.011	0.011						
1:39	0.013	0.014	5:54	0.011	0.011						
1:44	0.013	0.014	5:59	0.011	0.011						
1:49	0.013	0.014	6:04	0.011	0.012						

Instrument Data			Site-18 Hall by Room 6			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
9:12	0.011	0.02	13:27	0.007	0.015	17:42	0.009	0.015
9:17	0.01	0.018	13:32	0.008	0.015	17:47	0.009	0.016
9:22	0.008	0.014	13:37	0.024	0.044	17:52	0.01	0.023
9:27	0.008	0.012	13:42	0.022	0.034	17:57	0.009	0.021
9:32	0.009	0.015	13:47	0.015	0.026	18:02	0.008	0.015
9:37	0.009	0.016	13:52	0.02	0.039	18:07	0.007	0.012
9:42	0.011	0.022	13:57	0.023	0.048	18:12	0.007	0.014
9:47	0.016	0.034	14:02	0.02	0.042	18:17	0.007	0.013
9:52	0.033	0.102	14:07	0.017	0.031	18:22	0.006	0.011
9:57	0.086	0.271	14:12	0.015	0.025	18:27	0.006	0.009
10:02	0.084	0.239	14:17	0.014	0.025	18:32	0.006	0.009
10:07	0.048	0.115	14:22	0.011	0.019	18:37	0.007	0.012
10:12	0.025	0.059	14:27	0.01	0.016	18:42	0.009	0.016
10:17	0.017	0.042	14:32	0.014	0.02	18:47	0.012	0.024
10:22	0.012	0.026	14:37	0.011	0.016	18:52	0.011	0.017
10:27	0.013	0.028	14:42	0.013	0.017	18:57	0.02	0.049
10:32	0.03	0.062	14:47	0.013	0.017	19:02	0.041	0.122
10:37	0.036	0.07	14:52	0.013	0.017	19:07	0.088	0.261
10:42	0.077	0.102	14:57	0.055	0.06	19:12	0.114	0.332
10:47	0.08	0.1	15:02	0.129	0.135	19:17	0.081	0.223
10:52	0.055	0.076	15:07	0.047	0.053	19:22	0.028	0.075
10:57	0.044	0.067	15:12	0.025	0.031	19:27	0.016	0.037
11:02	0.029	0.051	15:17	0.022	0.032	19:32	0.011	0.021
11:07	0.033	0.051	15:22	0.014	0.024	19:37	0.01	0.018
11:12	0.052	0.085	15:27	0.011	0.019	19:42	0.009	0.015
11:17	0.048	0.088	15:32	0.011	0.02	19:47	0.009	0.014
11:22	0.033	0.047	15:37	0.014	0.029	19:52	0.009	0.013
11:27	0.023	0.032	15:42	0.017	0.035	19:57	0.009	0.012
11:32	0.017	0.023	15:47	0.014	0.03	20:02	0.008	0.011
11:37	0.014	0.019	15:52	0.014	0.028	20:07	0.008	0.011
11:42	0.011	0.017	15:57	0.011	0.023	20:12	0.008	0.01
11:47	0.158	0.166	16:02	0.01	0.022	20:17	0.009	0.011
11:52	0.074	0.082	16:07	0.009	0.02	20:22	0.009	0.01
11:57	0.031	0.056	16:12	0.009	0.018	20:27	0.009	0.013
12:02	0.021	0.038	16:17	0.008	0.014	20:32	0.01	0.013
12:07	0.016	0.026	16:22	0.008	0.015	20:37	0.01	0.012
12:12	0.012	0.02	16:27	0.007	0.012	20:42	0.01	0.012
12:17	0.01	0.016	16:32	0.006	0.009	20:47	0.01	0.013
12:22	0.008	0.013	16:37	0.006	0.008	20:52	0.01	0.013
12:27	0.008	0.011	16:42	0.006	0.008	20:57	0.01	0.014
12:32	0.006	0.009	16:47	0.006	0.009	21:02	0.011	0.016
12:37	0.007	0.013	16:52	0.006	0.01	21:07	0.011	0.015
12:42	0.013	0.028	16:57	0.006	0.01	21:12	0.012	0.016
12:47	0.011	0.027	17:02	0.006	0.01	21:17	0.012	0.015
12:52	0.021	0.036	17:07	0.006	0.008	21:22	0.013	0.017
12:57	0.015	0.032	17:12	0.005	0.007	21:27	0.013	0.017
13:02	0.013	0.032	17:17	0.005	0.007	21:32	0.013	0.018
13:07	0.01	0.021	17:22	0.005	0.008	21:37	0.014	0.019
13:12	0.008	0.015	17:27	0.006	0.009	21:42	0.014	0.018
13:17	0.007	0.013	17:32	0.009	0.015	21:47	0.014	0.018
13:22	0.007	0.013	17:37	0.008	0.014	21:52	0.013	0.018

Instrument Data			Site-18 Hall by Room 6			12/9-10/2010 AQM #10-510		
Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³	Time	PM2.5 mg/m ³	PM10 mg/m ³
21:57	0.013	0.017	2:12	0.011	0.011	6:27	0.017	0.038
22:02	0.012	0.016	2:17	0.011	0.011	6:32	0.025	0.069
22:07	0.012	0.015	2:22	0.01	0.011	6:37	0.017	0.039
22:12	0.012	0.014	2:27	0.01	0.011	6:42	0.02	0.051
22:17	0.012	0.015	2:32	0.01	0.011	6:47	0.018	0.04
22:22	0.012	0.014	2:37	0.01	0.01	6:52	0.015	0.03
22:27	0.012	0.014	2:42	0.01	0.011	6:57	0.017	0.04
22:32	0.012	0.014	2:47	0.01	0.01	7:02	0.021	0.053
22:37	0.012	0.014	2:52	0.01	0.011	7:07	0.02	0.043
22:42	0.012	0.014	2:57	0.01	0.01	7:12	0.019	0.035
22:47	0.012	0.014	3:02	0.01	0.01	7:17	0.024	0.057
22:52	0.012	0.014	3:07	0.01	0.01	7:22	0.03	0.078
22:57	0.012	0.014	3:12	0.01	0.01	7:27	0.021	0.047
23:02	0.012	0.014	3:17	0.01	0.01	7:32	0.02	0.038
23:07	0.013	0.014	3:22	0.01	0.01	7:37	0.017	0.031
23:12	0.012	0.014	3:27	0.01	0.01	7:42	0.021	0.038
23:17	0.013	0.014	3:32	0.009	0.01	7:47	0.023	0.043
23:22	0.013	0.014	3:37	0.009	0.01	7:52	0.022	0.04
23:27	0.013	0.014	3:42	0.009	0.01	7:57	0.019	0.032
23:32	0.012	0.014	3:47	0.009	0.01	8:02	0.018	0.029
23:37	0.012	0.013	3:52	0.009	0.01	8:07	0.024	0.05
23:42	0.012	0.013	3:57	0.009	0.01	8:12	0.046	0.121
23:47	0.012	0.013	4:02	0.009	0.01	8:17	0.024	0.056
23:52	0.013	0.014	4:07	0.009	0.009	8:22	0.02	0.04
23:57	0.014	0.015	4:12	0.009	0.009	8:27	0.045	0.074
0:02	0.013	0.014	4:17	0.009	0.009	8:32	0.081	0.15
0:07	0.013	0.014	4:22	0.009	0.009	8:37	0.038	0.066
0:12	0.013	0.014	4:27	0.009	0.009	8:42	0.029	0.043
0:17	0.013	0.014	4:32	0.009	0.009	8:47	0.032	0.048
0:22	0.013	0.014	4:37	0.009	0.01	8:52	0.023	0.033
0:27	0.013	0.014	4:42	0.009	0.01	8:57	0.032	0.065
0:32	0.013	0.014	4:47	0.009	0.01	9:02	0.029	0.063
0:37	0.013	0.014	4:52	0.009	0.01	9:07	0.02	0.037
0:42	0.013	0.014	4:57	0.01	0.01			
0:47	0.012	0.013	5:02	0.01	0.01			
0:52	0.012	0.013	5:07	0.01	0.01			
0:57	0.012	0.013	5:12	0.009	0.01			
1:02	0.012	0.012	5:17	0.009	0.01			
1:07	0.011	0.012	5:22	0.009	0.01			
1:12	0.011	0.012	5:27	0.009	0.01			
1:17	0.011	0.012	5:32	0.01	0.01			
1:22	0.011	0.012	5:37	0.01	0.01			
1:27	0.011	0.012	5:42	0.01	0.01			
1:32	0.011	0.012	5:47	0.01	0.01			
1:37	0.011	0.012	5:52	0.01	0.01			
1:42	0.011	0.012	5:57	0.01	0.01			
1:47	0.012	0.013	6:02	0.01	0.01			
1:52	0.013	0.014	6:07	0.01	0.01			
1:57	0.012	0.013	6:12	0.01	0.01			
2:02	0.012	0.012	6:17	0.01	0.01			
2:07	0.011	0.012	6:22	0.01	0.011			

Instrument Data		Site-6			Room 105			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
7:35	551	0	21.8	18.2	11:50	834	0	23.1	16.3			
7:40	523	0	22.2	17.6	11:55	822	0	23.1	16.3			
7:45	675	0	22.5	17.3	12:00	812	0	23.1	16.3			
7:50	695	0	22.6	17.1	12:05	804	0	23.1	16.2			
7:55	833	0	22.6	17	12:10	804	0	23.1	16.2			
8:00	875	0	22.8	17	12:15	803	0	23	16.2			
8:05	959	0	23.2	17	12:20	841	0	22.9	16.2			
8:10	1080	0	23.4	17	12:25	861	0	22.7	16.2			
8:15	1128	0	23.5	17.1	12:30	853	0	22.5	16.3			
8:20	1087	0	23.3	17.1	12:35	846	0	22.4	16.3			
8:25	979	0	22.9	17	12:40	845	0	22.3	16.3			
8:30	955	0	22.4	17	12:45	848	0	22.3	16.3			
8:35	947	0	22.1	17	12:50	840	0	22.5	16.3			
8:40	914	0	22.1	17	12:55	865	0	22.6	16.3			
8:45	877	0	22.2	16.9	13:00	889	0	22.5	16.4			
8:50	860	0	22.5	16.9	13:05	878	0	22.3	16.4			
8:55	847	0	22.7	16.8	13:10	871	0	22.2	16.4			
9:00	837	0	22.8	16.8	13:15	865	0	22.2	16.4			
9:05	884	0	22.9	16.8	13:20	848	0	22.4	16.4			
9:10	983	0	23	16.8	13:25	832	0	22.6	16.4			
9:15	1008	0	22.8	16.9	13:30	819	0	22.8	16.3			
9:20	1000	0	22.8	16.8	13:35	807	0	22.9	16.3			
9:25	978	0	22.7	16.8	13:40	797	0	23	16.2			
9:30	954	0	22.8	16.8	13:45	784	0	23	16.2			
9:35	929	0	22.9	16.8	13:50	770	0	22.9	16.1			
9:40	906	0	23	16.7	13:55	722	0	22.8	16			
9:45	882	0	23.1	16.7	14:00	684	0	22.6	16			
9:50	860	0	23.1	16.6	14:05	696	0	22.4	16			
9:55	839	0	23.2	16.6	14:10	728	0	22.3	15.9			
10:00	818	0	23.3	16.5	14:15	758	0	22.2	15.9			
10:05	800	0	23.3	16.5	14:20	763	0	22.2	16			
10:10	785	0	23.3	16.4	14:25	751	0	22.2	16			
10:15	772	0	23.4	16.4	14:30	727	0	22.2	15.9			
10:20	766	0	23.4	16.3	14:35	716	0	22.3	15.9			
10:25	841	0	23.5	16.3	14:40	706	0	22.3	15.8			
10:30	906	0	23.4	16.4	14:45	696	0	22.3	15.8			
10:35	971	0	23.3	16.4	14:50	729	0	22.3	15.7			
10:40	1021	0	23	16.4	14:55	758	0	22.5	15.7			
10:45	1062	0	22.5	16.5	15:00	787	0	22.6	15.8			
10:50	1074	0	22.2	16.6	15:05	748	0	22.7	15.8			
10:55	1067	0	22.2	16.6	15:10	719	0	22.6	15.7			
11:00	1043	0	22.3	16.6	15:15	740	0	22.5	15.7			
11:05	1019	0	22.5	16.6	15:20	674	0	22.4	15.7			
11:10	994	0	22.7	16.6	15:25	646	0	22.3	15.6			
11:15	971	0	22.9	16.6	15:30	629	0	22.3	15.6			
11:20	946	0	23	16.6	15:35	614	0	22.3	15.5			
11:25	925	0	23.1	16.5	15:40	604	0	22.4	15.5			
11:30	905	0	23.1	16.5	15:45	595	0	22.5	15.5			
11:35	886	0	23.1	16.4	15:50	587	0	22.5	15.5			
11:40	867	0	23.1	16.4	15:55	579	0	22.5	15.4			
11:45	850	0	23.1	16.4	16:00	568	0	22.5	15.4			

Instrument Data		Site-6			Room 105			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
16:05	558	0	22.4	15.3	20:20	474	0	23.1	14.4			
16:10	550	0	22.4	15.3	20:25	476	0	23.1	14.4			
16:15	544	0	22.4	15.3	20:30	478	0	23.1	14.4			
16:20	547	0	22.4	15.3	20:35	478	0	23	14.4			
16:25	546	0	22.5	15.2	20:40	480	0	22.9	14.3			
16:30	553	0	22.7	15.2	20:45	477	0	22.5	14.3			
16:35	567	0	22.8	15.2	20:50	473	0	22.2	14.3			
16:40	580	0	22.8	15.2	20:55	469	0	21.9	14.3			
16:45	583	0	22.9	15.3	21:00	463	0	21.7	14.4			
16:50	586	0	22.9	15.2	21:05	453	0	21.7	14.4			
16:55	588	0	22.8	15.2	21:10	447	0	21.7	14.4			
17:00	578	0	22.8	15.2	21:15	443	0	21.6	14.4			
17:05	573	0	22.8	15.3	21:20	442	0	21.5	14.4			
17:10	566	0	22.9	15.2	21:25	442	0	21.3	14.4			
17:15	553	0	22.9	15.2	21:30	439	0	21.2	14.4			
17:20	541	0	22.9	15.1	21:35	437	0	21.1	14.4			
17:25	533	0	22.9	15.1	21:40	436	0	21	14.3			
17:30	526	0	22.8	15.1	21:45	436	0	20.9	14.3			
17:35	519	0	22.7	15.1	21:50	434	0	20.7	14.3			
17:40	514	0	22.7	15	21:55	434	0	20.6	14.3			
17:45	508	0	22.8	15	22:00	433	0	20.4	14.3			
17:50	504	0	22.8	15	22:05	432	0	20.3	14.3			
17:55	503	0	22.9	14.9	22:10	431	0	20.1	14.3			
18:00	501	0	22.9	14.9	22:15	429	0	20	14.3			
18:05	499	0	22.9	14.9	22:20	429	0	19.9	14.3			
18:10	495	0	22.9	14.9	22:25	429	0	19.7	14.3			
18:15	493	0	22.9	14.9	22:30	428	0	19.6	14.3			
18:20	490	0	22.8	14.8	22:35	427	0	19.5	14.2			
18:25	487	0	22.9	14.8	22:40	426	0	19.4	14.3			
18:30	484	0	22.9	14.8	22:45	425	0	19.3	14.2			
18:35	481	0	22.9	14.8	22:50	425	0	19.2	14.3			
18:40	478	0	22.9	14.7	22:55	424	0	19.1	14.3			
18:45	475	0	23	14.7	23:00	423	0	19	14.3			
18:50	473	0	23	14.7	23:05	422	0	19	14.3			
18:55	471	0	23	14.7	23:10	422	0	19	14.3			
19:00	469	0	23	14.7	23:15	421	0	18.9	14.3			
19:05	467	0	23	14.6	23:20	420	0	18.9	14.3			
19:10	465	0	23	14.6	23:25	420	0	18.9	14.3			
19:15	464	0	23	14.6	23:30	420	0	18.8	14.3			
19:20	463	0	23	14.6	23:35	419	0	18.8	14.3			
19:25	462	0	23	14.6	23:40	419	0	18.7	14.3			
19:30	461	0	23	14.6	23:45	418	0	18.7	14.3			
19:35	460	0	23	14.5	23:50	418	0	18.6	14.3			
19:40	460	0	23	14.5	23:55	417	0	18.6	14.3			
19:45	461	0	23	14.5	0:00	416	0	18.5	14.3			
19:50	462	0	23	14.5	0:05	416	0	18.5	14.3			
19:55	464	0	23	14.5	0:10	415	0	18.4	14.3			
20:00	466	0	23	14.5	0:15	415	0	18.4	14.3			
20:05	467	0	23	14.5	0:20	415	0	18.3	14.3			
20:10	469	0	23.1	14.5	0:25	414	0	18.2	14.3			
20:15	471	0	23.1	14.4	0:30	414	0	18.2	14.3			

Instrument Data		Site-6			Room 105			12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%		
0:35	413	0	18.1	14.3	4:50	406	0	20.9	14.4		
0:40	412	0	18.1	14.3	4:55	407	0	21	14.4		
0:45	412	0	18	14.3	5:00	407	0	21.1	14.3		
0:50	411	0	18	14.3	5:05	408	0	21.2	14.3		
0:55	411	0	17.9	14.3	5:10	408	0	21.3	14.3		
1:00	410	0	17.8	14.3	5:15	408	0	21.4	14.3		
1:05	410	0	17.8	14.3	5:20	408	0	21.4	14.3		
1:10	410	0	17.7	14.3	5:25	408	0	21.5	14.3		
1:15	409	0	17.7	14.3	5:30	408	0	21.5	14.3		
1:20	408	0	17.6	14.3	5:35	408	0	21.6	14.3		
1:25	408	0	17.5	14.3	5:40	408	0	21.6	14.3		
1:30	408	0	17.5	14.3	5:45	408	0	21.7	14.3		
1:35	408	0	17.4	14.3	5:50	409	0	21.8	14.2		
1:40	407	0	17.4	14.3	5:55	409	0	21.8	14.2		
1:45	407	0	17.3	14.3	6:00	408	0	21.8	14.2		
1:50	407	0	17.3	14.3	6:05	408	0	21.9	14.2		
1:55	406	0	17.2	14.3	6:10	409	0	21.9	14.2		
2:00	406	0	17.1	14.3	6:15	409	0	21.9	14.2		
2:05	406	0	17.1	14.3	6:20	409	0	22	14.2		
2:10	405	0	17	14.3	6:25	410	0	22	14.1		
2:15	405	0	17	14.3	6:30	410	0	22.1	14.1		
2:20	404	0	16.9	14.3	6:35	410	0	22.1	14.1		
2:25	404	0	16.8	14.3	6:40	410	0	22.2	14.1		
2:30	404	0	16.8	14.3	6:45	410	0	22.2	14.1		
2:35	403	0	16.7	14.3	6:50	410	0	22.2	14.1		
2:40	403	0	16.7	14.3	6:55	410	0	22.3	14.1		
2:45	403	0	16.6	14.3	7:00	411	0	22.3	14.1		
2:50	402	0	16.6	14.3	7:05	416	0	22.3	14.1		
2:55	402	0	16.5	14.3	7:10	421	0	22.3	14.1		
3:00	402	0	16.5	14.3	7:15	427	0	22.5	14.1		
3:05	401	0	16.4	14.4	7:20	437	0	22.6	14.1		
3:10	401	0	16.3	14.4	7:25	450	0	22.6	14		
3:15	401	0	16.3	14.4	7:30	465	0	22.3	14		
3:20	401	0	16.2	14.4							
3:25	401	0	16.2	14.4							
3:30	400	0	16.1	14.4							
3:35	398	0	16.3	14.4							
3:40	395	0	16.9	14.5							
3:45	394	0	17.6	14.6							
3:50	395	0	18.2	14.6							
3:55	396	0	18.7	14.6							
4:00	398	0	19.1	14.5							
4:05	399	0	19.4	14.5							
4:10	401	0	19.7	14.5							
4:15	402	0	19.9	14.5							
4:20	404	0	20.1	14.5							
4:25	405	0	20.3	14.4							
4:30	405	0	20.4	14.4							
4:35	406	0	20.6	14.4							
4:40	406	0	20.7	14.4							
4:45	407	0	20.8	14.4							

Instrument Data		Site-7			Room 107			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
7:37	483	0	21.8	13.2	11:52	968	0	23.7	12.1			
7:42	457	0	21.7	12.5	11:57	962	0	23.7	12.1			
7:47	475	0	21.7	12.1	12:02	967	0	23.7	12.1			
7:52	488	0	21.8	11.9	12:07	927	0	23.6	12.1			
7:57	474	0	21.8	11.7	12:12	842	0	23.4	12			
8:02	467	0	21.9	11.5	12:17	758	0	23.3	11.9			
8:07	464	0	21.9	11.4	12:22	691	0	23.2	11.8			
8:12	464	0	22	11.3	12:27	638	0	23.2	11.7			
8:17	465	0	21.9	11.2	12:32	603	0	23.2	11.6			
8:22	463	0	21.9	11.1	12:37	575	0	23.2	11.5			
8:27	467	0	21.8	11	12:42	554	0	23.3	11.4			
8:32	468	0	21.7	11	12:47	540	0	23.5	11.3			
8:37	470	0	21.7	10.9	12:52	611	0	23.9	11.3			
8:42	470	0	21.7	10.9	12:57	687	0	24.6	11.4			
8:47	474	0	21.7	10.9	13:02	770	0	25.1	11.5			
8:52	480	0	21.7	10.9	13:07	868	0	25.4	11.5			
8:57	483	0	21.6	10.8	13:12	958	0	25.9	11.6			
9:02	482	0	21.6	10.8	13:17	986	0	26.4	11.6			
9:07	503	0	21.6	10.8	13:22	997	0	26.6	11.4			
9:12	635	0	22	10.9	13:27	1035	0	26.8	11.3			
9:17	745	0	22.6	11.1	13:32	1069	0	27	11.2			
9:22	780	0	23.1	11.3	13:37	1082	0	27.1	11.2			
9:27	863	0	23.3	11.3	13:42	1100	0	27.3	11.1			
9:32	891	0	23.5	11.4	13:47	1127	0	27.4	11.1			
9:37	939	0	23.5	11.5	13:52	1165	0	27.5	11			
9:42	930	0	23.5	11.6	13:57	1206	0	27.6	11			
9:47	953	0	23.4	11.6	14:02	1252	0	27.5	11			
9:52	975	0	23.2	11.7	14:07	1072	0	27	11			
9:57	972	0	23	11.7	14:12	872	0	26.4	10.7			
10:02	938	0	22.8	11.7	14:17	760	0	25.7	10.4			
10:07	921	0	22.8	11.7	14:22	703	0	26.8	10.4			
10:12	901	0	22.9	11.7	14:27	646	0	31.6	10			
10:17	884	0	22.9	11.8	14:32	601	0	34.4	9.3			
10:22	885	0	22.9	11.8	14:37	570	0	35.7	8.8			
10:27	881	0	22.8	11.8	14:42	549	0	36.2	8.2			
10:32	830	0	22.7	11.7	14:47	527	0	36.3	7.8			
10:37	781	0	22.6	11.7	14:52	500	0	35.7	7.5			
10:42	808	0	22.5	11.7	14:57	498	0	31.3	7.5			
10:47	872	0	22.6	11.7	15:02	486	0	27.4	7.7			
10:52	919	0	22.8	11.8	15:07	477	0	25.5	8			
10:57	931	0	23	11.8	15:12	471	0	24.5	8.2			
11:02	963	0	23.1	11.9	15:17	477	0	23.8	8.4			
11:07	1016	0	23.3	11.9	15:22	504	0	23.4	8.5			
11:12	1060	0	23.7	12	15:27	475	0	22.9	8.6			
11:17	1060	0	23.9	12.1	15:32	459	0	22.3	8.6			
11:22	1068	0	23.8	12.1	15:37	450	0	21.8	8.7			
11:27	1071	0	23.7	12.1	15:42	444	0	21.6	8.8			
11:32	1058	0	23.7	12.1	15:47	440	0	21.4	8.9			
11:37	1044	0	23.7	12.2	15:52	438	0	21.4	9			
11:42	1031	0	23.7	12.2	15:57	437	0	21.5	9.1			
11:47	1009	0	23.8	12.2	16:02	436	0	21.7	9.1			

Instrument Data		Site-7			Room 107			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
16:07	435	0	22	9.2	20:22	418	0	22.7	8.9			
16:12	434	0	22.4	9.3	20:27	417	0	22.7	8.9			
16:17	433	0	22.6	9.3	20:32	416	0	22.7	8.9			
16:22	433	0	22.9	9.3	20:37	418	0	22.6	8.9			
16:27	437	0	23.1	9.3	20:42	417	0	22.4	8.8			
16:32	440	0	23.2	9.3	20:47	416	0	22.3	8.8			
16:37	438	0	23.3	9.3	20:52	414	0	22.1	8.8			
16:42	437	0	23.1	9.3	20:57	414	0	22	8.8			
16:47	436	0	23	9.3	21:02	413	0	21.9	8.7			
16:52	434	0	22.8	9.3	21:07	413	0	21.8	8.7			
16:57	431	0	22.7	9.3	21:12	413	0	21.7	8.7			
17:02	431	0	22.6	9.3	21:17	413	0	21.7	8.7			
17:07	432	0	22.6	9.3	21:22	412	0	21.6	8.7			
17:12	432	0	22.6	9.3	21:27	412	0	21.6	8.7			
17:17	433	0	22.6	9.3	21:32	411	0	21.5	8.7			
17:22	441	0	22.6	9.3	21:37	412	0	21.5	8.7			
17:27	442	0	22.6	9.3	21:42	412	0	21.4	8.7			
17:32	441	0	22.5	9.4	21:47	412	0	21.4	8.7			
17:37	439	0	22.5	9.3	21:52	411	0	21.4	8.7			
17:42	436	0	22.5	9.3	21:57	412	0	21.3	8.7			
17:47	434	0	22.5	9.3	22:02	412	0	21.3	8.7			
17:52	430	0	22.5	9.3	22:07	412	0	21.3	8.7			
17:57	428	0	22.5	9.3	22:12	412	0	21.2	8.7			
18:02	427	0	22.5	9.3	22:17	410	0	21.2	8.7			
18:07	425	0	22.6	9.3	22:22	408	0	21.2	8.7			
18:12	422	0	22.6	9.3	22:27	409	0	21.2	8.7			
18:17	420	0	22.6	9.2	22:32	408	0	21.1	8.7			
18:22	418	0	22.6	9.2	22:37	407	0	21.1	8.6			
18:27	418	0	22.6	9.2	22:42	406	0	21.1	8.6			
18:32	417	0	22.6	9.2	22:47	407	0	21	8.6			
18:37	417	0	22.7	9.2	22:52	406	0	21	8.6			
18:42	417	0	22.7	9.2	22:57	405	0	21	8.6			
18:47	416	0	22.7	9.2	23:02	405	0	21	8.6			
18:52	417	0	22.8	9.2	23:07	405	0	21	8.6			
18:57	415	0	22.8	9.1	23:12	405	0	20.9	8.6			
19:02	416	0	22.8	9.1	23:17	405	0	20.9	8.6			
19:07	416	0	22.8	9.1	23:22	404	0	20.9	8.6			
19:12	417	0	22.8	9.1	23:27	404	0	20.9	8.6			
19:17	416	0	22.8	9.1	23:32	405	0	20.8	8.6			
19:22	415	0	22.8	9.1	23:37	406	0	20.8	8.6			
19:27	416	0	22.8	9.1	23:42	405	0	20.8	8.6			
19:32	415	0	22.8	9	23:47	405	0	20.8	8.6			
19:37	416	0	22.8	9	23:52	405	0	20.8	8.6			
19:42	417	0	22.8	9	23:57	406	0	20.7	8.6			
19:47	417	0	22.8	9	0:02	406	0	20.7	8.6			
19:52	417	0	22.8	9	0:07	406	0	20.7	8.6			
19:57	417	0	22.8	9	0:12	406	0	20.7	8.6			
20:02	418	0	22.7	9	0:17	406	0	20.6	8.6			
20:07	417	0	22.7	9	0:22	406	0	20.6	8.6			
20:12	416	0	22.7	9	0:27	406	0	20.6	8.6			
20:17	417	0	22.7	8.9	0:32	406	0	20.6	8.6			

Instrument Data		Site-7			Room 107			12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%		
0:37	405	0	20.5	8.5	4:52	412	0	21.3	8.5		
0:42	405	0	20.5	8.5	4:57	413	0	21.3	8.5		
0:47	404	0	20.5	8.6	5:02	413	0	21.3	8.5		
0:52	405	0	20.4	8.6	5:07	412	0	21.3	8.5		
0:57	404	0	20.4	8.6	5:12	413	0	21.3	8.5		
1:02	404	0	20.3	8.6	5:17	413	0	21.3	8.5		
1:07	404	0	20.3	8.6	5:22	413	0	21.3	8.5		
1:12	404	0	20.3	8.6	5:27	413	0	21.3	8.5		
1:17	404	0	20.3	8.6	5:32	413	0	21.3	8.5		
1:22	405	0	20.3	8.6	5:37	414	0	21.3	8.5		
1:27	405	0	20.3	8.6	5:42	414	0	21.3	8.5		
1:32	405	0	20.3	8.6	5:47	415	0	21.4	8.5		
1:37	404	0	20.3	8.6	5:52	416	0	21.4	8.5		
1:42	404	0	20.3	8.6	5:57	418	0	21.4	8.5		
1:47	403	0	20.2	8.6	6:02	419	0	21.4	8.5		
1:52	404	0	20.2	8.6	6:07	419	0	21.4	8.5		
1:57	405	0	20.2	8.6	6:12	420	0	21.4	8.5		
2:02	405	0	20.2	8.6	6:17	421	0	21.4	8.5		
2:07	405	0	20.2	8.6	6:22	421	0	21.4	8.5		
2:12	405	0	20.2	8.6	6:27	421	0	21.4	8.5		
2:17	405	0	20.1	8.6	6:32	421	0	21.4	8.5		
2:22	405	0	20.1	8.6	6:37	422	0	21.4	8.5		
2:27	403	0	20.1	8.6	6:42	422	0	21.4	8.5		
2:32	404	0	20.1	8.6	6:47	421	0	21.4	8.5		
2:37	404	0	20.1	8.6	6:52	423	0	21.5	8.5		
2:42	404	0	20.2	8.6	6:57	424	0	21.5	8.5		
2:47	406	0	20.5	8.7	7:02	424	0	21.5	8.5		
2:52	407	0	20.9	8.7	7:07	426	0	21.6	8.5		
2:57	407	0	21.2	8.7	7:12	430	0	22.4	8.6		
3:02	409	0	21.4	8.7	7:17	432	0	23.2	8.7		
3:07	409	0	21.6	8.7	7:22	434	0	23.2	8.6		
3:12	411	0	21.7	8.7	7:27	434	0	22.8	8.5		
3:17	412	0	21.8	8.7	7:32	434	0	22.4	8.4		
3:22	414	0	21.9	8.7							
3:27	414	0	22	8.7							
3:32	414	0	22	8.7							
3:37	414	0	22.1	8.7							
3:42	414	0	22	8.6							
3:47	415	0	21.9	8.6							
3:52	415	0	21.8	8.6							
3:57	415	0	21.7	8.6							
4:02	415	0	21.6	8.6							
4:07	415	0	21.5	8.6							
4:12	415	0	21.5	8.6							
4:17	415	0	21.4	8.6							
4:22	412	0	21.4	8.5							
4:27	413	0	21.4	8.5							
4:32	413	0	21.4	8.5							
4:37	413	0	21.4	8.5							
4:42	413	0	21.4	8.5							
4:47	413	0	21.3	8.5							

Instrument Data		Site-11	Room 4			12/9-10/2010	AQM #10-510			
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	
7:55	557	Invalid	20.1	16.2	12:10	607	Invalid	20.2	13	
8:00	609	0	20.3	15.5	12:15	605	Invalid	20.2	13	
8:05	628	0	20.3	15	12:20	605	Invalid	20.2	13	
8:10	623	0	20.2	14.7	12:25	610	Invalid	20.3	13	
8:15	639	0	20.1	14.4	12:30	616	Invalid	20.3	12.9	
8:20	680	0	20.2	14.3	12:35	627	Invalid	20.3	12.9	
8:25	660	0	20.2	14.1	12:40	643	Invalid	20.3	13	
8:30	659	0	20.1	14	12:45	649	Invalid	20.3	13	
8:35	665	0	20.1	13.9	12:50	654	Invalid	20.3	13	
8:40	679	0	20.1	13.9	12:55	664	Invalid	20.3	13	
8:45	701	0	20.1	13.8	13:00	672	Invalid	20.3	13	
8:50	713	0	20.2	13.8	13:05	682	Invalid	20.3	13	
8:55	717	0	20.2	13.7	13:10	711	Invalid	20.3	13	
9:00	722	0	20.2	13.7	13:15	728	Invalid	20.4	13	
9:05	743	0	20.2	13.7	13:20	730	Invalid	20.3	13	
9:10	758	0	20.4	13.8	13:25	736	Invalid	20.3	13	
9:15	782	0	20.5	13.8	13:30	732	Invalid	20.3	13.1	
9:20	778	0	20.5	13.8	13:35	727	Invalid	20.4	13	
9:25	781	0	20.5	13.8	13:40	730	Invalid	20.4	13	
9:30	778	0	20.4	13.8	13:45	736	Invalid	20.4	13	
9:35	785	0	20.4	13.8	13:50	724	Invalid	20.4	13.1	
9:40	787	0	20.4	13.8	13:55	708	Invalid	20.4	13.1	
9:45	785	0	20.4	13.8	14:00	702	Invalid	20.4	13.1	
9:50	778	0	20.4	13.8	14:05	704	Invalid	20.5	13	
9:55	777	0	20.3	13.8	14:10	700	Invalid	20.4	13	
10:00	728	0	20	13.7	14:15	700	Invalid	20.4	13	
10:05	678	0	19.6	13.5	14:20	694	Invalid	20.4	13	
10:10	642	Invalid	19.2	13.4	14:25	686	Invalid	20.4	13	
10:15	609	Invalid	18.9	13.3	14:30	676	Invalid	20.4	12.9	
10:20	576	Invalid	18.8	13.3	14:35	669	Invalid	20.4	12.9	
10:25	587	Invalid	19	13.3	14:40	658	Invalid	20.4	12.9	
10:30	606	Invalid	19.3	13.3	14:45	646	Invalid	20.4	12.9	
10:35	634	Invalid	19.5	13.3	14:50	635	Invalid	20.4	12.9	
10:40	666	Invalid	19.7	13.3	14:55	627	Invalid	20.4	12.9	
10:45	689	Invalid	19.8	13.3	15:00	616	Invalid	20.5	12.8	
10:50	692	Invalid	20	13.2	15:05	603	Invalid	20.5	12.8	
10:55	686	Invalid	20	13.2	15:10	597	Invalid	20.6	12.8	
11:00	681	Invalid	20	13.2	15:15	588	Invalid	20.6	12.7	
11:05	677	Invalid	20	13.2	15:20	600	Invalid	20.7	12.7	
11:10	678	Invalid	20.1	13.2	15:25	590	Invalid	20.7	12.7	
11:15	671	Invalid	20.1	13.2	15:30	643	Invalid	20.7	12.7	
11:20	667	Invalid	20.2	13.2	15:35	589	Invalid	20.6	12.6	
11:25	659	Invalid	20.2	13.2	15:40	573	Invalid	20.6	12.6	
11:30	646	Invalid	20.2	13.2	15:45	567	Invalid	20.5	12.5	
11:35	635	Invalid	20.2	13.1	15:50	565	Invalid	20.5	12.5	
11:40	628	Invalid	20.2	13.1	15:55	568	Invalid	20.5	12.5	
11:45	621	Invalid	20.2	13.1	16:00	571	Invalid	20.5	12.4	
11:50	617	Invalid	20.2	13.1	16:05	565	Invalid	20.5	12.4	
11:55	612	Invalid	20.2	13.1	16:10	556	0	20.4	12.4	
12:00	609	Invalid	20.2	13	16:15	548	Invalid	20.4	12.3	
12:05	608	Invalid	20.2	13	16:20	539	Invalid	20.5	12.3	

Instrument Data		Site-11			Room 4			12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%		
16:25	535	Invalid	20.5	12.3	20:40	415	Invalid	20	11.3		
16:30	536	Invalid	20.5	12.3	20:45	413	Invalid	19.7	11.3		
16:35	536	Invalid	20.5	12.2	20:50	413	0	19.4	11.3		
16:40	543	Invalid	20.4	12.2	20:55	412	0	19	11.3		
16:45	542	Invalid	20.4	12.2	21:00	411	0	18.7	11.3		
16:50	527	Invalid	20.3	12.2	21:05	409	Invalid	18.5	11.4		
16:55	519	Invalid	20.2	12.2	21:10	407	0	18.3	11.4		
17:00	512	Invalid	20.1	12.1	21:15	407	0	18.1	11.4		
17:05	508	Invalid	20.1	12.1	21:20	406	0	17.9	11.4		
17:10	517	Invalid	20.1	12.1	21:25	406	0	17.8	11.4		
17:15	524	Invalid	20.2	12.2	21:30	405	0	17.6	11.5		
17:20	507	Invalid	20.3	12.1	21:35	404	0	17.4	11.5		
17:25	499	Invalid	20.4	12.1	21:40	404	0	17.3	11.5		
17:30	509	Invalid	20.5	12.1	21:45	403	Invalid	17.1	11.5		
17:35	504	Invalid	20.4	12.1	21:50	402	0	17	11.5		
17:40	496	Invalid	20.4	12.1	21:55	402	0	16.9	11.5		
17:45	492	Invalid	20.3	12	22:00	401	0	16.8	11.5		
17:50	487	Invalid	20.3	12	22:05	401	0	16.7	11.5		
17:55	482	Invalid	20.3	12	22:10	400	0	16.6	11.5		
18:00	478	Invalid	20.3	12	22:15	399	0	16.5	11.5		
18:05	475	Invalid	20.3	12	22:20	399	0	16.4	11.5		
18:10	471	Invalid	20.2	11.9	22:25	398	0	16.4	11.5		
18:15	468	Invalid	20.2	11.9	22:30	398	0	16.3	11.5		
18:20	465	Invalid	20.2	11.9	22:35	398	0	16.2	11.5		
18:25	462	Invalid	20.2	11.8	22:40	397	0	16.2	11.5		
18:30	459	Invalid	20.2	11.8	22:45	397	0	16.1	11.5		
18:35	456	Invalid	20.2	11.8	22:50	396	0	16	11.5		
18:40	453	Invalid	20.2	11.8	22:55	396	0	16	11.5		
18:45	451	Invalid	20.2	11.8	23:00	395	0	15.9	11.5		
18:50	449	Invalid	20.2	11.8	23:05	396	0	15.9	11.5		
18:55	447	Invalid	20.2	11.7	23:10	395	0	15.8	11.5		
19:00	444	Invalid	20.2	11.7	23:15	395	0	15.8	11.5		
19:05	442	Invalid	20.2	11.7	23:20	394	0	15.7	11.5		
19:10	440	Invalid	20.2	11.7	23:25	394	0	15.7	11.5		
19:15	438	Invalid	20.2	11.7	23:30	394	0	15.6	11.5		
19:20	436	Invalid	20.2	11.7	23:35	394	0	15.6	11.5		
19:25	435	Invalid	20.2	11.6	23:40	393	0	15.5	11.5		
19:30	433	Invalid	20.2	11.6	23:45	393	0	15.5	11.6		
19:35	432	Invalid	20.2	11.6	23:50	393	0	15.5	11.6		
19:40	430	Invalid	20.2	11.6	23:55	392	0	15.4	11.6		
19:45	428	Invalid	20.2	11.6	0:00	392	0	15.4	11.6		
19:50	427	Invalid	20.2	11.6	0:05	392	0	15.3	11.6		
19:55	426	Invalid	20.2	11.6	0:10	392	0	15.3	11.5		
20:00	425	Invalid	20.2	11.5	0:15	391	0	15.2	11.6		
20:05	423	Invalid	20.2	11.5	0:20	391	0	15.2	11.6		
20:10	421	Invalid	20.2	11.5	0:25	391	0	15.1	11.6		
20:15	420	0	20.2	11.5	0:30	390	0	15.1	11.6		
20:20	419	Invalid	20.2	11.5	0:35	390	0	15	11.6		
20:25	418	Invalid	20.2	11.5	0:40	390	0	15	11.6		
20:30	417	Invalid	20.2	11.5	0:45	390	0	14.9	11.6		
20:35	417	Invalid	20.2	11.4	0:50	389	0	14.9	11.6		

Instrument Data		Site-11		Room 4		12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%
0:55	390	0	14.9	11.6	5:10	384	Invalid	18.4	11.4
1:00	389	0	14.8	11.6	5:15	384	Invalid	18.4	11.4
1:05	389	0	14.8	11.6	5:20	384	0	18.5	11.4
1:10	389	0	14.8	11.6	5:25	384	Invalid	18.5	11.3
1:15	389	0	14.7	11.6	5:30	384	Invalid	18.5	11.3
1:20	389	0	14.7	11.6	5:35	385	Invalid	18.6	11.3
1:25	389	0	14.6	11.6	5:40	385	Invalid	18.7	11.3
1:30	389	0	14.6	11.6	5:45	385	Invalid	18.7	11.3
1:35	389	0	14.5	11.6	5:50	385	Invalid	18.7	11.3
1:40	389	0	14.5	11.6	5:55	386	Invalid	18.7	11.3
1:45	388	0	14.5	11.6	6:00	386	0	18.8	11.3
1:50	388	0	14.4	11.6	6:05	386	Invalid	18.8	11.2
1:55	388	0	14.4	11.6	6:10	386	Invalid	18.8	11.2
2:00	388	0	14.4	11.6	6:15	386	0	18.9	11.2
2:05	387	0	14.3	11.6	6:20	387	Invalid	18.9	11.2
2:10	387	0	14.3	11.6	6:25	387	Invalid	19	11.2
2:15	387	0	14.2	11.6	6:30	387	Invalid	19	11.2
2:20	387	0	14.2	11.6	6:35	388	Invalid	19	11.2
2:25	386	0	14.2	11.6	6:40	388	Invalid	19	11.2
2:30	386	0	14.1	11.6	6:45	388	0	19.1	11.2
2:35	386	Invalid	14.1	11.6	6:50	388	Invalid	19.1	11.2
2:40	386	0	14.1	11.6	6:55	388	0	19.2	11.2
2:45	386	0	14	11.6	7:00	389	Invalid	19.2	11.1
2:50	386	0	14	11.6	7:05	389	Invalid	19.2	11.1
2:55	386	0	14	11.6	7:10	389	0	19.2	11.1
3:00	386	0	13.9	11.7	7:15	389	0	19.3	11.1
3:05	386	0	13.9	11.7	7:20	404	Invalid	19.3	11.1
3:10	386	0	13.9	11.7	7:25	402	0	19.3	11.1
3:15	386	0	13.9	11.7	7:30	401	Invalid	19.3	11.1
3:20	385	0	13.8	11.7	7:35	400	Invalid	19.4	11.1
3:25	385	0	13.8	11.7	7:40	401	0	19.5	11.1
3:30	385	0	13.8	11.7	7:45	406	0	19.5	11
3:35	384	0	14	11.7	7:50	450	0	19.5	11.1
3:40	382	0	14.6	11.8					
3:45	381	0	15.2	11.9					
3:50	381	0	15.8	11.9					
3:55	381	0	16.2	11.8					
4:00	381	0	16.5	11.8					
4:05	382	Invalid	16.8	11.8					
4:10	382	0	17	11.7					
4:15	383	Invalid	17.2	11.7					
4:20	383	Invalid	17.4	11.6					
4:25	383	0	17.5	11.6					
4:30	383	0	17.7	11.6					
4:35	384	0	17.8	11.5					
4:40	384	Invalid	17.9	11.5					
4:45	384	Invalid	18	11.5					
4:50	384	0	18.1	11.5					
4:55	384	0	18.2	11.4					
5:00	384	0	18.2	11.4					
5:05	384	0	18.3	11.4					

Instrument Data		Site-13			Room 203			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
7:48	737	0	20.7	22.1	12:03	907	0	21.1	19.6			
7:53	699	0	20.6	21.4	12:08	910	0	21.3	19.6			
7:58	709	0	20.6	21	12:13	914	0	21.2	19.6			
8:03	718	0	20.5	20.7	12:18	911	0	21	19.6			
8:08	725	0	20.5	20.4	12:23	913	0	21	19.6			
8:13	735	0	20.4	20.3	12:28	919	0	21.1	19.7			
8:18	738	0	20.4	20.2	12:33	913	0	21.4	19.7			
8:23	729	0	20.3	20.1	12:38	910	0	21.8	19.7			
8:28	710	0	20.3	20	12:43	911	0	21.9	19.7			
8:33	702	0	20.2	19.9	12:48	912	0	21.9	19.6			
8:38	697	0	20.2	19.8	12:53	917	0	21.6	19.6			
8:43	687	0	20.2	19.7	12:58	920	0	21.4	19.6			
8:48	676	0	20.2	19.7	13:03	921	0	21.4	19.6			
8:53	685	0	20.2	19.7	13:08	922	0	21.4	19.7			
8:58	697	0	20.3	19.7	13:13	923	0	21.7	19.7			
9:03	717	0	20.5	19.6	13:18	918	0	21.8	19.7			
9:08	762	0	20.7	19.7	13:23	919	0	21.7	19.7			
9:13	766	0	20.8	19.6	13:28	919	0	21.6	19.7			
9:18	768	0	21	19.6	13:33	916	0	21.4	19.7			
9:23	770	0	21	19.5	13:38	911	0	21.3	19.7			
9:28	780	0	21	19.5	13:43	901	0	21.3	19.7			
9:33	781	0	21	19.5	13:48	894	0	21.4	19.7			
9:38	792	0	21.1	19.5	13:53	883	0	21.7	19.8			
9:43	795	0	21.2	19.5	13:58	877	0	21.8	19.7			
9:48	800	0	21.4	19.4	14:03	892	0	21.7	19.7			
9:53	800	0	21.3	19.4	14:08	907	0	21.5	19.7			
9:58	800	0	21.1	19.4	14:13	908	0	21.2	19.7			
10:03	799	0	21	19.4	14:18	905	0	21.1	19.7			
10:08	802	0	21	19.4	14:23	913	0	21.1	19.7			
10:13	802	0	21.2	19.5	14:28	922	0	21.2	19.7			
10:18	802	0	21.5	19.5	14:33	924	0	21.3	19.7			
10:23	797	0	21.7	19.5	14:38	922	0	21.4	19.7			
10:28	799	0	21.7	19.4	14:43	909	0	21.3	19.7			
10:33	805	0	21.5	19.4	14:48	896	0	21.1	19.7			
10:38	806	0	21.3	19.4	14:53	888	0	21.1	19.7			
10:43	811	0	21.3	19.4	14:58	884	0	21.3	19.8			
10:48	815	0	21.3	19.4	15:03	866	0	21.6	19.8			
10:53	824	0	21.4	19.4	15:08	850	0	22	19.8			
10:58	828	0	21.4	19.4	15:13	838	0	22.1	19.7			
11:03	831	0	21.3	19.4	15:18	825	0	21.9	19.6			
11:08	835	0	21.2	19.4	15:23	805	0	21.7	19.6			
11:13	839	0	21.3	19.4	15:28	796	0	21.5	19.6			
11:18	845	0	21.3	19.4	15:33	783	0	21.4	19.6			
11:23	860	0	21.3	19.4	15:38	775	0	21.4	19.6			
11:28	878	0	21.4	19.4	15:43	767	0	21.5	19.6			
11:33	891	0	21.3	19.4	15:48	744	0	21.5	19.5			
11:38	888	0	21.2	19.4	15:53	736	0	21.2	19.4			
11:43	890	0	21.1	19.4	15:58	715	0	21	19.4			
11:48	893	0	20.9	19.5	16:03	701	0	20.7	19.4			
11:53	899	0	20.9	19.5	16:08	702	0	20.7	19.4			
11:58	901	0	20.9	19.5	16:13	697	0	20.8	19.4			

Instrument Data		Site-13			Room 203			12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%		
16:18	694	0	21	19.4	20:33	570	0	20.7	19		
16:23	688	0	21.3	19.4	20:38	572	0	20.5	19		
16:28	679	0	21.4	19.3	20:43	569	0	20.3	19		
16:33	674	0	21.2	19.3	20:48	571	0	20.1	19		
16:38	667	0	20.9	19.2	20:53	572	0	20	19		
16:43	670	0	20.8	19.2	20:58	572	0	20	19		
16:48	668	0	20.8	19.3	21:03	570	0	19.8	19		
16:53	666	0	21	19.3	21:08	569	0	19.7	19		
16:58	665	0	21.2	19.3	21:13	566	0	19.7	19		
17:03	657	0	21.3	19.3	21:18	562	0	19.8	19		
17:08	652	0	21.3	19.2	21:23	559	0	19.8	18.9		
17:13	646	0	21	19.2	21:28	555	0	19.8	18.9		
17:18	647	0	20.7	19.2	21:33	552	0	19.8	18.9		
17:23	650	0	20.6	19.2	21:38	552	0	19.8	18.9		
17:28	648	0	20.7	19.3	21:43	554	0	19.7	18.8		
17:33	645	0	20.9	19.3	21:48	553	0	19.6	18.8		
17:38	639	0	21.2	19.3	21:53	548	0	19.5	18.8		
17:43	636	0	21.3	19.3	21:58	547	0	19.4	18.8		
17:48	634	0	21.2	19.2	22:03	546	0	19.3	18.8		
17:53	633	0	20.9	19.2	22:08	544	0	19.2	18.8		
17:58	630	0	20.7	19.2	22:13	543	0	19.1	18.8		
18:03	628	0	20.7	19.2	22:18	542	0	19	18.8		
18:08	630	0	20.8	19.3	22:23	545	0	18.8	18.8		
18:13	630	0	21	19.3	22:28	545	0	18.7	18.8		
18:18	632	0	21.3	19.3	22:33	543	0	18.6	18.8		
18:23	627	0	21.3	19.3	22:38	544	0	18.5	18.9		
18:28	624	0	21.1	19.2	22:43	543	0	18.5	18.9		
18:33	621	0	20.9	19.2	22:48	543	0	18.4	18.9		
18:38	620	0	20.8	19.2	22:53	541	0	18.3	18.8		
18:43	619	0	20.8	19.2	22:58	538	0	18.3	18.8		
18:48	618	0	21	19.2	23:03	538	0	18.2	18.8		
18:53	615	0	21.2	19.2	23:08	536	0	18.2	18.8		
18:58	612	0	21.3	19.2	23:13	534	0	18.1	18.8		
19:03	607	0	21.3	19.2	23:18	535	0	18	18.8		
19:08	604	0	21.1	19.2	23:23	536	0	18	18.8		
19:13	598	0	20.9	19.1	23:28	536	0	17.9	18.8		
19:18	593	0	20.8	19.1	23:33	534	0	17.9	18.8		
19:23	594	0	20.8	19.1	23:38	536	0	17.8	18.8		
19:28	592	0	21	19.2	23:43	534	0	17.8	18.8		
19:33	593	0	21.3	19.2	23:48	532	0	17.7	18.8		
19:38	589	0	21.4	19.2	23:53	532	0	17.7	18.8		
19:43	584	0	21.3	19.1	23:58	534	0	17.7	18.8		
19:48	582	0	21	19.1	0:03	531	0	17.6	18.8		
19:53	579	0	20.7	19	0:08	529	0	17.6	18.7		
19:58	581	0	20.6	19	0:13	528	0	17.5	18.7		
20:03	581	0	20.8	19.1	0:18	526	0	17.5	18.7		
20:08	580	0	21.1	19.1	0:23	527	0	17.5	18.7		
20:13	577	0	21.4	19.2	0:28	526	0	17.4	18.7		
20:18	575	0	21.5	19.1	0:33	526	0	17.4	18.7		
20:23	570	0	21.3	19	0:38	522	0	17.3	18.7		
20:28	571	0	21	19	0:43	515	0	17.3	18.7		

Instrument Data		Site-13		Room 203		12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%
0:48	517	0	17.3	18.7	5:03	491	0	20.9	18.5
0:53	515	0	17.2	18.6	5:08	490	0	21	18.5
0:58	515	0	17.2	18.6	5:13	488	0	20.9	18.4
1:03	516	0	17.1	18.6	5:18	488	0	20.9	18.4
1:08	516	0	17.1	18.6	5:23	487	0	21	18.4
1:13	518	0	17	18.6	5:28	488	0	21	18.4
1:18	515	0	17	18.6	5:33	488	0	20.9	18.3
1:23	513	0	16.9	18.6	5:38	486	0	20.9	18.3
1:28	513	0	16.9	18.6	5:43	489	0	20.9	18.3
1:33	513	0	16.9	18.6	5:48	486	0	20.9	18.3
1:38	512	0	16.8	18.5	5:53	490	0	20.9	18.3
1:43	512	0	16.8	18.5	5:58	490	0	20.9	18.2
1:48	511	0	16.8	18.5	6:03	485	0	20.9	18.2
1:53	511	0	16.7	18.5	6:08	483	0	20.9	18.2
1:58	511	0	16.7	18.5	6:13	489	0	20.9	18.2
2:03	511	0	16.7	18.5	6:18	489	0	20.9	18.2
2:08	512	0	16.6	18.5	6:23	491	0	20.9	18.2
2:13	509	0	16.5	18.5	6:28	492	0	20.9	18.1
2:18	512	0	16.5	18.5	6:33	490	0	20.9	18.1
2:23	514	0	16.5	18.5	6:38	488	0	20.9	18.1
2:28	510	0	16.5	18.5	6:43	487	0	20.9	18.1
2:33	509	0	16.4	18.5	6:48	483	0	20.9	18.1
2:38	509	0	16.4	18.5	6:53	484	0	21	18.1
2:43	507	0	16.4	18.5	6:58	483	0	21	18.1
2:48	511	0	16.3	18.5	7:03	484	0	21.1	18.1
2:53	515	0	16.3	18.5	7:08	486	0	21.1	18.1
2:58	520	0	16.2	18.5	7:13	486	0	21.2	18.1
3:03	517	0	16.2	18.5	7:18	490	0	21.2	18.1
3:08	519	0	16.2	18.5	7:23	491	0	21.3	18.1
3:13	518	0	16.1	18.4	7:28	493	0	21.2	18
3:18	515	0	16.1	18.4	7:33	514	0	21.1	17.9
3:23	511	0	16.1	18.4	7:38	535	0	21.1	17.9
3:28	512	0	16	18.4	7:43	560	0	21	17.9
3:33	515	0	16.1	18.4					
3:38	516	0	16.4	18.5					
3:43	518	0	17	18.6					
3:48	517	0	17.7	18.7					
3:53	515	0	18.2	18.8					
3:58	512	0	18.6	18.8					
4:03	508	0	18.9	18.7					
4:08	509	0	19.2	18.7					
4:13	503	0	19.5	18.7					
4:18	502	0	19.7	18.7					
4:23	500	0	19.9	18.7					
4:28	497	0	20.1	18.6					
4:33	496	0	20.3	18.6					
4:38	496	0	20.5	18.6					
4:43	492	0	20.6	18.6					
4:48	492	0	20.7	18.6					
4:53	491	0	20.8	18.6					
4:58	492	0	20.8	18.5					

Instrument Data		Site-15			Room 215			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
7:51	509	0	66	21.5	12:06	714	0	70.3	18.7			
7:56	551	0	66.5	20.8	12:11	714	0	70.2	18.7			
8:01	593	0	66.9	20.3	12:16	703	0	70	18.7			
8:06	597	0	67.3	20	12:21	688	0	69.9	18.7			
8:11	586	0	67.6	19.7	12:26	677	0	69.8	18.7			
8:16	583	0	67.9	19.5	12:31	667	0	69.6	18.7			
8:21	573	0	68.2	19.3	12:36	660	0	69.6	18.7			
8:26	573	0	68.4	19.2	12:41	650	0	69.5	18.6			
8:31	587	0	68.5	19	12:46	648	0	69.4	18.6			
8:36	585	0	68.4	19	12:51	701	0	69.6	18.6			
8:41	588	0	68.3	18.9	12:56	1342	0	70.3	19			
8:46	598	0	68.2	18.9	13:01	1179	0	70.7	19.2			
8:51	602	0	68	18.9	13:06	1217	0	70.9	19.3			
8:56	605	0	67.8	18.9	13:11	1217	0	70.7	19.5			
9:01	597	0	67.7	18.8	13:16	1154	0	70.4	19.5			
9:06	598	0	67.5	18.8	13:21	1084	0	70.2	19.5			
9:11	592	0	67.5	18.8	13:26	1018	0	70	19.4			
9:16	599	0	67.3	18.7	13:31	959	0	69.8	19.4			
9:21	614	0	67.2	18.7	13:36	915	0	69.8	19.3			
9:26	621	0	67.1	18.7	13:41	883	0	69.6	19.2			
9:31	611	0	67.2	18.7	13:46	862	0	69.6	19.2			
9:36	606	0	67.7	18.7	13:51	845	0	69.6	19.1			
9:41	610	0	68.1	18.7	13:56	840	0	69.6	19.1			
9:46	611	0	68.4	18.6	14:01	885	0	69.7	19.1			
9:51	609	0	68.5	18.6	14:06	893	0	69.6	19.1			
9:56	610	0	68.5	18.5	14:11	881	0	69.6	19.1			
10:01	615	0	68.4	18.5	14:16	855	0	69.5	19.1			
10:06	613	0	68.5	18.5	14:21	833	0	69.4	19			
10:11	613	0	68.6	18.5	14:26	809	0	69.3	19			
10:16	608	0	68.7	18.5	14:31	782	0	69.3	18.9			
10:21	609	0	68.7	18.5	14:36	748	0	69.3	18.9			
10:26	620	0	68.9	18.5	14:41	727	0	69.3	18.9			
10:31	645	0	68.9	18.5	14:46	710	0	69.3	18.9			
10:36	675	0	68.9	18.6	14:51	692	0	69.3	18.8			
10:41	703	0	69	18.6	14:56	670	0	69.3	18.8			
10:46	727	0	69.4	18.7	15:01	652	0	69.3	18.8			
10:51	749	0	70	18.7	15:06	632	0	69.3	18.8			
10:56	774	0	70.2	18.7	15:11	588	0	69.3	18.7			
11:01	786	0	70.1	18.7	15:16	554	0	69.2	18.6			
11:06	780	0	70	18.7	15:21	535	0	69.1	18.5			
11:11	781	0	70.2	18.8	15:26	548	0	68.9	18.5			
11:16	778	0	70.3	18.8	15:31	565	0	68.9	18.5			
11:21	772	0	70.3	18.8	15:36	555	0	68.8	18.4			
11:26	759	0	70.3	18.7	15:41	551	0	68.7	18.4			
11:31	747	0	70.5	18.7	15:46	562	0	68.7	18.4			
11:36	733	0	70.6	18.7	15:51	565	0	68.7	18.3			
11:41	727	0	70.7	18.7	15:56	551	0	68.5	18.3			
11:46	725	0	70.7	18.7	16:01	540	0	68.5	18.3			
11:51	728	0	70.7	18.7	16:06	530	0	68.5	18.3			
11:56	732	0	70.7	18.7	16:11	524	0	68.5	18.2			
12:01	725	0	70.5	18.7	16:16	518	0	68.4	18.2			

Instrument Data		Site-15			Room 215			12/9-10/2010			AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%			
16:21	514	0	68.4	18.2	20:36	415	0	66.4	17.4			
16:26	505	0	68.4	18.1	20:41	414	0	66.6	17.4			
16:31	501	0	68.4	18.1	20:46	411	0	66.6	17.4			
16:36	501	0	68.4	18.1	20:51	410	0	66.6	17.4			
16:41	501	0	68.5	18.1	20:56	408	0	66.7	17.4			
16:46	498	0	68.5	18.2	21:01	407	0	66.7	17.4			
16:51	493	0	68.4	18.3	21:06	400	0	66.7	17.4			
16:56	494	0	68.4	18.3	21:11	398	0	66.7	17.4			
17:01	495	0	68.2	18.3	21:16	397	0	66.7	17.4			
17:06	490	0	68.2	18.3	21:21	395	0	66.7	17.4			
17:11	487	0	68.1	18.2	21:26	393	0	66.7	17.4			
17:16	485	0	68	18.2	21:31	392	0	66.6	17.3			
17:21	477	0	67.9	18.2	21:36	390	0	66.6	17.3			
17:26	471	0	67.8	18.2	21:41	388	0	66.6	17.3			
17:31	476	0	67.7	18.2	21:46	388	0	66.6	17.3			
17:36	472	0	67.6	18.2	21:51	385	0	66.6	17.3			
17:41	471	0	67.6	18.1	21:56	384	0	66.6	17.3			
17:46	468	0	67.5	18.1	22:01	383	0	66.6	17.3			
17:51	464	0	67.3	18.1	22:06	379	0	66.6	17.3			
17:56	458	0	67.3	18	22:11	379	0	66.6	17.3			
18:01	455	0	67.3	18	22:16	380	0	66.6	17.3			
18:06	455	0	67.3	18	22:21	378	0	66.6	17.3			
18:11	457	0	67.1	17.9	22:26	377	0	66.6	17.3			
18:16	457	0	67.1	17.9	22:31	374	0	66.6	17.3			
18:21	458	0	67.1	17.9	22:36	372	0	66.5	17.2			
18:26	463	0	67.1	17.9	22:41	372	0	66.4	17.2			
18:31	464	0	67	17.8	22:46	372	0	66.4	17.2			
18:36	464	0	66.9	17.8	22:51	371	0	66.4	17.2			
18:41	462	0	66.9	17.8	22:56	372	0	66.4	17.2			
18:46	461	0	66.9	17.8	23:01	371	0	66.4	17.2			
18:51	459	0	66.9	17.7	23:06	369	0	66.4	17.2			
18:56	456	0	66.9	17.7	23:11	366	0	66.4	17.2			
19:01	452	0	66.9	17.7	23:16	368	0	66.4	17.2			
19:06	445	0	66.9	17.7	23:21	366	0	66.4	17.2			
19:11	440	0	66.9	17.7	23:26	366	0	66.4	17.2			
19:16	434	0	66.9	17.6	23:31	365	0	66.4	17.2			
19:21	430	0	66.8	17.6	23:36	366	0	66.4	17.2			
19:26	427	0	66.7	17.6	23:41	366	0	66.4	17.1			
19:31	427	0	66.7	17.6	23:46	364	0	66.4	17.1			
19:36	426	0	66.7	17.6	23:51	365	0	66.4	17.1			
19:41	423	0	66.7	17.5	23:56	364	0	66.4	17.1			
19:46	421	0	66.7	17.5	0:01	364	0	66.4	17.1			
19:51	422	0	66.7	17.5	0:06	363	0	66.2	17.1			
19:56	418	0	66.7	17.5	0:11	361	0	66.2	17.1			
20:01	421	0	66.6	17.5	0:16	360	0	66.2	17.1			
20:06	420	0	66.6	17.5	0:21	360	0	66.2	17.1			
20:11	419	0	66.6	17.4	0:26	360	0	66.2	17.1			
20:16	418	0	66.6	17.4	0:31	361	0	66.1	17.1			
20:21	419	0	66.6	17.4	0:36	361	0	66	17.1			
20:26	420	0	66.6	17.4	0:41	357	0	66	17.1			
20:31	417	0	66.5	17.4	0:46	356	0	66	17			

Instrument Data		Site-15			Room 215			12/9-10/2010		AQM #10-510	
Time	CO ₂ ppm	CO ppm	Temp deg C	RH%	Time	CO ₂ ppm	CO ppm	Temp deg C	RH%		
0:51	355	0	65.8	17	5:06	344	0	65.1	16.7		
0:56	349	0	65.8	17	5:11	346	0	65.1	16.7		
1:01	347	0	65.8	17	5:16	346	0	65.1	16.7		
1:06	350	0	65.8	17	5:21	348	0	65.1	16.7		
1:11	354	0	65.8	17	5:26	347	0	65.1	16.7		
1:16	351	0	65.8	17	5:31	348	0	65.1	16.7		
1:21	351	0	65.8	17	5:36	349	0	65.1	16.7		
1:26	350	0	65.8	17	5:41	348	0	65.1	16.7		
1:31	350	0	65.8	17	5:46	345	0	65	16.6		
1:36	351	0	65.8	17	5:51	347	0	64.9	16.6		
1:41	351	0	65.8	17	5:56	347	0	64.9	16.6		
1:46	355	0	65.8	17	6:01	348	0	64.9	16.6		
1:51	352	0	65.8	17	6:06	348	0	64.9	16.6		
1:56	352	0	65.8	17	6:11	346	0	64.9	16.6		
2:01	351	0	65.8	16.9	6:16	345	0	64.9	16.6		
2:06	344	0	65.8	16.9	6:21	345	0	64.9	16.6		
2:11	349	0	65.8	16.9	6:26	344	0	64.9	16.6		
2:16	352	0	65.8	16.9	6:31	348	0	64.9	16.6		
2:21	349	0	65.8	16.9	6:36	345	0	64.9	16.6		
2:26	349	0	65.7	16.9	6:41	345	0	64.8	16.6		
2:31	350	0	65.7	16.9	6:46	346	0	64.8	16.6		
2:36	347	0	65.7	16.9	6:51	347	0	64.8	16.5		
2:41	349	0	65.7	16.9	6:56	349	0	64.8	16.5		
2:46	351	0	65.7	16.9	7:01	352	0	64.8	16.5		
2:51	349	0	65.7	16.9	7:06	353	0	64.8	16.5		
2:56	349	0	65.7	16.9	7:11	351	0	64.6	16.5		
3:01	354	0	65.7	16.9	7:16	347	0	64.4	16.4		
3:06	352	0	65.7	16.9	7:21	348	0	64.4	16.4		
3:11	351	0	65.6	16.8	7:26	349	0	64.2	16.4		
3:16	350	0	65.5	16.8	7:31	353	0	64.2	16.4		
3:21	349	0	65.5	16.8	7:36	362	0	64.2	16.4		
3:26	348	0	65.5	16.8	7:41	374	0	64.4	16.4		
3:31	349	0	65.5	16.8	7:46	387	0	64.6	16.4		
3:36	350	0	65.5	16.8							
3:41	349	0	65.5	16.8							
3:46	346	0	65.5	16.8							
3:51	348	0	65.5	16.8							
3:56	346	0	65.5	16.8							
4:01	349	0	65.5	16.8							
4:06	347	0	65.5	16.8							
4:11	348	0	65.5	16.8							
4:16	348	0	65.4	16.8							
4:21	347	0	65.3	16.8							
4:26	345	0	65.3	16.7							
4:31	343	0	65.3	16.7							
4:36	344	0	65.3	16.7							
4:41	345	0	65.3	16.7							
4:46	344	0	65.3	16.7							
4:51	346	0	65.3	16.7							
4:56	345	0	65.2	16.7							
5:01	344	0	65.1	16.7							

APPENDICES
SILICA RESULTS

GALSON
LABORATORIES

6601 Kirtville Rd.
East Syracuse, NY 13057
Tel: (315) 432-5227
360-432-LABS (5227)
Fax: (315) 437-0571
www.galsonlabs.com

Check if change of address
 New Client? yes no

Report To: Air Quality Mgmt Services
PO Box 20635
Rockton, IL 60421

Phone No.: 807 657 7360
Fax No.: 807 657 7361

Invoice To: Air Quality Mgmt Services
PO Box 20635
Rockton, IL 60421

Phone No.: 807-657-7360
Fax No.:

Site Name: Biddleford High Project: 10-510

Card Holder Name: _____ Exp: _____

Client Account No.: 74067
Purchase Order No.: 10-510
Credit Card No.: _____

Email / Fax Results To: Nandy Griffin
Email Address: ngiffin@airquality.com

Sampled By: _____

Samples submitted using the FreeSamplingBadge™ Program.

Need Results By: (surcharge)
 6 Business Days 0%
 4 Business Days 35%
 3 Business Days 50%
 2 Business Days 75%
 Next Day by Eom 100%
 Next Day by Noon 150%
 Same day 200%

Sample Identification	Date Sampled	Collection Medium	*Air Volume (Liters)	Passive Monitors (Min)	Analysis Requested	Method Reference	Specific Detection Needed
1. 51-Room 105	12/9/10	AW-PVC	1050L	1016.4L	Resp Dust + PEST	NIOSH	2000/7500
2. 52-Room 107							
3. 53-Hall by Room 112							
4. 54-Hall by Speech Rm							
5. 55-Hall by Girls Gym							
6. 56-Hall by P.E. Room							
7. 57-Hall by Girls Locker							
8. 58-Hall by Rm 14							
9. 59-Office by Reception							
10. 510-Hall by Charis							
11. 511-Office by L.H. White							

Yes No We normally add a laboratory blank for each analysis. We will charge you for this at our normal rate. If you agree please check "Yes" otherwise check "No".

List description of industry or process / interference's present in sampling area:

Comments:

Chain of Custody: _____ Date/Time: _____

Relinquished by: Nandy Griffin Signature: _____ Date/Time: 12/9/10


Received by LAB: CPA Signature: _____ Date/Time: 12/13/10

Page 1 of 2

Samples received after 3pm will be considered as next day's business.

* Sample collected by this X LPM = Air Vol.

CUSTOMER COPY



Report To: Air Quality Mgmt Services
PO Box 20195
Blacksburg, VA
24024

Phons No.: 807 657 7360
 Fax No.: 807 657 7361

Check if change of address yes no
 New Client? yes no

Phone No.: 202 657 7260
 Fax No.: _____
 Exp.: _____

Site Name: Biddeford High Project: 10-510
 Samples submitted using the FreeSamplingBadges™ Program.

Client Account No.: 14067
 Purchase Order No.: 10-510
 Credit Card No.: _____
 Card Holder Name: _____
 Exp.: _____

Email / Fax Results To: Handy Geo. Fray
 Email Address: Geo.Fray@services.com
 Fax No.: _____

Sample Identification	Date Sampled	Collection Medium	Air Volume (Liters)	Passive Monitor (Min)	Analysis Requested	Method Reference	Specific DL Needed
S12 - Hall by Am 8	12/9/10	PW-PVC	1050	1016.4 L	Mesi Dust, St. A, Cat	M105H	7500
S13 - Hall by Am 23							
S11 - Room 203							
S15 - Room 215							
S16 - Hall by Am 216							
S17 - Hall by Am 207							
S18 - Room 209							
S19 - Field blank	12/9/10	PW-PVC					
S20 - Field blank	12/9/10	PW-PVC					
D1 - Dust in air CT Km 105	12/9/10						7500
D2 - Dust in air CT Km 215	12/9/10						7500

Yes No We normally add a laboratory blank for each analyte. We will charge you for this at our normal rate. If you agree please check "Yes" otherwise check "No".
 List description of industry or process / interference's present in sampling area:

Comments: _____
 Chain of Custody: _____
 Retrievable by: Handy Geo. Fray
 Received by LAB: _____
 Login #: _____
 Signature: [Signature]
 Date/Time: 12/10/10 1900
 * sample collection time X LPM = Air Vol.
10 x 10 x 10 = 1000
page 2 of 2



LABORATORY ANALYSIS REPORT

6601 Kirkville Road
 East Syracuse, NY 13057
 (315) 432-5227
 FAX: (315) 437-0571
 www.galsonlabs.com

Client : Air Quality Management Services
 Site : Biddeford High
 Project No. : 10-510
 Date Sampled : 09-DEC-10
 Date Received : 13-DEC-10
 Date Analyzed : 14-DEC-10 - 18-DEC-10
 Report ID : 674977

Account No.: 14067
 Login No. : L230411

Respirable Dust and Crystalline Silica: Quartz, Cristobalite, Tridymite

Sample ID	Lab ID	Analyte	Air Vol				Dust P E L mg/m3
			l	mg	%	mg/m3	
S1-ROOM 105	L230411-1	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S2-ROOM 107	L230411-2	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S3-HALL BY RM 112	L230411-3	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S4-HALL BY SPEECH RM	L230411-4	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	

COMMENTS: Please see attached lab footnote report for any applicable footnotes.

Level of quantitation: Dust 0.10mg Q:0.010mg C:0.010mg T:0.020mg Submitted by: pah/AJD
 Analytical Method : mod NIOSH 0600/7500;mod OSHA ID-142 Approved by : KRK
 OSHA PEL (TWA) : see 1910.1000 (Table Z-3) Date : 20-DEC-10 NYS DOH # : 11626
 Collection Media : PVC FW QC by: Tom Burgess

< -Less Than mg -Milligrams m3 -Cubic Meters kg -Kilograms
 > -Greater Than ug -Micrograms l -Liters NS -Not Specified
 NA -Not Applicable ND -Not Detected ppm -Parts per Million



LABORATORY ANALYSIS REPORT

6601 Kirkville Road
 East Syracuse, NY 13057
 (315) 432-5227
 FAX: (315) 437-0571
 www.galsonlabs.com

Client : Air Quality Management Services
 Site : Biddeford High
 Project No. : 10-510
 Date Sampled : 09-DEC-10
 Date Received : 13-DEC-10
 Date Analyzed : 14-DEC-10 - 18-DEC-10
 Report ID : 674977

Account No.: 14067
 Login No. : L230411

Respirable Dust and Crystalline Silica: Quartz, Cristobalite, Tridymite

Sample ID	Lab ID	Analyte	Air Vol l	mg	%	mg/m3	Dust
							PEL mg/m3
S5-HALL BY GIRLS GYM	L230411-5	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S6-HALL BY CAFE	L230411-6	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S7-HALL GIRLS LOCKER	L230411-7	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S8-HALL BY RM 14	L230411-8	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	

COMMENTS: Please see attached lab footnote report for any applicable footnotes.

Level of quantitation: Dust 0.10mg Q:0.010mg C:0.010mg T:0.020mg Submitted by: pah/AJD
 Analytical Method : mod NIOSH 0600/7500;mod OSHA ID-142 Approved by : KRK
 OSHA PEL (TWA) : see 1910.1000 (Table Z-3) Date : 20-DEC-10 NYS DOH # : 11626
 Collection Media : PVC PW QC by: Tom Burgess

< -Less Than mg -Milligrams m3 -Cubic Meters kg -Kilograms
 > -Greater Than ug -Micrograms l -Liters NS -Not Specified
 NA -Not Applicable ND -Not Detected ppm -Parts per Million



LABORATORY ANALYSIS REPORT

6601 Kirkville Road
 East Syracuse, NY 13057
 (315) 432-5227
 FAX: (315) 437-0571
 www.galsonlabs.com

Client : Air Quality Management Services
 Site : Biddeford High
 Project No. : 10-510
 Date Sampled : 09-DEC-10
 Date Received : 13-DEC-10
 Date Analyzed : 14-DEC-10 - 18-DEC-10
 Report ID : 674977

Account No.: 14067
 Login No. : L230411

Respirable Dust and Crystalline Silica: Quartz, Cristobalite, Tridymite

Sample ID	Lab ID	Analyte	Air Vol	mg	%	mg/m3	Dust
			l				PEL
S9-ROOM 4	L230411-9	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S10-HALL BY CHORUS	L230411-10	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S11-LITTLE THEATRE	L230411-11	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S12-HALL BY RM8	L230411-12	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	

COMMENTS: Please see attached lab footnote report for any applicable footnotes.

Level of quantitation: Dust 0.10mg Q:0.010mg C:0.010mg T:0.020mg Submitted by: pah/AJD
 Analytical Method : mod NIOSH 0600/7500;mod OSHA ID-142 Approved by : KRK
 OSHA PEL (TWA) : see 1910.1000 (Table Z-3) Date : 20-DEC-10 NYS DOH # : 11626
 Collection Media : PVC PW QC by: Tom Burgess

< -Less Than mg -Milligrams m3 -Cubic Meters kg -Kilograms
 > -Greater Than ug -Micrograms l -Liters NS -Not Specified
 NA -Not Applicable ND -Not Detected ppm -Parts per Million



LABORATORY ANALYSIS REPORT

6601 Kirkville Road
 East Syracuse, NY 13057
 (315) 432-5227
 FAX: (315) 437-0571
 www.galsonlabs.com

Client : Air Quality Management Services
 Site : Biddeford High
 Project No. : 10-510
 Date Sampled : 09-DEC-10
 Date Received : 13-DEC-10
 Date Analyzed : 14-DEC-10 - 18-DEC-10
 Report ID : 674977

Account No.: 14067
 Login No. : L230411

Respirable Dust and Crystalline Silica: Quartz, Cristobalite, Tridymite

Sample ID	Lab ID	Analyte	Air Vol l	mg	%	mg/m3	Dust
							PEL mg/m3
S13 HALL BY RM223	L230411-13	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S14-ROOM 203	L230411-14	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S15- ROOM 215	L230411-15	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S16-HALL BY RM216	L230411-16	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	

COMMENTS: Please see attached lab footnote report for any applicable footnotes.

Level of quantitation: Dust 0.10mg Q:0.010mg C:0.010mg T:0.020mg Submitted by: pah/AJD
 Analytical Method : mod NIOSH 0600/7500;mod OSHA ID-142 Approved by : KRK
 OSHA PEL (TWA) : see 1910.1000 (Table Z-3) Date : 20-DEC-10 NYS DOH # : 11626
 Collection Media : PVC PW QC by: Tom Burgess

< -Less Than mg -Milligrams m3 -Cubic Meters kg -Kilograms
 > -Greater Than ug -Micrograms l -Liters NS -Not Specified
 NA -Not Applicable ND -Not Detected ppm -Parts per Million



LABORATORY ANALYSIS REPORT

6601 Kirkville Road
 East Syracuse, NY 13057
 (315) 432-5227
 FAX: (315) 437-0571
 www.galsonlabs.com

Client : Air Quality Management Services
 Site : Biddeford High
 Project No. : 10-510
 Date Sampled : 09-DEC-10
 Date Received : 13-DEC-10
 Date Analyzed : 14-DEC-10 - 18-DEC-10
 Report ID : 674977
 Account No.: 14067
 Login No. : L230411

Respirable Dust and Crystalline Silica: Quartz, Cristobalite, Tridymite

Sample ID	Lab ID	Analyte	Air Vol	mg	%	mg/m3	Dust
			l				PEL
S17 HALL BY RM 207	L230411-17	Dust	1016.4	<0.10		<0.098	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S18 ROOM 209	L230411-18	Dust	1016.4	0.12		0.12	5.0
		Quartz	1016.4	<0.010	ND	<0.0098	
		Cristobalite	1016.4	<0.010	ND	<0.0098	
		Tridymite	1016.4	<0.020	ND	<0.020	
S19-FIELD BLANK	L230411-19	Dust	NA	<0.10		NA	NA
		Quartz	NA	<0.010	ND	NA	
		Cristobalite	NA	<0.010	ND	NA	
		Tridymite	NA	<0.020	ND	NA	
S20-FIELD BLANK	L230411-20	Dust	NA	<0.10		NA	NA
		Quartz	NA	<0.010	ND	NA	
		Cristobalite	NA	<0.010	ND	NA	
		Tridymite	NA	<0.020	ND	NA	

COMMENTS: Please see attached lab footnote report for any applicable footnotes.

Level of quantitation: Dust 0.10mg Q:0.010mg C:0.010mg T:0.020mg Submitted by: pah/AJD
 Analytical Method : mod NIOSH 0600/7500;mod OSHA ID-142 Approved by : KRK
 OSHA PEL (TWA) : see 1910.1000 (Table Z-3) Date : 20-DEC-10 NYS DOH # : 11626
 Collection Media : PVC PW QC by: Tom Burgess

< -Less Than mg -Milligrams m3 -Cubic Meters kg -Kilograms
 > -Greater Than ug -Micrograms l -Liters NS -Not Specified
 NA -Not Applicable ND -Not Detected ppm -Parts per Million



LABORATORY ANALYSIS REPORT

6601 Kirkville Road East Syracuse, NY 13057 (315) 432-5227 FAX: (315) 437-0571 www.galsonlabs.com	Client : Air Quality Management Services Site : Biddeford High Project No. : 10-510 Date Sampled : 09-DEC-10 Date Received : 13-DEC-10 Date Analyzed : 18-DEC-10 Report ID : 675813	Account No.: 14067 Login No. : L230411
---	---	---

Silica: Quartz, Cristobalite, Tridymite

<u>Sample ID</u>	<u>Lab ID</u>	<u>Analyte</u>	<u>%</u>
# D1-DUST ABOVE RM105	L230411-21	Quartz	3.2
		Cristobalite	<0.5
		Tridymite	<1.5
^ D2-DUST ABOVE RM215	L230411-22	Quartz	6.0
		Cristobalite	<0.6
		Tridymite	<2.1

COMMENTS: Please see attached lab footnote report for any applicable footnotes.

Level of quantitation: Q:0.50% C:0.50% T:1.0%	Submitted by: AJD
Analytical Method : modNIOSH 7500/modOSHA ID142; XRD	Approved by : KRK
OSHA PEL (TWA) : NA	Date : 20-DEC-10 NYS DOH # : 11626
Collection Media : Bulk	QC by: Tom Burgess

< -Less Than	mg -Milligrams	m3 -Cubic Meters	kg -Kilograms
> -Greater Than	ug -Micrograms	l -Liters	NS -Not Specified
NA -Not Applicable	ND -Not Detected	ppm -Parts per Million	



LABORATORY FOOTNOTE REPORT

6601 Kirkville Road
East Syracuse, NY 13057
(315) 432-5227
FAX: (315) 437-0571
www.galsonlabs.com

Client Name : Air Quality Management Services
Site : Biddeford High
Project No. : 10-510

Date Sampled : 09-DEC-10 Account No.: 14067
Date Received: 13-DEC-10 Login No. : L230411
Date Analyzed: 14-DEC-10 - 18-DEC-10

Unless otherwise noted below, all quality control results associated with the samples were within established control limits.

Unrounded results are carried through the calculations that yield the final result and the final result is rounded to the number of significant figures appropriate to the accuracy of the analytical method. Please note that results appearing in the columns preceeding the final result column may have been rounded in order to fit the report format and therefore, if carried through the calculations, may not yield an identical final result to the one reported.

The stated LOQs for each analyte represent the demonstrated LOQ concentrations prior to correction for desorption efficiency (if applicable).

L230411 (Report ID: 675813):
SOPs: ix-calibrate(7), ix-xrdbulkprep(8), ix-xrdreview(5), ix-xrdstdprep(11)

L230411 (Report ID: 675813):
Elevated tridymite reporting limit due to matrix interference.

^ L230411 (Report ID: 675813):
Elevated cristobalite and tridymite reporting limits due to matrix interference.

L230411 (Report ID: 675813):
Bulk silica results are considered approximate, per OSHA ID-142 section 7.5.4.

L230411 (Report ID: 674977):
There is an average weight loss of 0.028 mg +/- 0.056 mg (95% confidence level) per PVC sample filter. The sample results have not been corrected for the average loss.
SOPs: GRAV-SOP-1(6), ix-calibrate(7), ix-xrdashprep(9), ix-xrdreview(5), ix-xrdstdprep(11)

< -Less Than	mg -Milligrams	m3 -Cubic Meters	kg -Kilograms
> -Greater Than	ug -Micrograms	l -Liters	NS -Not Specified
NA -Not Applicable	ND -Not Detected	ppm -Parts per Million	
